

# Five-Year Water Quality and Supply Plan



2023-24 to 2027-28

**DRAFT**

*“ To assure that pumping does not lead to further degradation of water quality in the Basin, a Five-Year Water Quality and Supply Plan must be prepared and updated annually by Watermaster...”*

*Section 28 of Watermaster’s Rules and Regulations*

# **Five-Year Water Quality and Supply Plan**

November 2023



Main San Gabriel Basin  
**WATERMASTER**

Telephone (626) 815-1300 • Fax (626) 815-1303  
725 North Azusa Avenue • Azusa, California 91702  
[www.watermaster.org](http://www.watermaster.org)



# CONTENTS

<b>I. INTRODUCTION</b>	<b>2</b>
PURPOSE OF THE FIVE-YEAR PLAN	2
WATERMASTER BACKGROUND AND HISTORY	2
Figure 1. Area Covered by Main San Gabriel Basin	3
<b>II. CURRENT WATER SUPPLY CONDITIONS</b>	<b>4</b>
WATER SUPPLY INFLOWS DURING 2022-23	4
Figure 2. Rainfall Was Above the Long-Term Average This Year, but Only for Three of the Past 10 Years	4
Figure 3. Annual Local Water Runoff Was Well Above Average	5
Figure 4. Imported Water Deliveries Below Long-Term Average in FY 2022-23	5
Figure 5. Local Water Conserved Was Well Above Average	6
Figure 6. Cyclic Storage is Well Above Average for the Fifth Consecutive Year	8
Figure 7. Cyclic Storage and Rainfall Increased the Key Well Level by 37 Feet in 2022-23	8
Figure 8. Total Water Demand (Water Use) Reduced to Historic Low	9
Figure 9. Key Well Elevations During the Last 10 Years	11
Figure 10. Water Stored in San Gabriel Canyon Reservoirs is Near Minimum Pool	12
Figure 11. Groundwater Production Continues Long Downward Trend	12
<b>III. CURRENT WATER QUALITY CONDITIONS</b>	<b>13</b>
PRIMARY CONTAMINANTS IN THE GROUNDWATER BASIN	14
WELLS ASSESSED FOR VULNERABILITY TO CONTAMINATION	17
Figure 12. Location of USEPA Operable Units	17
Figure 13. Volatile Organic Compound Levels in Groundwater Throughout the Basin	18
Figure 14. Nitrate Levels in Groundwater Throughout the Basin	19
<b>IV. FIVE-YEAR WATER QUALITY AND SUPPLY PLAN</b>	<b>20</b>
GROUNDWATER MONITORING PROGRAMS	20
CONTINUE BASINWIDE GROUNDWATER ELEVATION MONITORING PROGRAM (BGWEMP)	21
IMPLEMENT PROVISIONS OF SUSTAINABLE GROUNDWATER MANAGEMENT ACT (SGMA)	21
GROUNDWATER QUALITY MONITORING	22
GROUNDWATER FLOW AND CONTAMINANT MIGRATION PROGRAMS	23
GROUNDWATER CLEANUP PROJECTS	25
BASIN CLEANUP PROJECTS/USEPA OPERABLE UNIT PLANS	25
OTHER WATER QUALITY PLANNING AND ACTIONS	26
WATER SUPPLY AND DROUGHT MANAGEMENT PLANNING AND ACTIONS	27
PROJECTED GROUNDWATER DEMAND PRODUCER ESTIMATES	31
<b>V. DIRECTORY TO APPENDICES</b>	<b>32</b>
Appendix A. Projected Groundwater Demands from 2023-24 to 2027-28	
Appendix B. Simulated Changes in Groundwater Elevations at Wells or Wellfields in Main San Gabriel Basin	
Appendix C. Highlights of Volatile Organic Compounds and Nitrate Concentrations, and Wells Vulnerable to Contamination	
Appendix D. Potential Sites for Aquifer Performance Tests	
Appendix E. Summary of Treatment Facility Activity in the Main San Gabriel Basin	
Appendix F. Simulated Basin Groundwater Contours 2022-23 and 2027-28 (Figures 15 and 16), Simulated Groundwater Elevation Changes Between FY 2022-23 and FY 2027-28 (Figure 17), VOC Plume Map in BPOU and Perchlorate Plume Map in BPOU (Figures 18 and 19)	

# INTRODUCTION

Main San Gabriel Basin Watermaster (Watermaster) annually prepares and updates this Five-Year Water Quality and Supply Plan (Five-Year Plan) in accordance with the requirements of Section 28 of its Rules and Regulations. The objective is to coordinate groundwater-related activities so that both water supply and water quality in the Main San Gabriel Basin (Basin) are protected and improved.

## PURPOSE OF THE FIVE-YEAR PLAN

Many important issues are detailed in the Five-Year Plan, including Watermaster's plans for the following activities:

1. Monitor groundwater supply and quality.
2. Develop projections of future groundwater supply and quality.
3. Provide water supply and drought management to ensure long-term reliable and sustainable water supplies.
4. Review and cooperate on cleanup projects and provide technical assistance to other agencies.
5. Assure that pumping does not lead to further water quality degradation in the Basin.
6. Address emerging contaminants in the Basin.
7. Develop a cleanup and water supply program consistent with the U.S. Environmental Protection Agency (USEPA) plans for its Main San Gabriel Basin Superfund sites.
8. Continue to perform responsibilities under the Baldwin Park Operable Unit (BPOU) Project Agreement relating to project administration and performance evaluation.

## WATERMASTER BACKGROUND AND HISTORY

The Los Angeles County Superior Court created the Main San Gabriel Basin Watermaster in 1973 to resolve water issues among water users in the San Gabriel Valley. At that time, the Watermaster's mission was to manage the Basin's water supply. During the late 1970s and early 1980s, significant concentrations of contaminants were detected in the groundwater Basin. The contamination was partly caused by past practices of local industries that had inappropriately disposed of industrial solvents and by infiltration of nitrates from an earlier agricultural period. Cleanup efforts for industrial contamination were undertaken at the local, state, and federal levels.

### WATERMASTER RECEIVES WATER QUALITY RESPONSIBILITIES

By 1989, local water agencies had adopted a joint resolution concerning water quality issues, which stated that Watermaster should coordinate local activities to preserve and restore groundwater quality in the Basin. The joint resolution also called for a Basin cleanup plan. In 1991, the Los Angeles County Superior Court granted Watermaster the authority to control pumping for water quality purposes.

Accordingly, Watermaster added Section 28 to its Rules and Regulations regarding water quality management. The new responsibilities included developing this Five-Year Water Quality and Supply Plan; updating it annually, submitting it to the California Regional Water Quality Control Board, Los Angeles Region (Regional Board); and making it available for public review by November 1 of each year.

## PLAN TO PERMANENTLY BALANCE THE BASIN'S GROUNDWATER SUPPLY

For decades, the Basin depended on imported replenishment water to meet about 20% of local needs. However, the reliability of these imported supplies has been diminishing over the years. The severe 2011–2016 drought made clear that Watermaster could not exclusively count on imported water deliveries each year for long-term sustainability.

Early in the drought, Watermaster recognized changes in the water supply that were occurring. As a result, by 2012, Watermaster unanimously approved an unprecedented set of changes to its Rules and Regulations to engage in developing new, proactive strategies for water supplies and storage.

**Watermaster and Its Partners Have the Tools to Balance the Basin.** Over the years, Watermaster, the Producers, and its many partners have developed a large portfolio of water tools and programs that are used in both dry and wet years to manage the Basin effectively.

Watermaster and its partners work to flexibly adapt to changing circumstances. For example, in 2022-23, new tools were developed such as Reverse Cyclic storage and the Water Supply Agreement with Metropolitan Water District of Southern California (MWD) to extend the timing for recharging imported water.

While there are many elements of Watermaster's Plan to proactively improve long-term water supplies and storage, the three most important are:

1. Maintain a low Operating Safe Yield (OSY). The key impact of a low OSY is that it requires the purchase of additional Replenishment Water to meet demands while helping to refill the Basin.
2. Collect funds through the Resource Development Assessment (RDA) to purchase Replenishment Water whenever it is available. Storing Replenishment Water helps replenish the Basin and ensures that water is available to counter the impacts of future extreme droughts.
3. Collaborate in the Metropolitan Water District's (MWD) Regional Recycled Water Program, which is being designed to deliver up to 80,000 acre-feet of reliable recycled water to the Basin to replace variable imported supplies and decreased local runoff in dry years.


Figure 1. AREA COVERED BY MAIN SAN GABRIEL BASIN

### Massive Basin

The Basin has a surface area of 167 square miles and can hold about 2.8 trillion gallons of groundwater.

### Watermaster's Role

Watermaster manages the overall quantity and quality of the Basin's giant underground water supply.

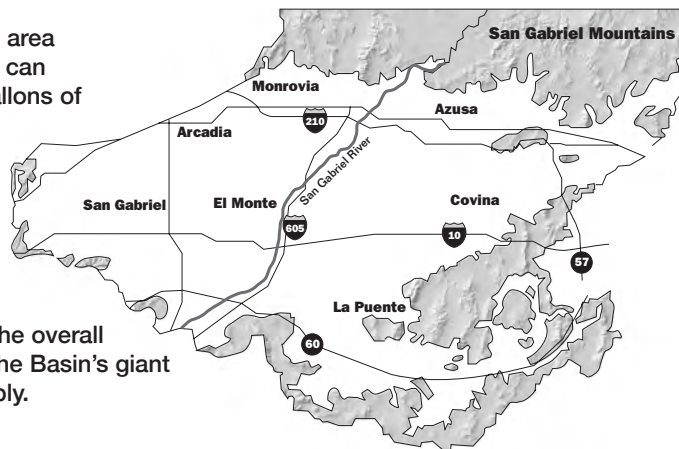

### Precious Underground Water Supply

The Basin provides up to 90 billion gallons of groundwater annually, enough to meet over 80% of the water needs for San Gabriel Valley's 1.4 million residents.

# CURRENT WATER SUPPLY CONDITIONS


Drier-than-normal conditions have generally persisted in the San Gabriel Valley for the past two decades. Commencing in fiscal year 1998-99, annual rainfall has been below the long-term average annual amount of 18.52 inches in 19 of the past 25 years. However, during fiscal year 2022-23, the San Gabriel Valley received 34.41 inches of much-needed rainfall, which is about 186% of long-term average. This rainfall has provided relief to the San Gabriel Valley, but drier-than-normal conditions may return at any time.

More information about programs to improve long-term water reliability is provided under Water Supply and Drought Management Planning and Actions on page 27.

## WATER SUPPLY INFLOWS DURING 2022-23

VALLEY RECEIVES MUCH-NEEDED RAINFALL AFTER THE PAST THREE YEARS OF BELOW-AVERAGE RAINFALL

Figure 2. RAINFALL WAS ABOVE THE LONG-TERM AVERAGE THIS YEAR, BUT ONLY FOR THREE OF THE PAST 10 YEARS

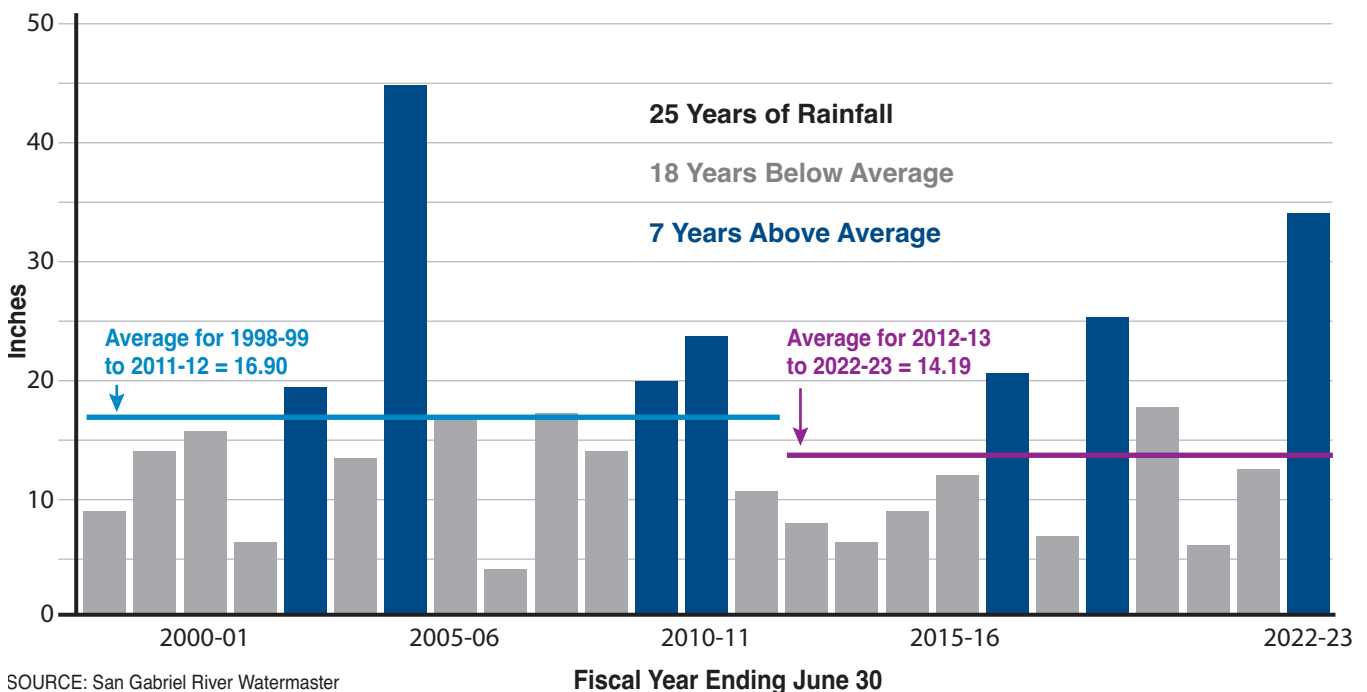


SOURCE: San Gabriel River Watermaster

In 2022-23, the San Gabriel Valley received 34.41 inches of rain, about 186% of the long-term average of 18.52 inches. The rainfall total is an average taken from four stations located in San Dimas, Diamond Bar, El Monte, and Pasadena. Rain has been below average over the past two decades. Eighteen of the past 25 years have experienced below-average rainfall.




**Figure 3. ANNUAL LOCAL WATER RUNOFF WAS WELL ABOVE AVERAGE**

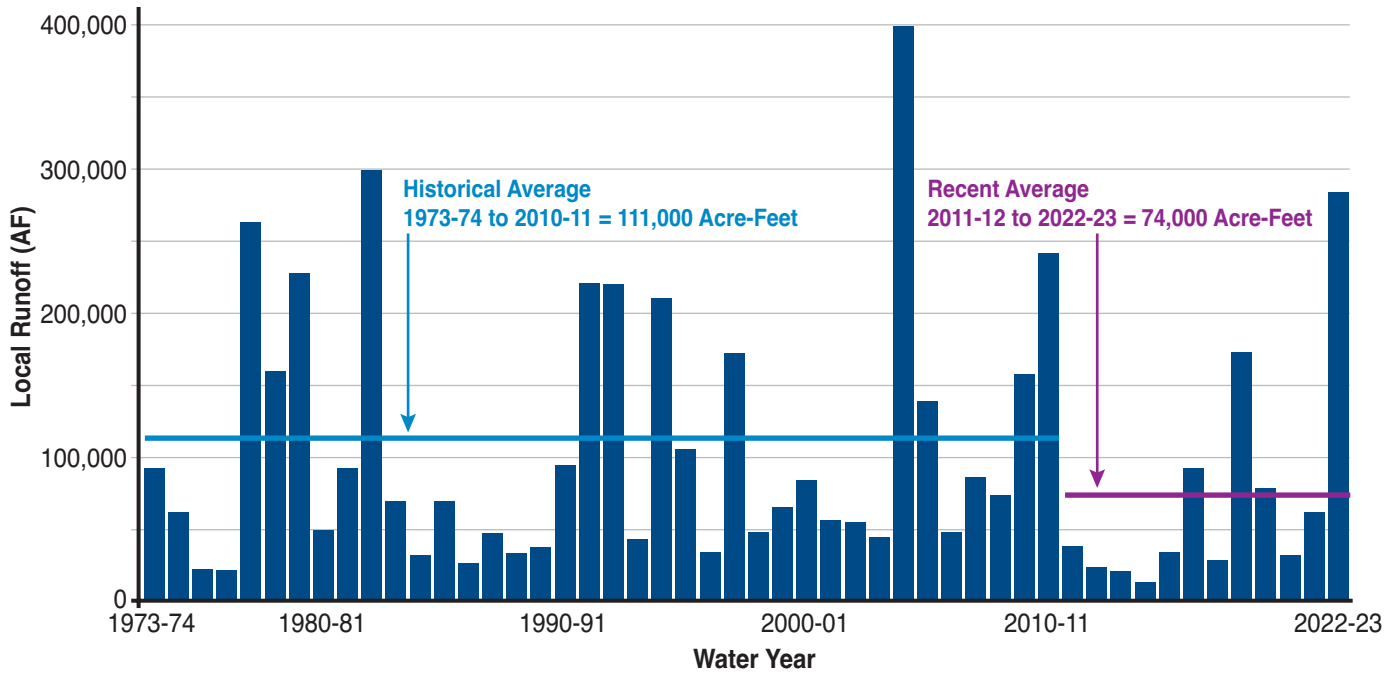

In 2022-23, Annual runoff was about 286,000 acre-feet, well above the historical average of about 111,000 acre-feet. However, in the 11 years between 2011-12 and 2021-22, there has been about 600,000 acre-feet less runoff than would be expected due to the many drought years.

**Figure 4. IMPORTED WATER DELIVERIES BELOW LONG-TERM AVERAGE IN FY 2022-23**

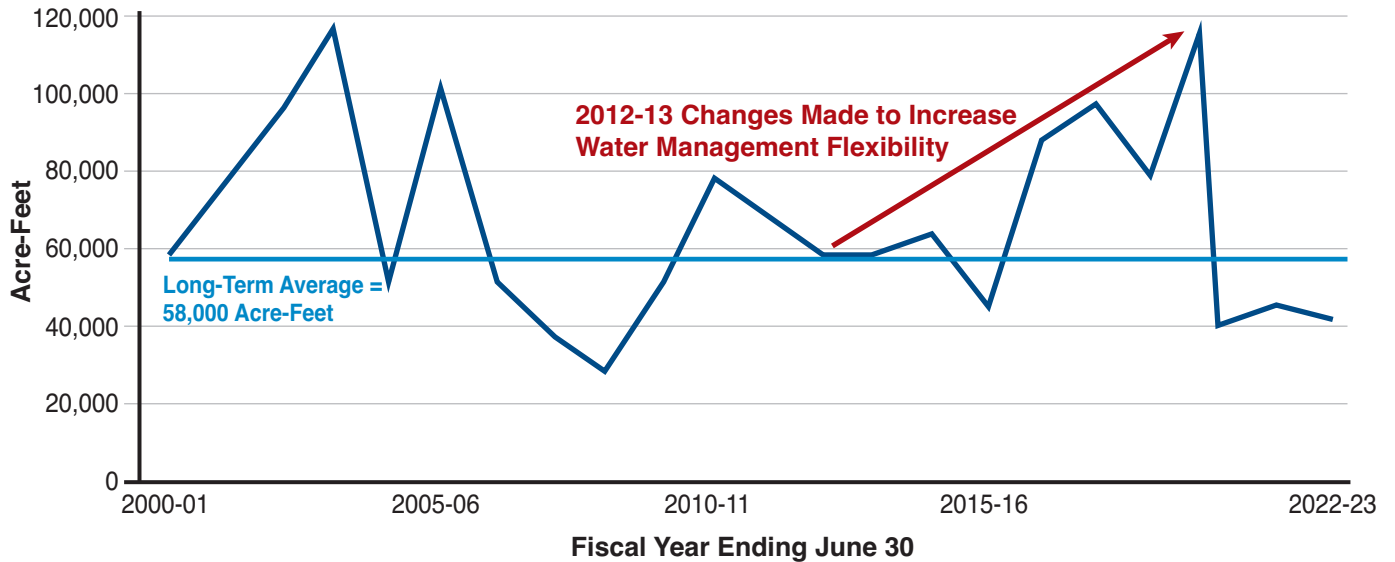


Imported water deliveries (treated and untreated) during 2022-23 were below the long-term average because imported water was less available due to the drought. In addition, due to above-average rainfall, significant runoff was spread in the San Gabriel Valley through June 2023, delaying untreated imported water deliveries for spreading into the next fiscal year. As a result, water imports totaled only about 41,000 acre-feet for direct use and groundwater replenishment. This is about 71% of the long-term average of about 58,000 acre-feet.

The RDA has provided steady funding needed to secure available imported water. As a result, imported water deliveries have been above average in recent years, though imports this year were below average because of limited supplies due to the drought.

**MANAGEMENT CHANGES SINCE 2012-13 ARE RESULTING IN INCREASED IMPORTED SUPPLIES**

The long-term reliability of imported water supplies has decreased due to drought, increased competition for limited water supplies, and regulations that allocate water supplies for environmental uses. Despite these challenges, Watermaster’s assertive management programs and flexible funding for imported water supply purchases through the RDA, Cyclic Storage, and other programs have enabled a trend of increasing imports of water to help balance the Basin over the long term.

**Figure 5. LOCAL WATER CONSERVED WAS WELL ABOVE AVERAGE**

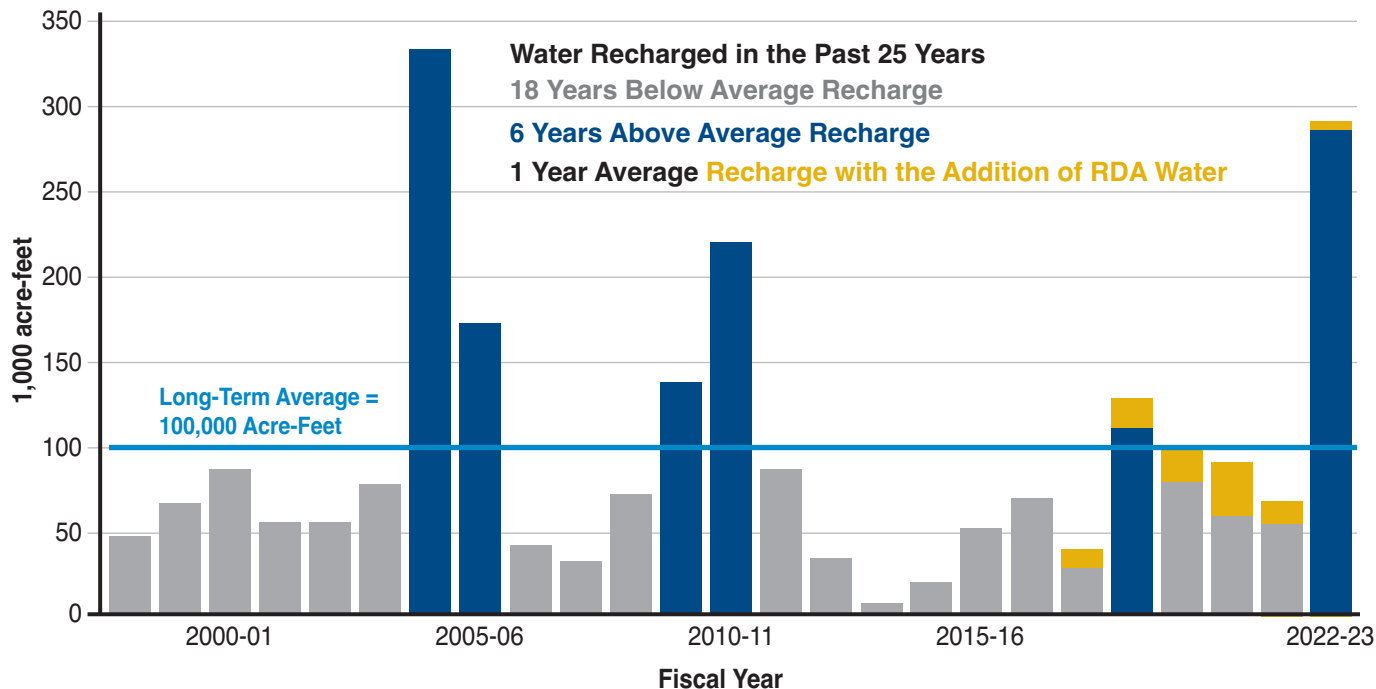

Approximately 286,000 acre-feet of local water and 4,000 acre-feet of RDA water were conserved during 2022-23. In December 2022, Watermaster had enough funds to purchase about 74,000 acre-feet. However, due to a State Water Project Allocation for 2022 of only 5% of Health & Safety Allocation, about 14,700 acre-feet of wet deliveries for Cyclic Storage were delivered. The State Water Project Allocation for 2023 increased to 100% due to above-average rainfall in Northern California. However, due to above-average local runoff, spreading of local water continued through late June 2023. Consequently, only 4,000 acre-feet of RDA water deliveries were delivered by June 30, 2023, and the remaining RDA deliveries are delayed into the next fiscal year.

## LOCAL STORMWATER CAPTURE 286% OF THE LONG-TERM AVERAGE

Total rainfall from 2011–12 through 2017–18 was well below average (an especially severe seven-year drought period within a longer 20-plus years of mostly drought conditions). During 2022–23, rainfall was about 186% of average. Stormwater capture was about 286,000 acre-feet, which was about 286% of average.

Stormwater runoff from rainfall and delivery of RDA water and untreated imported water helped increase the groundwater level by about 55 feet during fiscal year 2022-23.

During FY 2022-23, Los Angeles County Flood Control District (LACFCD) has been performing an emergency cleanout at Cogswell and San Gabriel Reservoirs to remove sediments and debris from the Bobcat Fire. This required emptying both reservoirs. Consequently, LACFCD drained Cogswell and San Gabriel Reservoirs by the end of June 2023. The three reservoirs (Cogswell, San Gabriel, and Morris) are at a combined minimum pool of all three reservoirs.

### Imported RDA Water is Another Source of Groundwater Replenishment That

**Supplements Local Stormwater Capture.** In addition to local stormwater capture, about 4,000 acre-feet of untreated imported water were replenished for general benefit as part of Watermaster’s RDA Program. Consequently, a total of about 290,000 acre-feet of water was replenished, which is roughly 290% of the long-term average.


### Agreement to Pre-Deliver Imported Water Provided Additional Replenishment Water.

Recognizing the importance of delivering untreated imported water when it was available, during fiscal year 2017–18, Watermaster and the Upper San Gabriel Valley Municipal Water District (Upper District) entered into an agreement with MWD to pre-deliver untreated imported water to complement the RDA Program. MWD delivered a total of 58,517.5 acre-feet during 2017-18. Subsequently, during fiscal year 2018–19, Watermaster and Upper District entered into a second agreement with MWD to pre-deliver an additional 110,000 acre-feet of untreated imported water during calendar year 2019. MWD delivered a total of about 97,000 acre-feet in 2019. In addition, Watermaster and the Three Valleys Municipal Water District (Three Valleys District) entered into a similar agreement with MWD to pre-deliver untreated imported water in 2019-20. As of June 30, 2023, there is about 24,000 acre-feet remaining in Cyclic Storage to be paid for by December 2023. During fiscal year 2022-23, Watermaster and Upper District entered into a third agreement with MWD to pre-deliver an additional 110,000 acre-feet of untreated imported water during calendar year 2023. With all the rain and efforts to capture local stormwater, imported deliveries were delayed resulting in much less than planned. Deliveries have started near the end of June 2023 and are expected to carry over into 2024.

### Reverse Cyclic Program Agreement Between MWD and Upper District.

In December 2022, MWD and Upper District entered into a Reverse Cyclic Program Agreement in which Upper District can purchase the water now and MWD will have 5 years to deliver the water when the State Water Project Allocation is higher than 40% or when MWD deems water is available. Under this program, the price is locked at the current rate when purchased. In December 2022, Watermaster purchased 15,000 acre-feet through Upper District, using funds from the RDA and/or Producer Cyclic Storage. During calendar year 2023, the State Water Project Allocation was set at 100% due to the above-average rainfall in Northern California. Consequently, MWD began delivering the 15,000 acre-feet near the end of June 2023.


**Figure 6. CYCLIC STORAGE IS WELL ABOVE AVERAGE FOR THE FIFTH CONSECUTIVE YEAR**

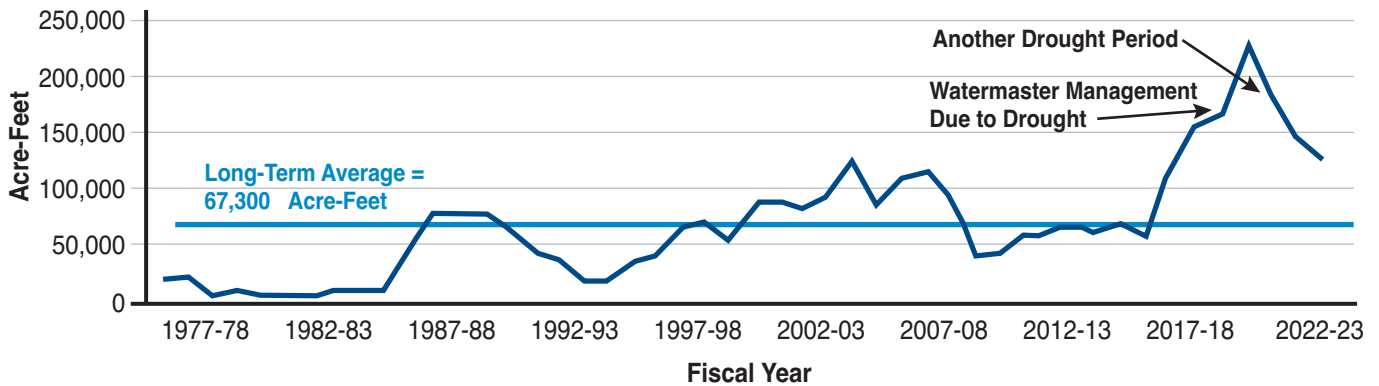

Watermaster has taken proactive action in recent years to encourage the Producers to increase their Cyclic Storage and the Producers have responded; the total amount of Cyclic Storage this year, for example, is about two times the long-term average.


As of June 30, 2023, a total of about 128,600 acre-feet was in Cyclic Storage: about 6,000 acre-feet by Three Valleys Municipal Water District, about 6,000 acre-feet by San Gabriel Valley Municipal Water District, 4,800 acre-feet by Upper San Gabriel Valley Municipal Water District, 54,600 acre-feet by Producers, 12,800 acre-feet by Water Resource Development, 24,100 acre-feet by MWD, and 20,300 acre-feet by Puente Basin Water Agency. Cyclic Storage as of June 30, 2023, was about 15,900 acre-feet below the previous year's total. The long-term average annual storage is about 67,300 acre-feet.

**Figure 7. CYCLIC STORAGE, RDA, AND RAINFALL INCREASED THE KEY WELL LEVEL BY 55 FEET IN 2022-23**

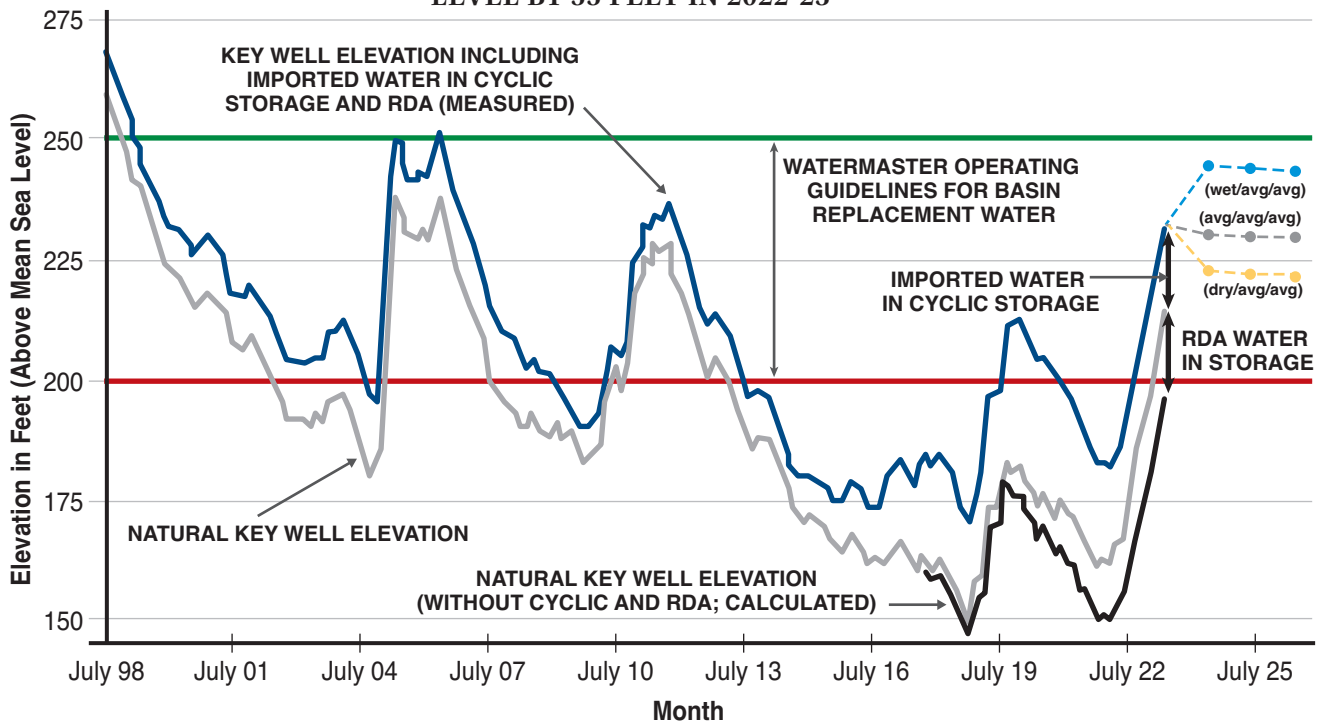

The additional water provided by Cyclic Storage and RDA water helps local agencies meet their future Replacement Water obligations. The natural Key Well elevation without Cyclic Storage and RDA water is calculated to be 195 feet. With the addition of Cyclic Storage, RDA, and rainfall, the Key Well elevation is actually 232 feet—55 feet higher than it would otherwise be. Figure 7 also forecasts Key Well elevations for three scenarios: wet years, average years, and dry years.

**Figure 8. TOTAL WATER DEMAND (WATER USE) REDUCED TO HISTORIC LOW**

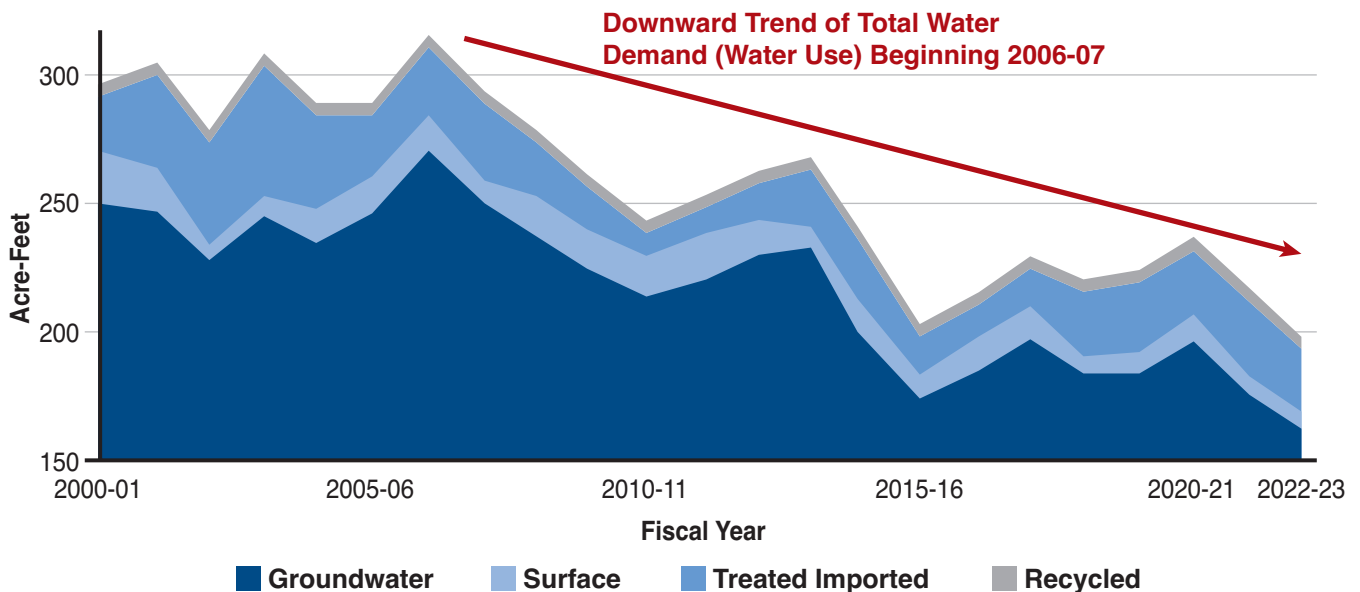

The long-term average water demand is about 259,300 acre-feet. During fiscal year 2022-23, total demand was about 197,600 acre-feet, which is a new historic low. This year's demand was made up of groundwater (161,600 acre-feet), surface water (6,800 acre-feet), imported treated water (17,600 acre-feet), and recycled water (5,000 acre-feet). Total water use within the San Gabriel Valley consists of groundwater production, surface water diversions, treated imported water deliveries, and recycled water for irrigation projects. During the previous fiscal year (2021-22), total water use was about 220,700 acre-feet. During fiscal year 2022-23, total water use was about 191,000 acre-feet.

**CONSERVATION PROGRAMS HAVE LED TO STEADY DECREASES IN WATER DEMAND SINCE 2006**

In recent years, Watermaster has worked with stakeholders to promote retail water conservation, and water use has decreased due to greater consumer awareness of drought conditions and increased water conservation by those consumers. During fiscal year 2022-23, total water use was about 31% lower than the fiscal year 2013-14, which preceded the then governor's declaration mandating water conservation.

**CONTINUED TO MAINTAIN A CONSERVATIVE OPERATING SAFE YIELD**

**A Low OSY Promotes Conservation and Increases Funding to Purchase Additional Imported Supplies.** Main San Gabriel Basin Watermaster annually establishes an OSY based on prevailing hydrologic conditions in the San Gabriel Valley. Because production above the OSY is subject to a Replacement Water Assessment used to purchase untreated imported water to replenish the Basin, setting a low OSY encourages conservation and increases funding to make necessary imported water purchases. Maintaining a low OSY is a central part of the overall plan to manage the Basin in a way that makes the water supply more stable and the costs more predictable in both wet and dry years.

Total Basin production during fiscal year 2022-23 was about 168,400 acre-feet, which was about 10% lower than the previous year. Production above water rights during fiscal year 2022-23 was about 16,900 acre-feet, about 41% lower than the prior year and about 53% lower than the long-term average of about 36,300 acre-feet.

Watermaster aggressively responded to the decreasing trend of the groundwater level at the Key Well during fiscal year 2022-23 by establishing an OSY of 150,000 acre-feet for fiscal year 2023-24 (identical to the OSY for the last nine years and about 39,000 acre-feet below the long-term average of about 189,000 acre-feet).

The addition of Cyclic Storage, RDA, and rainfall have increased the Key Well level by 55 feet.

### KEY WELL BELOW OPERATING RANGE

The Baldwin Park Key Well is used as the benchmark for determining how the groundwater supply for the entire Basin is trending. In accordance with the Judgment, Watermaster manages the Basin with a goal of maintaining the groundwater level at the Key Well between 200 feet and 250 feet above mean sea level. As of November 21, 2018, the groundwater level at the Baldwin Park Key Well had declined to a historic low of about 169 feet. Due to above-average rainfall, the Key Well has risen to 232 feet as of June 30, 2023. Without the extensive management decisions and implementation actions described below, the Key Well would have been only about 195 feet.


### SOME FACTORS THAT INCREASED THE KEY WELL LEVELS

The factors below, and others, collectively resulted in a Key Well elevation of 232.0 feet as of June 30, 2023. This is within the target operating range for Watermaster.

- **Above Average Rainfall** following three years in a row of low rainfall. During fiscal year 2022-23, rainfall was about 186% of average while stormwater runoff was about 286% of average.
- **Coordination to Import Untreated Water.** Watermaster coordinated with Producers and the Responsible Agencies to import about 23,700 acre-feet of untreated water to the Basin, which includes 4,000 acre-feet of RDA water delivered to the Basin to augment stormwater runoff.
- **Continued Low Groundwater Pumping.** Groundwater production was only about 161,600 acre-feet, well below the long-term average of about 222,700 acre-feet.

Without Watermaster's management actions, the Key Well would have fallen from 232 feet on June 30, 2023, to about 195 feet.

Figure 9. KEY WELL ELEVATIONS DURING THE LAST TEN YEARS

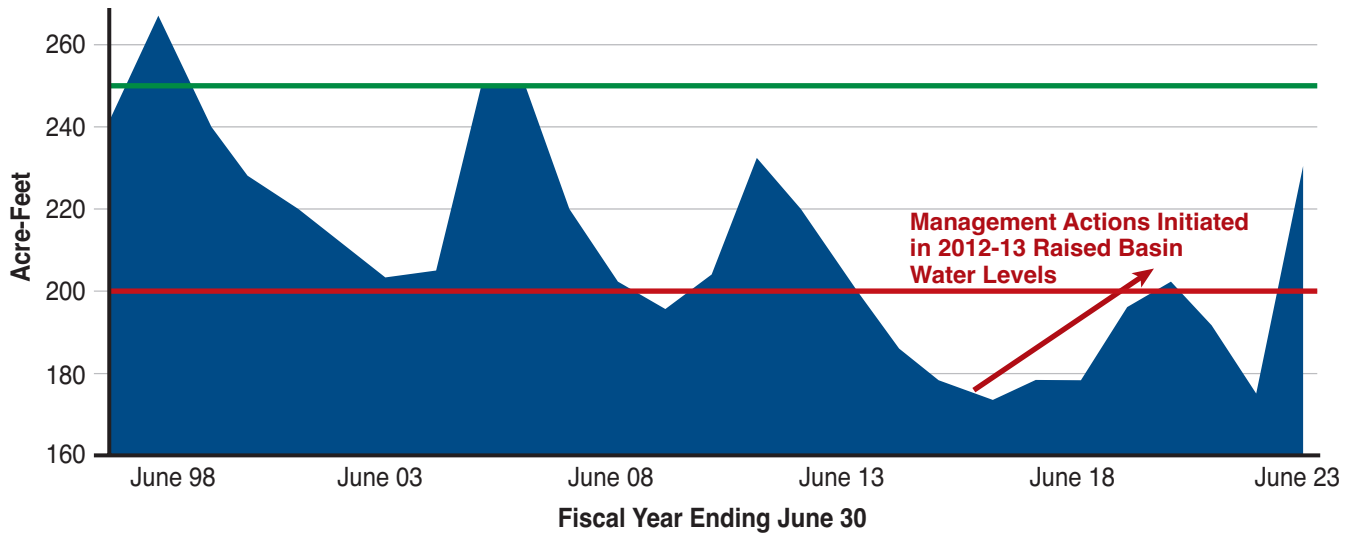


### DECREASE IN WATER STORED IN CANYON RESERVOIRS

Cogswell, San Gabriel, and Morris Reservoirs have a combined maximum storage capacity of about 85,000 acre-feet. At the end of the 2022-23 fiscal year, about 9,700 acre-feet of water was stored in these reservoirs. An emergency cleanout at Cogswell and San Gabriel is occurring to remove sediments and debris due to the Bobcat Fire. Consequently, Cogswell and San Gabriel are being emptied. Water stored at the reservoirs is at the minimum pool. This is about 8,000 acre-feet less than the previous year, representing about 21% of the long-term average of about 37,300 acre-feet of water in storage at the end of the fiscal year, and only about 9% of total reservoir capacity.


In addition, about 268,000 acre-feet of solely local runoff was recharged into the groundwater basin during fiscal year 2022-23.

**Figure 10. WATER STORED IN SAN GABRIEL CANYON RESERVOIRS IS NEAR MINIMUM POOL**

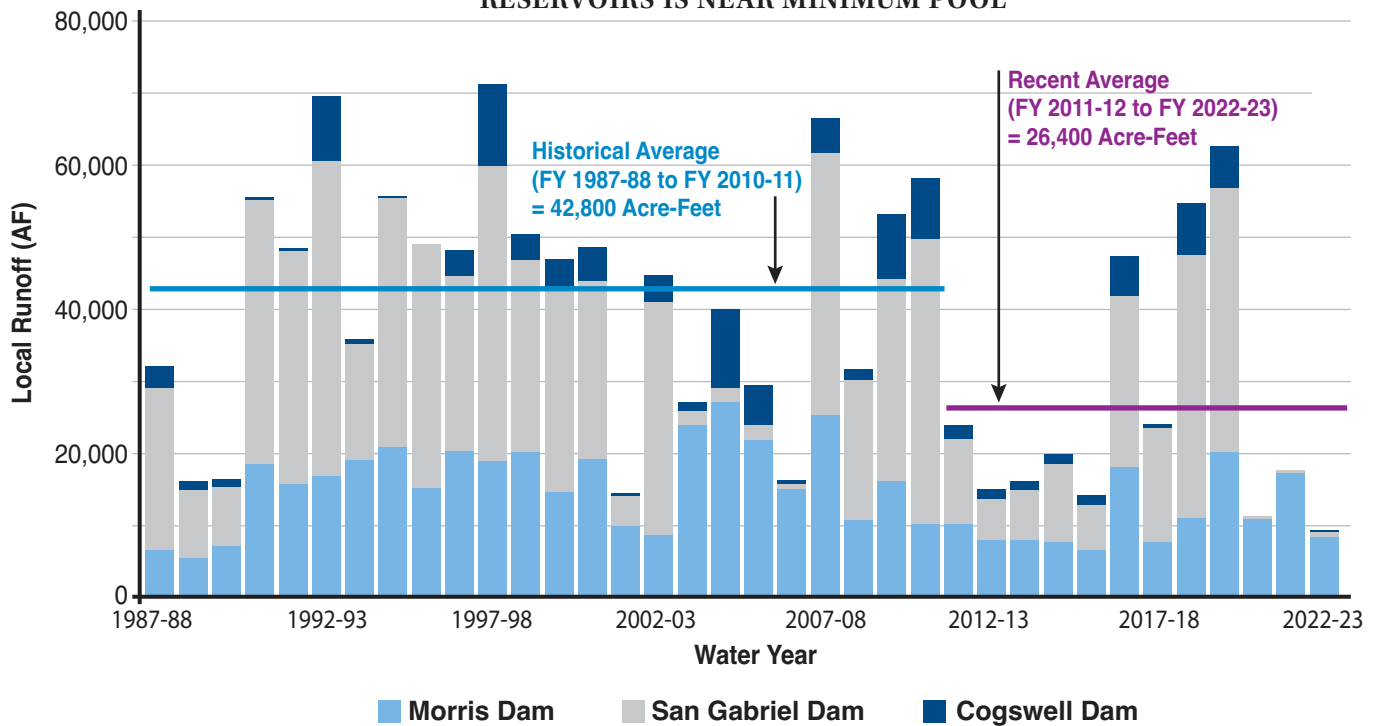

Total water stored in San Gabriel Canyon reservoirs at the end of the fiscal year was 9,660 acre-feet, about 21% of the long-term average.

**Figure 11. GROUNDWATER PRODUCTION CONTINUES LONG DOWNWARD TREND**

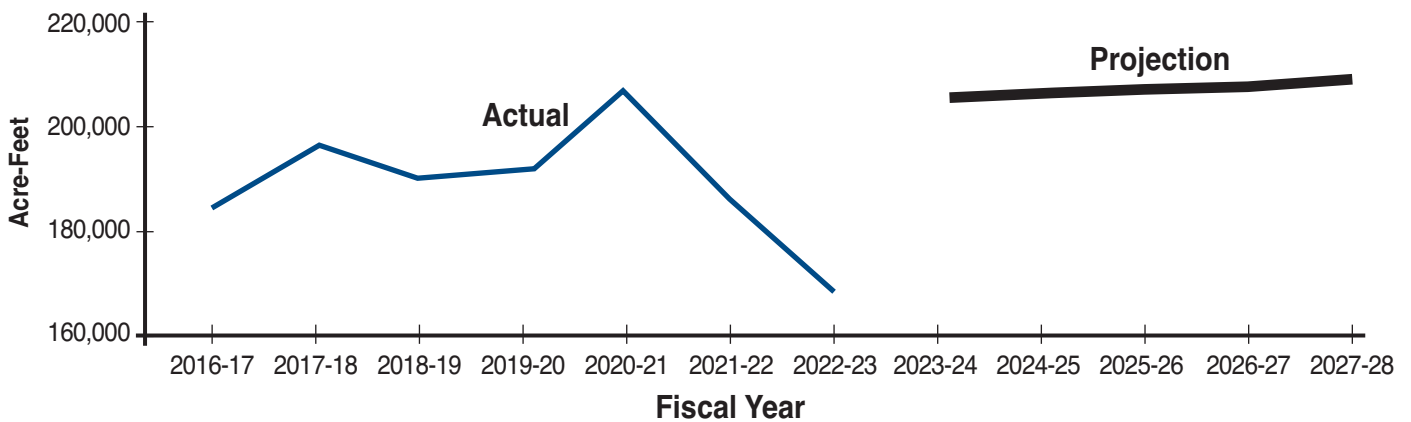

Total groundwater production from the Basin for the 2022–23 fiscal year was about 168,200 acre-feet, which is lower than the previous year’s production of 186,053 acre-feet, and lower than the ten-year average of 193,000 acre-feet. The decrease in groundwater production over time, as illustrated in Figure 11, is primarily the result of increased water conservation at the consumer level. Groundwater production is influenced by a variety of conditions, including population, seasonal precipitation, groundwater contamination, and availability of surface water. Before 2013-14, excluding the impacts of seasonal precipitation, groundwater production had experienced a gradual long-term increase, consistent with increasing population.

Since 2013–14, there has been a significant decrease in groundwater (and overall) demand, which is likely the result of increased water conservation by consumers.



# CURRENT WATER QUALITY CONDITIONS

Since the early 1990s, over 1.89 million acre-feet of contaminated groundwater have been treated for beneficial use—equal to about 8 years of basin water use.

Groundwater delivered to customers continues to be of high quality and always meets state and federal drinking water standards. However, several contaminants in areas of the Basin require careful monitoring and treatment before the water is served for domestic use. These contaminants include a variety of industrial solvents referred to as volatile organic compounds (VOCs) and nitrates (primarily from fertilizers used during the Valley’s agricultural period). Since 1997, additional contaminants have been detected: perchlorate, a solid rocket fuel ingredient; N-nitrosodimethylamine (NDMA), associated with liquid rocket fuel; 1,2,3-trichloropropane (1,2,3-TCP), a degreasing agent; and 1,4-dioxane, a stabilizer for chlorinated solvents.

## → AGGRESSIVE WATER QUALITY RESPONSE BEGAN IN THE 1980s

While only present in limited portions of the Basin, the detected contaminants pose difficult challenges for water Producers. When the chemicals were initially detected in the late 1980s, Watermaster responded vigorously and worked closely with the local water community to sponsor research on treatment methods. Since the detection of perchlorate, NDMA, 1,2,3-TCP, and 1,4-dioxane in the Main Basin, Watermaster has been instrumental in the successful development and operation of facilities to treat those contaminants.

Watermaster and local water entities acted rapidly to design, fund, and construct cleanup projects as rapidly as possible rather than waiting for the USEPA and the firms named as responsible for the contamination to take action.

In response to the detection of these contaminants, Watermaster and local water entities aggressively pursued the construction of treatment facilities to control the spread of contaminants and continue providing high-quality water that meets all state and federal drinking water standards. Initially, a number of VOC treatment facilities were constructed, and water with excessive nitrate concentrations was blended with higher-quality water to reach acceptable levels.

This policy of remediation and reuse preserves a valuable resource, particularly during the current prolonged drought conditions, and reduces the overall cost of groundwater cleanup.

## WATERMASTER IS ACTIVE IN OPERABLE UNITS

**Multiple Roles in Baldwin Park Operable Unit.** Watermaster led negotiations that resulted in the BPOU Project Agreement, including reimbursement for groundwater cleanup costs from certain parties responsible for the contamination. Under the BPOU Agreement, Watermaster is responsible for overall project coordination and administration, groundwater monitoring, and compliance with USEPA reporting requirements. Watermaster also participates in decisions regarding construction, operations, and technology selection. Now that all of the BPOU treatment facilities are operational, Watermaster also monitors the BPOU Project's performance in containing and removing contamination.

**Watermaster's Role in Other Operable Units.** In addition to cleanup activities with the BPOU, Watermaster coordinates and maintains records on groundwater cleanup efforts within the Puente Valley Operable Unit (PVOU), the El Monte Operable Unit (EMOU), the South El Monte Operable Unit (SEMOU), the Area 3 Operable Unit (Area 3 OU), and the Whittier Narrows Operable Unit (WNOU). The location of these Operable Units is shown in Figure 12.

## PRIMARY CONTAMINANTS IN THE GROUNDWATER BASIN

### VOLATILE ORGANIC COMPOUNDS AND NITRATES

VOCs and nitrates are the most prevalent contaminants found in the Basin. Intensive monitoring and research concerning these two types of contaminants have been underway for many years. During fiscal year 2022–23, 32 plants treated roughly 25.4 billion gallons (about 78,000 acre-feet) of VOC-contaminated water as shown in the table at the end of Appendix E.

Although VOC contamination is substantial, as Figure 13 shows, it is centered in just a few areas, leaving a large portion of the Basin unaffected. Figure 14 indicates that nitrates are also concentrated in a few areas, with the highest concentrations in the eastern portion of the Basin, away from the most productive pumping areas. Water containing nitrates above the Maximum Contaminant Level (MCL) is either blended with other low-nitrate sources of water or not used.

### PERCHLORATE

In January 2002, the State Water Resources Control Board Division of Drinking Water (DDW) lowered the Notification Level (NL) for perchlorate from 18 parts per billion to 4 parts per billion, and 22 wells were removed from service due to unacceptable levels of perchlorate. DDW subsequently raised the NL to 6 parts per billion in March 2004 and later established an MCL of 6 parts per billion during October 2007. Watermaster played a key role in developing the first treatment facility to remove perchlorate from drinking water. On February 27, 2015, the Office of Environmental Health Hazard Assessment (OEHHA) published an updated Public Health Goal (PHG) of 1 part per billion for perchlorate in drinking water. Once OEHHA establishes or revises a PHG for a contaminant with an MCL, a determination will be made by DDW as to whether the MCL should be considered for possible revision. In July 2021, the Detection Limit for Purposes of Reporting (DLR) was dropped to 2 parts per billion.

The location of VOC contamination and cleanup methods for VOCs are generally well understood and are being safely treated and managed within the Basin.

The location of perchlorate contamination and cleanup methods for perchlorates are generally well understood and are being safely treated and managed within the Basin.

**This Year's Perchlorate Related Actions.** Ion-exchange technology treatment facilities were operational at five sites in the BPOU and at two facilities in other parts of the Basin during fiscal year 2020–21. Based on its review of the perchlorate MCL, DDW recommended first establishing a lower Detection Limit for Purposes of Reporting (DLR) to gather additional occurrence data, and then revising the MCL if the new data support the development of a new standard. In April 2020, DDW issued a Notice of Proposed Rulemaking to consider lowering the perchlorate DLR to 2 parts per billion. In anticipation of a possible revision to the perchlorate MCL, Watermaster coordinated with Producers to conduct low-level detection sampling for perchlorate, using a laboratory detection level of 0.1 parts per billion, which allowed for the detection of perchlorate below the current DLR of 4 parts per billion. On July 1, 2021, DDW lowered the perchlorate DLR to 2 parts per billion.

The location of NDMA contamination and cleanup methods for NDMA are generally well understood and are being safely treated and managed within the Basin

**N-NITROSODIMETHYLAMINE (NDMA)**

During 1998, eight local wells were found to contain levels of NDMA above the NL (2 parts per trillion at that time). Five of the wells with measurable levels of NDMA had already been taken out of service for other reasons; the other three were put on inactive status once NDMA was detected. DDW subsequently raised the NL to 10 parts per trillion. As with perchlorate, Watermaster played a key role in the construction of NDMA treatment facilities in the BPOU area of the Basin. Five facilities were operational during fiscal year 2022–23. DDW has proposed to hold a workshop on the future establishment of an MCL for NDMA, which is planned for mid-to-late 2023.

The location of 1,2,3-TCP contamination and cleanup methods for 1,2,3-TCP are generally well understood and are being safely treated and managed within the Basin

**1,2,3-TRICHLOROPROPANE (1,2,3-TCP)**

The degreasing agent 1,2,3-TCP has been detected in the groundwater above the MCL of 5 parts per trillion, primarily in the BPOU and the Area 3 OU. The compound was detected in the BPOU during the winter of 2006, and its presence delayed the use of one treatment facility for potable purposes. Following detection, Watermaster, in cooperation with its BPOU Project partners, worked to construct treatment facilities to remove 1,2,3-TCP from the groundwater to make it suitable for potable uses. Those facilities remained operational during fiscal year 2022–23.

**HEXAVALENT CHROMIUM**

DDW is considering a hexavalent chromium MCL of 10 parts per billion, which is the same as the previous invalidated MCL. The proposed DLR was decreased from 1 part per billion to 0.05 parts per billion. The proposed compliance schedule is that systems with 10,000 or more service connections (2 years), 1,000 to 10,000 service connections (3 years), and fewer than 1,000 connections (4 years).

**MANGANESE**

DDW is developing a revised NL and Response Level (RL) for manganese. On January 27, 2023, DDW provided public notice of proposed revisions to the manganese NL and RL to 20 ppb and 200 ppb, respectively. DDW did not provide a timeline for the proposed revisions.

## MICROPLASTICS

The definition for microplastics was adopted by DDW in June 2020. DDW's goals are to test microplastics in public drinking water for 4 years and to notify the public of the results. Phase I of the statewide plan will occur between approximately fall 2023 and fall 2025.

## ACTION ON EMERGING CONTAMINANTS: PFAS (PER- AND POLYFLUOROALKYL SUBSTANCES)

**Background on PFAS.** PFAS are a class of synthetic chemicals that are not found naturally in the environment. PFAS are used extensively in consumer products such as carpets, clothing, paper packaging for food, personal care items (e.g., cosmetics, fragrances, hairspray), and other materials designed to be waterproof and stain resistant.

Perfluorooctanoic acid (PFOA) and perfluorooctyl sulfonate (PFOS) are two key PFAS chemicals. DDW required specific water systems to conduct water quality tests for these compounds during 2019 and established NLs and RLS for PFOA based on a running four-quarter average. Exceedance of the RL requires the water system to take the water source out of service or provide public and customer notice of the exceedance. To assist the Producers, Watermaster conducts and will continue conducting PFAS sampling and monitoring as required by the State Water Resources Control Board as part of the Basinwide Groundwater Quality Monitoring Program (BGWQMP). In addition, Watermaster is working with DDW to characterize the extent of PFAS in the Basin.

On March 5, 2021, DDW issued a drinking water NL and RL of 0.5 parts per billion and 5 parts per billion, respectively, for perfluorobutane sulfonic acid (PFBS). Wells sampled through Watermaster are generally below the Consumer Confidence Report Detection Level (CCRD) of 0.004 parts per billion for PFBS, with some detections at less than 0.01 parts per billion—these detections are well below the NL. On July 22, 2021, OEHHA announced the release of a draft document for public review describing proposed PHGs for PFOA and PFOS in drinking water of 0.007 parts per trillion for PFOA and 1 part per trillion for PFOS. The draft document also presents health-protective drinking water concentrations for noncancer health effects of 3 parts per trillion for PFOA and 2 parts per trillion for PFOS.

On October 31, 2022, DDW established a notification level of 3 parts per trillion and response level of 20 parts per trillion for perfluorohexane sulfonic acid (PFHxS) and issued a new PFAS Monitoring Order that requires the use of a new analytical method (EPA 533).

On March 14, 2023, EPA announced the proposed National Primary Drinking Water Regulation (NPDWR) for six PFAS, including PFOA, PFOS, perfluorononanoic acid (PFNA), hexafluoropropylene oxide dimer acid (HFPO-DA, commonly known as GenX Chemicals), PFHxS, and PFBS. The proposed PFAS NPDWR does not require any actions until it is finalized. EPA anticipates finalizing the regulation by the end of 2023.


## WELLS ASSESSED FOR VULNERABILITY TO CONTAMINATION

One of the primary purposes of the Five-Year Plan is to identify Basin wells that are vulnerable to contamination. A well is considered vulnerable if the concentration of contaminants has ever reached 50% of the NL or MCL allowed by state drinking water regulations. To project which wells may be vulnerable over the next five years, Watermaster reviews water quality tests performed on each well, regional water quality conditions, and contaminant migration patterns. Watermaster also participates in plans to construct treatment facilities, as needed.




### WATER QUALITY PROTECTION PLAN

Watermaster maintains a Water Quality Protection Plan that provides an early warning to Producers of potential increases in contaminant levels. The Water Quality Protection Plan also provides suggested alternative sources of supply and proposes long-term actions to solve contamination problems without contributing to the migration of contaminants in the Basin.


Figure 12. LOCATION OF USEPA OPERABLE UNITS

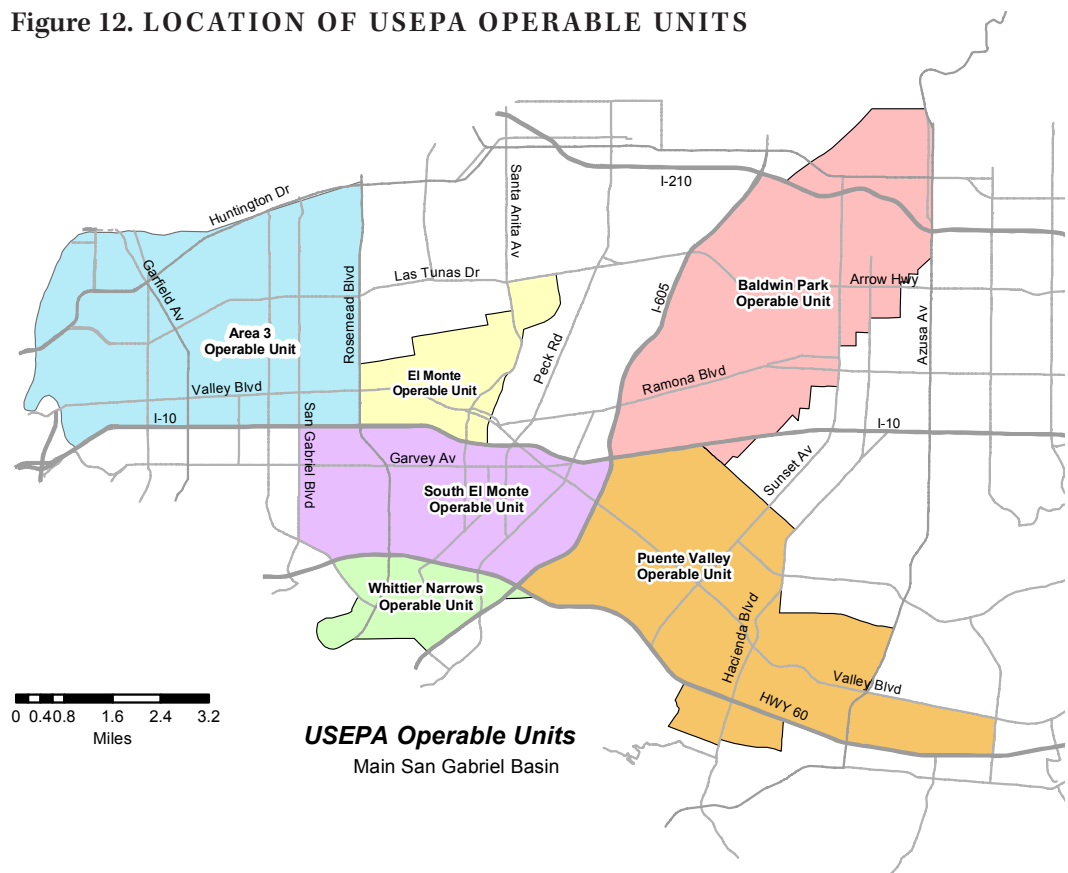



**Figure 13. VOLATILE ORGANIC COMPOUND LEVELS IN GROUNDWATER THROUGHOUT THE BASIN**

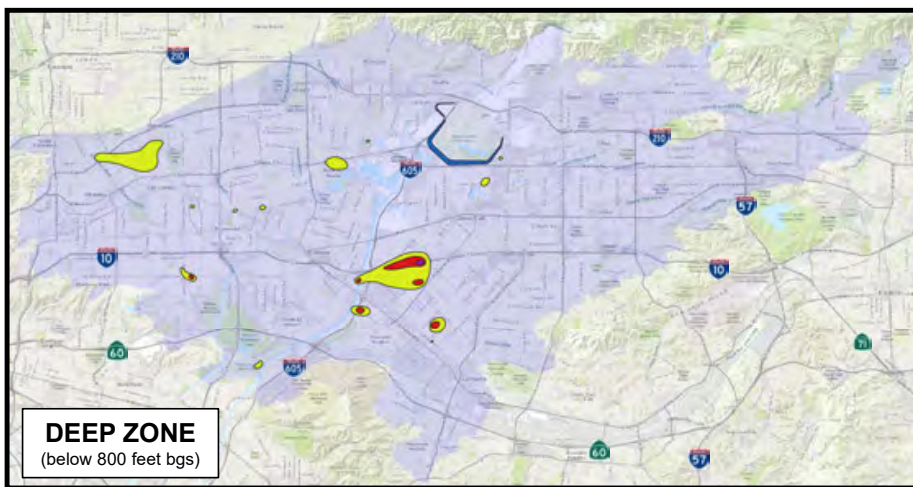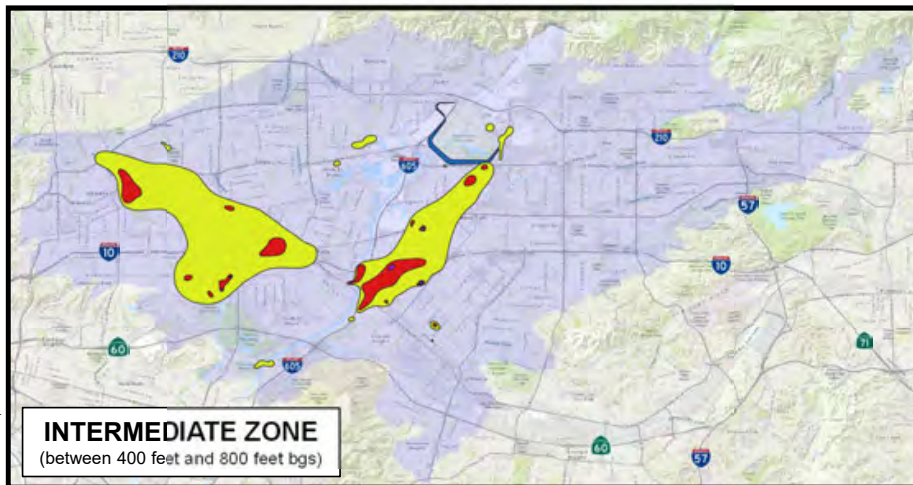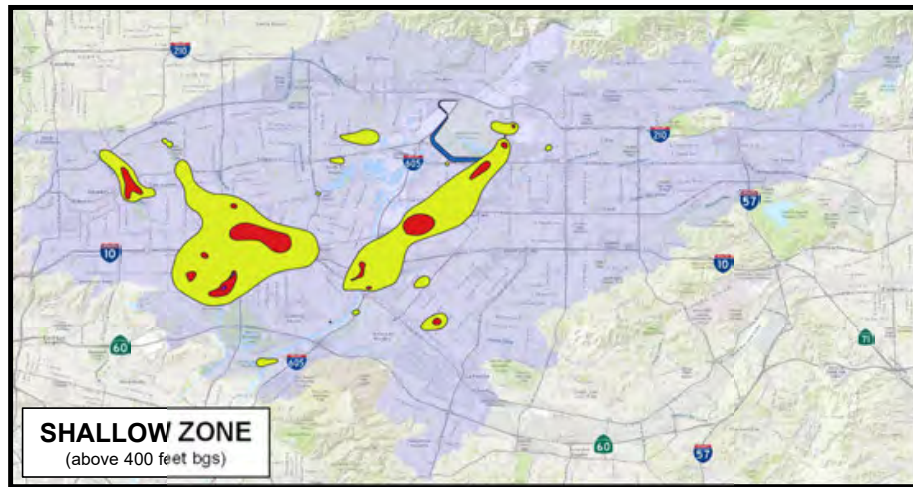


Extensive cleanup programs are underway in the areas affected by VOC contamination. Because the main plumes of contamination are centered in just a few areas, much of the Basin remains unaffected

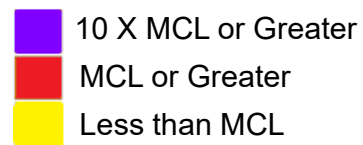

**Figure 14. NITRATE LEVELS IN GROUNDWATER THROUGHOUT THE BASIN**

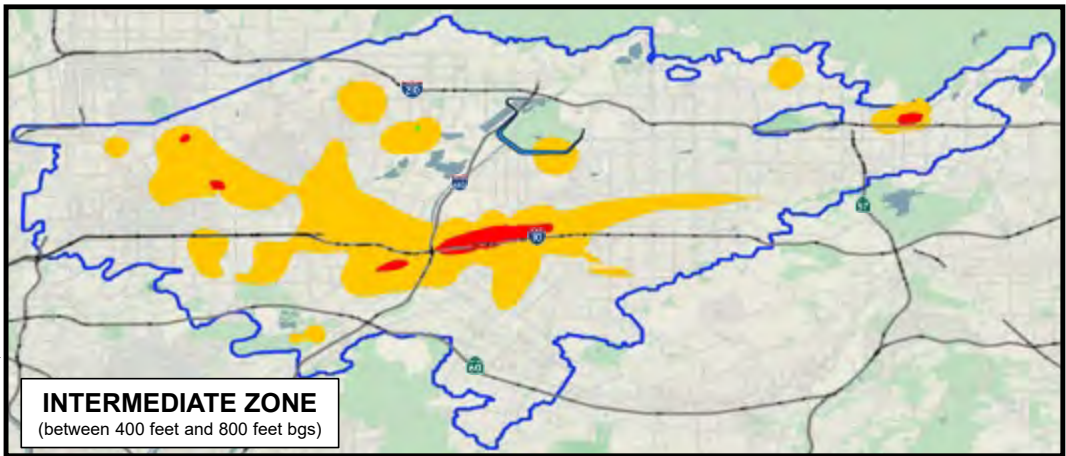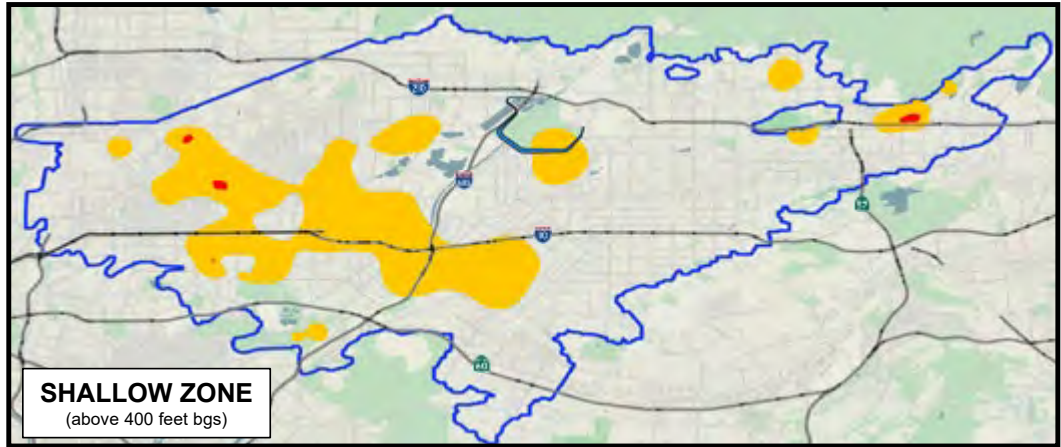

Historically, nitrate (N) contamination is highest in the eastern portion of the Basin, away from the San Gabriel River, the area of most intensive groundwater pumping.

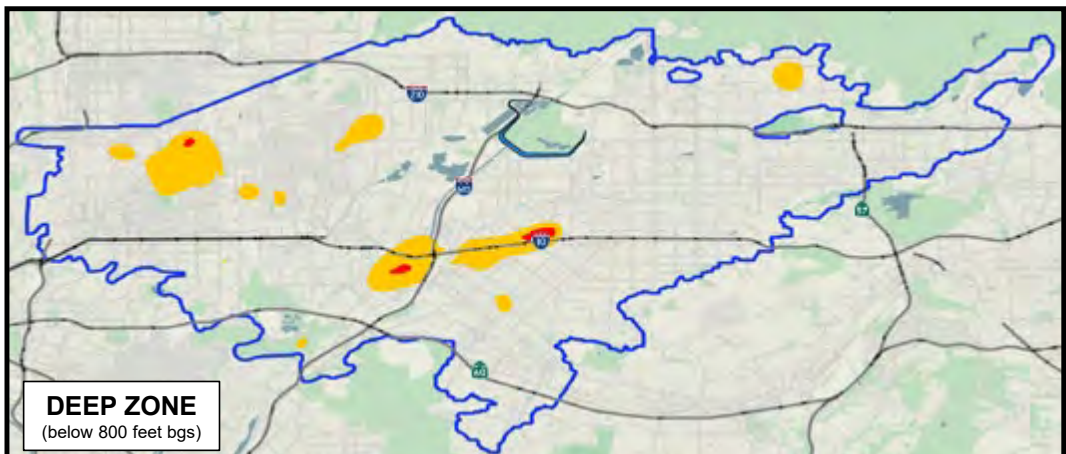

MCL or Greater  
 Less than MCL



# FIVE-YEAR WATER QUALITY AND SUPPLY PLAN

## HISTORICAL BACKGROUND

The Main San Gabriel Basin's designation as a federal Superfund site was prompted by the discovery of widespread VOC contamination. Cleanup plans were developed to contain and remove VOCs from groundwater, and Watermaster, along with various other local water agencies, water Producers, and regulators, have developed the expertise, financing, and treatment technologies to effectively address basinwide cleanup of VOCs.

The discovery of perchlorate and NDMA in 1997, however, created new challenges that complicated the existing VOC cleanup approach. Most importantly, these new contaminants could not be removed using existing treatment facilities, and new treatment methods had to be identified, financed, and implemented.

This report provides a comprehensive water quality cleanup and water supply plan for the Main San Gabriel Basin, including each of the USEPA Operable Units (see Appendix E). Watermaster's plan for each Operable Unit area is consistent with the USEPA plans, and its goal is to implement cleanup as promptly as possible, with or without the cooperation of the Responsible Parties.

Watermaster facilitates groundwater cleanup projects that also meet water supply needs.

## GROUNDWATER MONITORING PROGRAMS

Monitoring includes measuring groundwater levels, groundwater quality, and groundwater flow. Watermaster continuously refines its understanding of the groundwater Basin to better define the Basin's safe yield and to protect and improve local water quality.

### CONTINUE KEY WELL AND SUPPLEMENTAL KEY WELL OPERATION AND DATA PROCESSING

The entire 167-square-mile groundwater Basin is managed as one unit based on the groundwater levels as measured at a single Key Well in Baldwin Park. Water levels have been measured at this well since 1903 and are currently measured every three hours by an automated recorder.

Additional groundwater level recorders have been installed near the Santa Fe Spreading Grounds, adjacent to the San Gabriel River above the I-210 Freeway, in the City of Rosemead, and near Whittier Narrows Dam. These water level records are synchronized with the record in the Key Well.

Collectively, water level data from these wells provide a better understanding of the impacts of recharge operations at the Santa Fe Spreading Grounds on Basin hydrogeology. Water elevation data are collected semiannually at about 170 additional wells throughout the Basin, and water level recorders may be installed in some of those wells over the next five years.



## **CONTINUE BASINWIDE GROUNDWATER ELEVATION MONITORING PROGRAM (BGWEMP)**

The purpose of the BGWEMP is to obtain groundwater level measurements from a large number of wells across the Basin. The information is used to prepare groundwater contour maps showing the direction of groundwater flow. The data are also used in the Basin computer model to simulate future groundwater flow patterns. Through the implementation of the BGWEMP plan over the next five years, Watermaster will take the following steps:

- Gather semiannual measurements of water levels at all 170 primary wells.
- Collect weekly measurements of water levels in nine of the 170 primary wells.
- Obtain water levels in secondary wells from well owners or water Producers, the San Gabriel Valley Protective Association, Regional Board, USEPA, and others.
- Update the database with water level data.
- Prepare semiannual groundwater contour maps of the entire Basin.
- Participate in the California Statewide Groundwater Elevation Monitoring (CASGEM) program.

## **IMPLEMENT PROVISIONS OF SUSTAINABLE GROUNDWATER MANAGEMENT ACT (SGMA)**

SGMA became effective on September 29, 2014. As manager of an adjudicated Basin with ongoing effective management, Watermaster's requirements are generally limited to reporting the following information, to the extent available, for the portion of the Basin subject to the adjudication:

- (A) Groundwater Elevation Data.** Watermaster is the Monitoring Entity for the Main Basin under the terms of the CASGEM program and has submitted semiannual static water elevations to the Department of Water Resources (DWR) since the inception of CASGEM in 2009. Furthermore, Watermaster has collected static water elevations as part of the BGWEMP since the early 1990s. Watermaster uses the data to prepare semiannual groundwater contour maps (which are available on Watermaster's website) and support Watermaster's Main Basin groundwater computer model. Watermaster will continue to collect and review static groundwater elevation data on a regular basis.
- (B) Annual Groundwater Extraction Data.** Watermaster's Annual Report includes quarterly groundwater extraction data for each groundwater well. In addition, Watermaster provides a projection of each Producer's groundwater production over each of the upcoming five years, as shown in Appendix A of this Plan. Copies of Watermaster's current and prior annual reports are available on Watermaster's website.
- (C) Surface Water Used for Groundwater Recharge or In-Lieu Use.** Watermaster has included quarterly local surface water diversions for treated potable use in Appendix G of its Annual Report. Furthermore, Watermaster has presented a summary of local surface water used for groundwater recharge in the introduction to this Plan.

(D) **Total Water Use.** Water use in the Main Basin includes groundwater, treated local surface water, treated imported water, and recycled water. A summary of total water is included in the introduction to this Plan.

(E) **Change in Groundwater Storage.** Groundwater storage in the Main Basin is referenced to the elevation as measured at the Baldwin Park Key Well (Key Well). The Main San Gabriel Basin Judgment (Exhibit H) notes groundwater in storage was about 7.7 million acre-feet when the elevation at the Key Well was 209 feet above mean sea level (MSL). In general, each foot of change in elevation equals about 8,000 acre-feet in storage.

The Key Well elevation was about 185.2 feet on July 1, 2022, and water in storage was about 7.51 million acre-feet. The Key Well elevation on July 1, 2023, was about 232.0 feet above MSL and water in storage was about 7.88 million acre-feet. Thus, the net change in storage was an increase of about 370,000 acre-feet.

(F) **Submittal of Annual Report to the Court.** Watermaster submits its Annual Report to the Court by November 1 of each year. Watermaster will provide the preceding information to DWR over the next five years in compliance with SGMA.

## GROUNDWATER QUALITY MONITORING

### IMPLEMENT SALT AND NUTRIENT MANAGEMENT PLAN

During February 2009, the State Water Resources Control Board adopted the Recycled Water Policy, which adopted goals for water recycling, water conservation, and replenishment of stormwater runoff to enhance water supplies throughout California. One component of the Recycled Water Policy requires all groundwater basins to develop a Salt and Nutrient Management Plan (SNMP). Watermaster took the lead role in developing the SNMP for the Main San Gabriel Basin. The SNMP identifies the water quality of the Main San Gabriel Basin (specifically Total Dissolved Solids [TDS]—nitrate, chloride, and sulfate—which is not addressed by USEPA cleanup activities) and compares that water quality to standards established by the Regional Board. Each of the four water quality parameters comply with the standards set by the Regional Board, resulting in significant flexibility to implement new programs to enhance groundwater replenishment and reliability. A final draft of the SNMP was submitted to the Regional Board in May 2016 to satisfy the submittal requirement and was approved by the Regional Board in December 2016. In coordination with water purveyors, Watermaster is implementing the SNMP through continued collection and review of TDS data. The water quality data are also included in the Watermaster database to facilitate review.

Simulations of the direction of groundwater flow in 2022–23 and projections for 2027–28 show that the estimated increase in groundwater pumping during this period would not significantly change the overall direction of Basin groundwater movement, and therefore would not significantly impact water quality.

### CONTINUE BASINWIDE GROUNDWATER QUALITY MONITORING PROGRAM

Under the BGWQMP, all production wells in the Basin will be sampled at least once a year for VOCs, nitrates, and TDS. In addition, sulfate and chloride are sampled at least once every three years as required by DDW. The frequency of BGWQMP sampling complements the monitoring requirements under state law and supplements information gathered through Regional Water Quality Control Board source investigations and USEPA remedial investigations. The data

collected by BGWQMP are used to identify and evaluate the current locations and magnitude of contaminant levels, along with the effectiveness of the cleanup project.

### **CONTINUE TITLE 22 WATER QUALITY TESTING**

Watermaster continues to perform DDW-mandated Title 22 water quality sampling of groundwater from approximately 200 active wells in the Basin. Watermaster also continues to track regulations and inform local water purveyors about regulatory issues and requirements. Information from centralized water quality testing is added to Watermaster's water quality database, which contains data from many sources.

The centralized testing enables Watermaster to identify water quality trends on a regional scale that might otherwise go unnoticed at a specific well and lowers monitoring costs to Producers.

## **GROUNDWATER FLOW AND CONTAMINANT MIGRATION PROGRAMS**

Groundwater level and quality data are entered into the Basin computer model, which simulates where contamination is projected to flow in the future. The goal is to project contaminant levels by areas in advance of a contamination event and identify remedial steps to be taken. The Basin computer model has been used to identify the area of contamination that may be captured (capture zone) under various groundwater pumping scenarios. The capture zone is also able to show the probable length of time contamination takes to flow toward a well and how long a well must be treated for contaminant removal prior to use as a drinking water supply.

### **GROUNDWATER SIMULATIONS SHOW FUTURE GROUNDWATER ELEVATIONS BASED ON PROJECTED DEMANDS AND REPLENISHMENT**

The general groundwater elevations in fiscal year 2022-23 are shown in Figure 15 (see Appendix F). Fiscal Year 2022-23 was an unexpectedly wet year and is included in Figure 15. In addition, fiscal year 2022-23 had above-average local water spread into the Santa Fe Spreading Grounds, which was included in Figure 15. The model's predictive simulation results at groundwater production wells in fiscal year 2027-28 show changes in groundwater elevations ranging from a slight increase of approximately two feet to a maximum decrease of approximately 42 feet, and a general decrease of approximately 18 feet throughout the Basin. The continuous decrease in groundwater storage is primarily the result of current wet hydrologic conditions and applying the latest dry hydrologic conditions (fiscal years 2012-13 and 2016-17), and modestly increased groundwater production to the five-year projection from fiscal year 2023-24 through fiscal year 2027-28. The five-year predictive simulations indicate the estimated increase in groundwater production—based on projections by Producers and projected future dry hydrology—as of fiscal year 2027-28 will not significantly change the overall direction of Basin groundwater movement as the decline in groundwater elevations occurred throughout the entire groundwater basin. Therefore, the regional groundwater flow in both the east and west portions of the Main Basin maintains its southwesterly and southeasterly flow directions, respectively, toward the Whittier Narrows. Localized pumping depressions in the EPA operable units (OUs) may alter the regional groundwater flow areas; however, those pumping depressions are caused by continuous pumping from

groundwater remedy wells associated with the EPA Superfund sites cleanup project to contain and control groundwater contaminant movement. Contaminated groundwater from those wells is treated at several treatment facilities, and the DDW-permitted water is provided for potable use.

The general groundwater elevations for fiscal year 2022-23 are shown in Figure 15 (see Appendix F). Fiscal Year 2022-23 experienced an unexpected wet climate condition, leading to above-average water replenishment in local spreading grounds, including the Santa Fe Spreading Grounds, and higher percolation from the San Gabriel River. These factors improved the overall groundwater conditions in the Basin. Figure 16 is the projected groundwater conditions for fiscal year 2027-28 under the hypothetical scenario of five consecutive dry years starting in fiscal year 2023-24. A comparison of model-simulated groundwater levels between fiscal year 2022-23 and the projected fiscal year 2027-28 reveals changes in groundwater elevations ranging from about an increase of two feet to a decline of about 42 feet, with an overall decline of around 18 feet across the Basin.

Importantly, Figure 17 (see Appendix F) shows the net decrease in the groundwater elevations throughout the Basin may be about 9 feet lower.

The continuous decline in groundwater elevations over the projected five-year period is attributed to both the dry hydrologic conditions and a modest increase in groundwater extraction. Despite these declining groundwater levels, the projected dry climate condition as well as the expected increase in groundwater production by Producers, the overall flow patterns of groundwater in the Basin remain unchanged. The decline in groundwater elevations is consistent throughout the entire groundwater basin.

As a result, regional groundwater flow patterns in both the eastern and western sections of the Main Basin continue in their southwesterly and southeasterly directions, respectively, toward the Whittier Narrows. There may be localized pumping depressions observed within the EPA operable units (OUs), which could locally alter regional groundwater flow. However, these depressions are a result of ongoing strategic remediation efforts within the EPA Superfund site cleanup project aimed at containing and controlling the movement of groundwater contaminants. The contaminated groundwater extracted from these wells is treated at various treatment facilities under permits from the DDW for eventual potable use.

## **SIMULATE IMPACTS OF GROUNDWATER PUMPING ON CONTAMINANT MIGRATION**

Simulations similar to those described above indicate that pumping from USEPA-mandated cleanup projects as managed by Watermaster helps control and contain contaminant migration. Watermaster entered groundwater quality data collected during 2022-23 and projected quality data for 2027-28 into the groundwater model for the contamination migration studies. The computer model is used to simulate how the flow of water would affect the migration of contamination. The simulation showed that changes in groundwater flow did not have major impacts on the migration of contaminants (refer to Figures 15 and 16 in Appendix F).

The USEPA is responsible for overseeing and managing several Superfund sites located within the Main Basin, primarily focusing on remediating groundwater. These mandated cleanup projects are also jointly administered by Watermaster to control and contain the movement of contaminants. Watermaster routinely gathers, organizes, and ensures the quality and accuracy of water quality data to delineate present contaminant plumes (fiscal year 2022-23) and future contaminant plumes over a five-year projected period. Utilizing the Main Basin Model to assess the potential impacts arising from the USEPA's designated remedial wells, it is generally evident that the remediation operations are effective in controlling the movement of contaminants. Please refer to Figures 15 and 16 in Appendix F for further details.

## **GROUNDWATER CLEANUP PROJECTS**

Watermaster coordinates and provides technical assistance on many cleanup projects in the Basin, although the cleanup facilities are owned and operated by local water utilities. Watermaster's involvement includes coordinating proposed USEPA cleanup programs to ensure, to the extent feasible, that treated water is put to beneficial use within the Basin and that projects are consistent with the Judgment.

### **REVIEW OF SECTION 28 APPLICATIONS**

Watermaster reviews every proposal to construct, destroy, or modify a well or build a treatment plant pursuant to Section 28 of its Rules and Regulations. Watermaster's review ensures that any new or increased extractions from the Basin or any changes in production patterns are consistent with contamination cleanup efforts and will not adversely affect Basin water quality. In conjunction with the evaluation of an application to construct a new well or a treatment facility, Watermaster uses a computer model to predict the potential future impacts of each project on contaminant migration and Basin cleanup.

## **BASIN CLEANUP PROJECTS/USEPA OPERABLE UNIT PLANS**

The USEPA established Operable Units for the various areas within the Basin that have been contaminated and require groundwater cleanup. The Operable Units are Area 3 (Alhambra area), Baldwin Park, El Monte, Puente Valley, South El Monte, and Whittier Narrows (see Figure 12). USEPA has established a methodical cleanup process that includes a review of the extent of contamination (Remedial Investigation), the development of cleanup alternatives (Feasibility Study), and the selection of the most appropriate cleanup plan (Proposed Plan). Following these activities, the USEPA issues a report identifying the agreed-on cleanup plan (Record of Decision). Subsequently, the project facilities are designed and constructed. With USEPA plans generally in place, Watermaster continues to work with affected Producers, Responsible Parties, and others to implement solutions that provide effective cleanup, conform to the USEPA plans, and use the treated water to meet local water supply needs.

## **DETAILS ON EACH OPERABLE UNIT**

This Five-Year Plan describes each of the Operable Units along with the USEPA proposed cleanup plan. (A detailed description of the history and treatment facilities associated with each of the Operable Units is included in Appendix E.) In addition, Appendix A identifies current and projected groundwater production over the next five years, to address the contamination and implement the cleanup plans. In areas where the groundwater supply has been affected by contamination, Watermaster works with affected Producers and other local water agencies to implement cleanup as quickly as possible, with or without the cooperation of the Responsible Parties. Watermaster and affected Producers continue to seek cost recovery from the Responsible Parties for any cleanup costs they incur.

## **OTHER WATER QUALITY PLANNING AND ACTIONS**

### **WATER QUALITY PROTECTION PLAN**

Watermaster's Water Quality Protection Plan provides early warning to Producers before their wells are found to have contaminant levels that exceed drinking water quality standards. The Plan also contains pre-analyzed suggestions to the Producers for responding to the presence of contaminants.

### **LANDFILL INSPECTIONS**

Watermaster routinely conducts on-site inspections of area landfills to ensure they are operated in a way that does not allow contaminants to seep into the groundwater. Watermaster reports any violations of Waste Discharge Requirements to the Regional Board for enforcement.

### **IDENTIFY AND REDUCE POTENTIAL SOURCES OF CONTAMINATION AND COOPERATE WITH THE REGIONAL WATER QUALITY CONTROL BOARD**

Since 1993, Watermaster has obtained information from the Regional Board about sources of VOC contamination in the Basin as part of the Regional Board's investigations of potentially contaminated sites. The information includes a description of all potential sources of contamination investigated by the Regional Board, including:

- Maps showing the location of all investigation sites.
- Available cause-and-effect relationships between pollution sources and contaminated wells.
- Plans and tentative schedules to abate the source of pollution and clean up the soil and water.

Watermaster has reviewed a large amount of information gathered in Regional Board files and entered it into a database. This information is used in Watermaster's Section 28 process to help evaluate changes in pumping practices in relation to known contamination sources.

## **WATER SUPPLY AND DROUGHT MANAGEMENT PLANNING AND ACTIONS**

The Main San Gabriel Groundwater Basin is very complex, covering 167 square miles, and can hold about 2.8 trillion gallons of water. Water enters the Basin from countless natural and man-made locations and is extracted by over 200 wells operated by dozens of independent Producers. Watermaster conducts special studies to identify projected water demands and increase understanding of the Basin so it can be managed to preserve and improve water supply and quality.

Watermaster routinely reviews available data and is prepared to construct new monitoring wells to obtain supplemental water level and water quality data to better manage the Basin. As a result of these activities, and the cooperative activities with the Regional Board (noted above), ongoing VOC or perchlorate contamination has been eliminated, and the focus is now on cleanup activities.

Watermaster coordinates and maintains records on production, stormwater, untreated imported water deliveries for groundwater replenishment, and impacts on the groundwater levels throughout the Basin, particularly at the Baldwin Park Key Well. In that capacity, Watermaster has coordinated deliveries of untreated imported water into Cyclic Storage accounts and implemented the RDA assessment, which is used to purchase untreated imported water to augment stormwater replenishment. Watermaster has developed a 3D computer model, which is used to identify the groundwater levels throughout the Basin, including wells in which decreasing groundwater levels may impact water supply reliability. Throughout the upcoming five years, Watermaster will maintain records on existing and proposed water system interconnections, water levels in production wells, and Producer plans to develop new sources of supply in anticipation of prolonged dry periods.

### **SERVICES AND ASSISTANCE TO PRODUCERS TO MEET WATER NEEDS**

Watermaster has been advised that Producers propose constructing four new wells and two treatment plants during the next five years. Watermaster will continue providing the following services to assist Producers in meeting water demand:

- Investigate all new or increased water extractions.
- Provide computer modeling and technical support on treatment issues concerning the impact of extractions on contaminant migration.
- Prioritize areas requiring further investigation and coordinate with Producers on water supply modifications.
- Direct changes in pumping or treatment as necessary.

## **INTRODUCTION AND BACKGROUND ON WATER SUPPLY AND DROUGHT MANAGEMENT PLANNING AND ACTIONS**

Historical Basin management practices encouraged Producers to pump local groundwater instead of relying on treated imported water to address water demands in excess of Producers' water rights. Under normal conditions, Watermaster quantifies groundwater production in excess of Producers' water rights and arranges to have an equal amount of untreated imported water delivered to replenish the over-production from the Basin at a Full-Service untreated water rate.

## **WIDE-RANGING LONG-TERM WATER SUPPLY MANAGEMENT TOOLS**

In response to the long-term drought conditions, Watermaster has implemented wide-ranging new tools to more intensely manage Basin groundwater supplies, refill the Basin, and ensure long-term water supply reliability. These new drought management tools are described in the following pages.

**Continued Implementation of the RDA Program.** Watermaster developed the Supplemental Water Stormwater Augmentation Program (RDA) to help manage Basin water supplies under potential worst-case hydrologic conditions, which are assumed to be three consecutive five-year droughts with the same hydrologic conditions as the five years of drought experienced from 2011–12 through 2015–16. RDA generates revenue to purchase untreated imported replenishment water for stormwater augmentation so the Key Well elevation can be maintained above 180 feet by the end of the tenth year of a worst-case, 15-year drought cycle. Watermaster uses the RDA funds to purchase untreated imported water to replenish the Basin for the general benefit of all Producers within the Basin. Unlike the original RDA, which is a Watermaster pre-purchase of Replacement Water, the Supplemental Water RDA will supplement local stormwater replenishment and allow no right of recovery using a water right by any Basin Producer.

**RDA Assessment Steadily Increased to \$175 per Acre-Foot.** The RDA program began with an initial assessment of \$40 per acre-foot on fiscal year 2016–17 production and gradually increased to \$175 per acre-foot on fiscal year 2020–21 production. During fiscal year 2022-23, the RDA was \$175 per acre-foot on 2022-23 production, providing sufficient revenue to purchase about 31,000 acre-feet of water (representing about a five-foot benefit to Basin groundwater levels) was generated.

**Maintain a Low Operating Safe Yield (OSY).** This year, Watermaster unanimously approved maintaining the OSY at 150,000 acre-feet for the ninth year in a row and setting a record low of 130,000 for the following four years. A low OSY promotes conservation and raises funds to purchase water. By maintaining this low OSY, the Board agreed to stay the course to ensure that the Main Basin and its operations are sustainable over the long term.

**Three-Year Purchased Water Plan.** Watermaster annually prepares the Three-Year Purchased Water Plan, in which it quantifies the amount of untreated imported water that will be purchased from each of the three municipal water districts within the San Gabriel Valley and delivered to replenish groundwater supplies within the Basin. Untreated imported water deliveries will be made to:



- 1) augment the lack of local stormwater replenishment through the Water Resource Development program,
- 2) increase the amount of water held in Producer Cyclic Storage accounts,
- 3) satisfy the prior year's Replacement Water obligation, and
- 4) support other programs negotiated with Watermaster.

Recognizing the quantity of untreated imported water anticipated to be delivered in the ensuing three years aids Watermaster's management of groundwater levels and supplies.

**Proactive Measures to Increase Cyclic Storage.** Both Watermaster and Producers recognize that prolonged drought conditions will adversely impact untreated imported water availability, which is essential to managing the Basin. Consequently, Watermaster has taken proactive measures to encourage Producers to increase the collective amount of water in their Cyclic Storage accounts from about 15,000 acre-feet as of the end of June 2010 to 55,600 acre-feet as of June 2023.

**Extensive Outreach to Promote Retail Water Conservation And Understand Water Issues.** For many years, Watermaster has worked with stakeholders across the Basin to encourage consumer-based conservation efforts to reduce groundwater production. After Watermaster staff, Board, and an Ad Hoc Committee carefully reviewed communication and education needs, Watermaster selected a consultant and initiated an expanded Basin Outreach Program focusing on basinwide and San Gabriel River Watershed supply sources. The goal is to help the public understand critical regional water issues, including how the watershed and Basin work, what makes the Basin unique, and why a wet year in Northern California does not necessarily translate into robust water supplies in the Basin.

**Working Toward Massive Increase in Recycled Water Use.** Watermaster is working with Los Angeles County Sanitation Districts, MWD, and others to pursue a large supply of 60,000 to 80,000 acre-feet per year of treated recycled water for Basin replenishment.

**Increase Replenishment.** Watermaster is working with a range of stakeholders to implement tighter coordination and management to allow replenishment of imported water even during rainy periods. It is also finding new opportunities and incentives to deliver untreated imported water for Basin replenishment.

**Implement More Flexible Financial Tools.** Watermaster has instituted new, more flexible financial tools to increase water imports, such as pre-purchase of water through Cyclic Storage, Reverse Cyclic Storage, and Replacement Water Accounting, and is evaluating others, including mid-year assessments.

**Enabling an Additional Source of Imported Water.** Colorado River water could provide a valuable source of replenishment water, so Watermaster is actively developing plans to allow deliveries, when available.

**Encouraging Use of Sustainable Supplies.** The In-Lieu Program allows Producers to deliver treated renewable water in lieu of pumped water, reducing the demand for groundwater.

**Developing And Implementing Storage and Export Programs.** Watermaster has developed criteria for new water storage and export programs.

**Using Technology to Understand the Basin.** Watermaster's groundwater model provides sophisticated analysis to inform decision-making.

**Improving Stormwater Capture.** Watermaster is participating in a multi-year study led by Las Virgenes Municipal Water District that is investigating the potential for collecting urban runoff and stormwater and recycling it into a usable new water supply by using existing capacity in wastewater treatment plants.

**Protecting Water Rights.** Watermaster worked to protect water rights associated with legislation and expansion of the National Recreation Area along the San Gabriel River.

## **OTHER ACTIONS IN 2022-23 TO INCREASE WATER SUPPLIES TO THE BASIN**

**Quagga Mussel Control Plan.** In order to allow delivery of Colorado River Water when State Project water is unavailable and groundwater conditions reach critically low levels, threatening the loss of drinking water supplies, Watermaster collaborated with MWD, Main San Gabriel Basin Watermaster, USGVMWD, and Los Angeles County Public Works and developed a Provisional Quagga Mussel Control Plan. The Plan documents the procedures, operating criteria, monitoring, and testing methods to prevent, to the extent practicable, the establishment of any quagga mussel population in the reach of the San Gabriel River following delivery of Colorado River Water. The final draft plan has been reviewed and commented on by the required regulatory agencies. The Plan will be reviewed and updated annually.

**Entered Into a Third Agreement to Pre-Deliver Imported Water to Provide Additional Replenishment Water.** Due to above-average rainfall in Northern California, the State Water Project Allocation for 2023 was at 100%. To take advantage of the available untreated imported water, Watermaster and Upper District entered into a third agreement with MWD to pre-deliver an additional 110,000 acre-feet of replenishment water. Deliveries began in June 2023 and are expected to be completed by December 30, 2023 and may carryover into 2024 in order to deliver the full amount.

## PROJECTED GROUNDWATER DEMAND PRODUCER ESTIMATES

The amount of water production decreased compared to the prior year and remained significantly lower than the long-term average due in part to consumer water conservation.

Section 28 directs each Producer to submit a report to Watermaster detailing its projected water demands and water production requirements over the following five years. Projections were received from 20 Producers (all municipal water suppliers), accounting for about 80% of the groundwater production from the Basin.

For those Producers who did not submit projections, Watermaster provided an estimate based on the assumption that each Producer had an aggregate projected growth rate that was the same as those Producers who did submit projections.

→ Projected groundwater production is shown in Appendix A. Figure 11 shows the total projected and historical groundwater production from the Basin since 2016–17.

### UPGRADE OF GROUNDWATER MODEL TO 3D

The long-used and highly effective 2D groundwater model was updated during a multiyear process to 3D. It will provide advanced capabilities for identifying existing conditions, designing programs, and testing outcomes. The groundwater model will be useful for virtually every aspect of Basin management, from recycled water development to water quality evaluations to well performance analysis.

### AQUIFER PERFORMANCE TESTS

Watermaster has developed a groundwater flow model for the entire Basin that assists in evaluating the potential impacts of changes in groundwater production. Although Watermaster completed its three-year Aquifer Performance Test investigation, additional tests will be conducted as required for Section 28 applications or for other needs. A tabulation of potential Aquifer Performance Test investigation sites is included in Appendix D. The sites identified include a production well and at least one monitoring well. The tests provide information on the characteristics of the aquifer such as transmissivity, hydraulic conductivity, and coefficient of storage. The information gathered on aquifer characteristics will support cleanup activities, including groundwater model development and calibration (see Appendix D).

# DIRECTORY TO APPENDICES

The Following Appendices Are Found in This Section:

- A. Projected Groundwater Demands from 2023–24 to 2027–28
- B. Simulated Changes in Groundwater Elevations at Wells or Wellfields in Main San Gabriel Basin
- C. Highlights of Volatile Organic Compounds and Nitrate Concentrations, and Wells Vulnerable to Contamination
- D. Potential Sites for Aquifer Performance Tests
- E. Summary of Treatment Facility Activity in the Main San Gabriel Basin
- F. Simulated Basin Groundwater Contours 2022–23 and 2027–28 (Figures 15 and 16),

Simulated Groundwater Elevation Changes Between FY 2022–23 and FY 2027–28 (Figure 17),

VOC Plume Map in BPOU and Perchlorate Plume Map in BPOU (Figures 18 and 19)

---

# **APPENDIX A.**

## **PROJECTED GROUNDWATER DEMANDS FROM 2023-24 TO 2027-28**

**A**



**APPENDIX A**  
**PROJECTED GROUNDWATER DEMANDS FROM 2023-24 TO 2027-28**

RECORDATION NUMBER	WELL NAME	WELL CAPACITY		2022-23 PRODUCTION	PROJECTED GROUNDWATER DEMANDS				
		ACRE-FEET	GPM		2023-24	2024-25	2025-26	2026-27	2027-28
<b>9447 SAN GABRIEL CANYON LLC (VIETNAMESE AMERICAN BUDDHIST TEMPLE) (1)</b>									
8000191	VIET TEM	16	10	9.94	10.10	10.30	10.50	10.70	10.90
SUBTOTAL		16	10	9.94	10.10	10.30	10.50	10.70	10.90
<b>ADAMS RANCH MUTUAL WATER COMPANY (CALIFORNIA AMERICAN WATER COMPANY)</b>									
1902106	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902689	2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000182	3	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
<b>ALHAMBRA, CITY OF (2)</b>									
1900010	MOELR (8)	3,387	2,100	1,500.13	1,740.00	940.00	940.00	940.00	940.00
1900011	9	798	495	14.44	16.00	16.00	16.00	16.00	16.00
1900012	10	NA	NA	0.00	0.00	0.00	4.00	4.00	8.00
1900013	12	807	500	0.00	8.00	8.00	8.00	8.00	8.00
1900014	13	1,048	650	181.46	150.00	280.00	280.00	280.00	280.00
1900015	14	1,532	950	0.00	0.00	1,000.00	1,000.00	1,000.00	1,000.00
1900016	15	1,774	1,100	1,646.78	1,440.00	1,400.00	1,400.00	1,400.00	1,400.00
1900017	2 LON	1,589	985	943.02	1,320.00	1,260.00	1,260.00	1,260.00	1,260.00
1900018	GARF	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902789	1 LON	1,613	1,000	1,349.71	1,320.00	1,260.00	1,260.00	1,260.00	1,260.00
1903014	11	1,032	640	13.94	16.00	16.00	16.00	16.00	16.00
1903097	7	968	600	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		14,549	9,020	5,649.48	6,010.00	6,180.00	6,184.00	6,184.00	6,188.00
<b>AMARILLO MUTUAL WATER COMPANY (SAN GABRIEL VALLEY WATER COMPANY) (2)</b>									
1900791	SOUTH (1)	644	399	6.43	470.06	489.04	508.80	524.41	529.93
1900792	NORTH (2)	424	263	0.00	0.77	0.77	0.77	0.77	0.77
SUBTOTAL:		1,068	662	6.43	470.83	489.81	509.57	525.18	530.70
<b>ANDERSON, RAY L. AND HELEN</b>									
8000085	NA	18	11	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		18	11	0.00	0.00	0.00	0.00	0.00	0.00
<b>ARCADIA, CITY OF (1)</b>									
1901013	1 LON	1,613	1,000	178.18	620.00	620.00	620.00	620.00	620.00
1901014	2 LON	1,613	1,000	0.00	0.00	0.00	0.00	0.00	0.00
1901015	1 BAL	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902077	1 CAM	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902078	2 CAM	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902084	2 LGY	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902358	1 STJ	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902791	2 BAL	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902854	1 PEC	5,968	3,700	2,200.48	3,920.00	3,920.00	3,920.00	3,920.00	3,920.00
8000127	1 LO	4,516	2,800	4,333.27	1,820.00	1,820.00	1,820.00	1,820.00	1,820.00
8000177	2 STJ	1,613	1,000	0.00	0.00	0.00	0.00	0.00	0.00
8000213	3 CAM	4,355	2,700	2,126.10	3,160.00	3,160.00	3,160.00	3,160.00	3,160.00
8000214	3 LGY	2,903	1,800	407.40	1,520.00	1,520.00	1,520.00	1,520.00	1,520.00
SUBTOTAL:		22,582	14,000	9,245.43	11,040.00	11,040.00	11,040.00	11,040.00	11,040.00
<b>ARCADIA RECLAMATION (1)</b>									
8000229	NA	NA	NA	29.76	48.00	48.00	48.00	48.00	48.00
SUBTOTAL:		NA	NA	29.76	48.00	48.00	48.00	48.00	48.00
<b>ATTALLA, MARY L.</b>									
8000119	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		NA	NA	0.00	0.00	0.00	0.00	0.00	0.00

RECORDATION NUMBER	WELL NAME	WELL CAPACITY		2022-23 PRODUCTION	PROJECTED GROUNDWATER DEMANDS				
		ACRE-FEET	GPM		2023-24	2024-25	2025-26	2026-27	2027-28

**AZUSA, CITY OF (AZUSA AGRICULTURAL WATER COMPANY, AZUSA VALLEY WATER COMPANY) (1)**

1902533	5 (1)	1,613	1,000	1,129.66	1,310.00	1,310.00	1,310.00	1,310.00	1,310.00
1902535	6 (3)	4,839	3,000	645.78	470.00	470.00	470.00	470.00	470.00
1902536	GENESIS 1 (4)	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902537	GENESIS 2 (5)	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902538	GENESIS 3 (6)	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000072	1 (7)	4,839	3,000	1,218.49	1,060.00	1,060.00	1,060.00	1,060.00	1,060.00
8000086	3 (8)	4,678	2,900	2,254.59	2,370.00	2,370.00	2,370.00	2,370.00	2,370.00
1902457	2 (1 NORTH)	3,226	2,000	1,632.24	1,290.00	1,290.00	1,290.00	1,290.00	1,290.00
1902458	4 (2 SOUTH)	4,516	2,800	2,389.22	1,410.00	1,410.00	1,410.00	1,410.00	1,410.00
1902113	AVWC 1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902114	AVCW 2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902115	8 (AVWC 4)	3,065	1,900	571.30	480.00	480.00	480.00	480.00	480.00
1902116	7 (AVWC 5)	1,613	1,000	160.87	230.00	230.00	230.00	230.00	230.00
1902117	9 (AVWC 6)	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902425	AVWC 7	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000103	10 (AVWC 8)	4,194	2,600	227.69	160.00	160.00	160.00	160.00	160.00
8000178	11	2,581	1,600	965.10	1,590.00	1,590.00	1,590.00	1,590.00	1,590.00
8000179	12	2,420	1,500	737.42	1,420.00	1,420.00	1,420.00	1,420.00	1,420.00
1903119	VULCAN	NA	NA	38.06	40.00	40.00	40.00	40.00	40.00
SUBTOTAL:		37,583	23,300	11,970.42	11,830.00	11,830.00	11,830.00	11,830.00	11,830.00

**AZUSA ASSOCIATES LLC (COVELL, ET AL)**

1900390	DALTON	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		NA	NA	0.00	0.00	0.00	0.00	0.00	0.00

**B & B RED-I-MIX CONCRETE INC.**

1902589	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		NA	NA	0.00	0.00	0.00	0.00	0.00	0.00

**BANKS, GALE & VICKI (1)**

1900415	NA	560	347	22.34	30.00	30.00	30.00	30.00	30.00
SUBTOTAL		560	347	22.34	30.00	30.00	30.00	30.00	30.00

**BASELINE WATER COMPANY**

1901200	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901201	2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901202	3	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		NA	NA	0.00	0.00	0.00	0.00	0.00	0.00

**BEVERLY ACRES MUTUAL**

8000004	ROSE HILLS	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		NA	NA	0.00	0.00	0.00	0.00	0.00	0.00

**BIRENBAUM, MAX**

8000005	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		NA	NA	0.00	0.00	0.00	0.00	0.00	0.00

**BROOKS, GIFFORD JR.**

1902144	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		NA	NA	0.00	0.00	0.00	0.00	0.00	0.00



RECORDATION NUMBER	WELL NAME	WELL CAPACITY		2022-23 PRODUCTION	PROJECTED GROUNDWATER DEMANDS				
		ACRE-FEET	GPM		2023-24	2024-25	2025-26	2026-27	2027-28

**BURBANK DEVELOPMENT COMPANY**

1900093	BURB	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		NA	NA	0.00	0.00	0.00	0.00	0.00	0.00

**CALIFORNIA-AMERICAN WATER COMPANY/DUARTE SYSTEM (2)**

1900354	STA FE	1,694	1,050	161.26	600.00	600.00	610.00	610.00	620.00
1900355	B V	2,339	1,450	478.46	820.00	830.00	840.00	850.00	860.00
1900356	MT AVE	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900357	LAS L	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900358	FISH C	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902907	WILEY	2,420	1,500	2,056.55	850.00	860.00	870.00	880.00	880.00
1903018	CR HV	2,581	1,600	634.89	910.00	920.00	930.00	930.00	940.00
8000139	ENCTO	1,936	1,200	370.74	680.00	690.00	690.00	700.00	710.00
8000140	LASL 2	2,258	1,400	27.37	800.00	800.00	810.00	820.00	830.00
1900497	BACON	484	300	1.98	170.00	170.00	170.00	180.00	180.00
8000216	B V 2	2,661	1,650	785.17	940.00	950.00	950.00	960.00	970.00
8000237	LEMON	242	150	231.62	90.00	90.00	90.00	90.00	90.00
SUBTOTAL:		16,614	10,300	4,748.04	5,860.00	5,910.00	5,960.00	6,020.00	6,080.00

**CALIFORNIA-AMERICAN WATER COMPANY/SAN MARINO SYSTEM (2)**

1900917	HALL	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900918	GUESS	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900919	MISVW	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900920	MISVW	1,613	1,000	1,098.44	810.00	820.00	830.00	830.00	840.00
1900921	RIC-1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900922	RIC-2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900923	IVR-1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900924	MAR-1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900925	MAR-2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900926	GRAND	2,016	1,250	454.60	1,010.00	1,020.00	1,030.00	1,040.00	1,050.00
1900927	ROSE	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900934	ROAN	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900935	LONG	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901441	BR-1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902424	HOWL	1,129	700	249.87	570.00	570.00	580.00	580.00	590.00
1902787	BR-2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902867	IVR-2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1903019	MAR-3	1,936	1,200	1,725.77	970.00	980.00	990.00	1,000.00	1,010.00
1903059	DELMAR	1,290	800	619.10	650.00	650.00	660.00	670.00	670.00
8000175	HALL-2	2,258	1,400	163.80	1,130.00	1,140.00	1,160.00	1,170.00	1,180.00
8000222	RIC-3	2,581	1,600	731.35	1,290.00	1,310.00	1,320.00	1,330.00	1,350.00
8000182	ADA-3	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901508	9	2,420	1,500	215.24	400.00	410.00	410.00	420.00	420.00
8000217	11	2,420	1,500	1,185.31	1,210.00	1,230.00	1,240.00	1,250.00	1,260.00
SUBTOTAL:		17,662	10,950	6,443.48	8,040.00	8,130.00	8,220.00	8,290.00	8,370.00

**CALIFORNIA COUNTRY CLUB (1)**

1902529	CLUB	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902531	ARTES	1,129	700	0.00	0.00	0.00	0.00	0.00	0.00
1903084	SYC	1,290	800	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		2,420	1,500	0.00	0.00	0.00	0.00	0.00	0.00

**CALIFORNIA DOMESTIC WATER COMPANY (2)**

1901181	2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000236	2A	5,323	3,300	3,448.06	2,940.00	2,810.00	2,680.00	2,550.00	2,550.00
1901182	1-E	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901183	5	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901185	13-N	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902967	6	6,613	4,100	337.56	3,910.00	3,740.00	3,570.00	3,400.00	3,400.00
1903057	3	6,775	4,200	6,165.07	4,400.00	4,210.00	4,020.00	3,830.00	3,830.00
1903081	8	4,839	3,000	118.04	2,940.00	2,810.00	2,680.00	2,550.00	2,550.00
8000100	5A	6,452	4,000	5,213.09	3,910.00	3,740.00	3,570.00	3,400.00	3,400.00
8000174	14	5,323	3,300	0.00	0.00	0.00	0.00	0.00	0.00
8000223	10	8,065	5,000	1,854.46	4,900.00	4,690.00	4,480.00	4,270.00	4,270.00
1900092	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		43,390	26,900	17,136.28	23,000.00	22,000.00	21,000.00	20,000.00	20,000.00

RECORDATION NUMBER	WELL NAME	WELL CAPACITY		2022-23 PRODUCTION	PROJECTED GROUNDWATER DEMANDS				
		ACRE-FEET	GPM		2023-24	2024-25	2025-26	2026-27	2027-28

**CARRIER CORPORATION (1)**

Carrier	--	--	--	0.00	5.00	5.00	5.00	5.00	5.00
SUBTOTAL:		--	--	0.00	5.00	5.00	5.00	5.00	5.00

**CEDAR AVENUE MUTUAL WATER COMPANY**

1901411	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902783	2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**CEMEX CONSTRUCTION MATERIALS L.P. (AZ-TWO INC.)**

1900038	2	2,305	1,429	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		2,305	1,429	0.00	0.00	0.00	0.00	0.00	0.00

**CHAMPION MUTUAL WATER COMPANY (SAN GABRIEL VALLEY WATER COMPANY)**

1900908	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902816	2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000121	3	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**CHEVRON USA**

1900250	TEMP1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**CITRUS VALLEY MEDICAL CENTER, QUEEN OF THE VALLEY CAMPUS (QUEEN OF THE VALLEY HOSPITAL) (1)**

8000138	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**CLAYTON MANUFACTURING COMPANY**

1901055	2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000170	MW-4	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**COLLISON, E.O.**

1902968	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**CORCORAN BROS.**

1902814	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**COUNTY SANITATION DISTRICT NO. 18 (1)**

8000008	2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000009	3	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000104	LE 1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000105	LE 2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000106	LE 3	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000107	LE 4	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000128	EO8A	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000129	E09A	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000130	E10A	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000131	E11A	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000141	EX1	NA	NA	0.22	0.24	0.24	0.24	0.24	0.24
8000142	EX2	NA	NA	0.03	0.00	0.00	0.00	0.00	0.00
8000143	EX3	NA	NA	0.01	0.00	0.00	0.00	0.00	0.00
8000144	EX4	NA	NA	0.01	0.00	0.00	0.00	0.00	0.00

RECORDATION NUMBER	WELL NAME	WELL CAPACITY		2022-23 PRODUCTION	PROJECTED GROUNDWATER DEMANDS					
		ACRE-FEET	GPM		2023-24	2024-25	2025-26	2026-27	2027-28	
8000161	E01R	NA	NA	0.08	0.08	0.08	0.08	0.08	0.08	
8000162	E03R	NA	NA	0.04	0.04	0.04	0.04	0.04	0.04	
8000163	E05R	NA	NA	0.52	0.50	0.50	0.50	0.50	0.50	
8000164	E07R	NA	NA	0.76	0.87	0.87	0.87	0.87	0.87	
8000165	E02R	NA	NA	0.75	0.84	0.84	0.84	0.84	0.84	
8000166	E04R	NA	NA	0.25	0.24	0.24	0.24	0.24	0.24	
8000167	E06R	NA	NA	0.17	0.15	0.15	0.15	0.15	0.15	
8000168	E08R	NA	NA	0.32	0.32	0.32	0.32	0.32	0.32	
WRP FL E	WRP FL E	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00	
SUBTOTAL:				9.60	10.00	10.00	10.00	10.00	10.00	
<b>COVINA, CITY OF</b>										
1901685	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00	
1901686	2	968	600	0.00	0.00	0.00	0.00	0.00	0.00	
1901687	3	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00	
SUBTOTAL:				968	600	0.00	0.00	0.00	0.00	
<b>COVINA IRRIGATING COMPANY (2)</b>										
1900881	CONTR	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00	
1900882	3 BAL	2,903	1,800	2,283.62	2,650.00	2,650.00	2,650.00	2,650.00	2,650.00	
1900883	2 BAL	2,581	1,600	6.23	4.00	4.00	400.00	400.00	400.00	
1900885	1 BAL	2,097	1,300	774.61	600.00	1,000.00	1,250.00	1,600.00	1,600.00	
1900880	VALEN	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00	
SUBTOTAL:				7,581	4,700	3,064.46	3,254.00	3,654.00	4,300.00	4,650.00
<b>CREVOLIN, A.J.</b>										
8000011	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00	
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00	
<b>CROWN CITY PLATING COMPANY</b>										
8000012	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00	
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00	
<b>DAVIDSON OPTRONICS INC.</b>										
8000013	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00	
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00	
<b>DAWES, MARY K.</b>										
1902952	4	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00	
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00	
<b>DEFALCO, JOHN &amp; CAROLE</b>										
8000194	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00	
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00	
<b>DEL RIO MUTUAL WATER COMPANY (1)</b>										
1900331	BURKE	261	162	81.00	90.00	90.00	90.00	90.00	90.00	
1900332	KLING	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00	
SUBTOTAL:				261	162	81.00	90.00	90.00	90.00	90.00
<b>DRIFTWOOD DAIRY</b>										
1902924	1	298	185	0.00	0.00	0.00	0.00	0.00	0.00	
SUBTOTAL:				298	185	0.00	0.00	0.00	0.00	0.00

RECORDATION NUMBER	WELL NAME	WELL CAPACITY		2022-23 PRODUCTION	PROJECTED GROUNDWATER DEMANDS				
		ACRE-FEET	GPM		2023-24	2024-25	2025-26	2026-27	2027-28

**DUNNING, GEORGE**

1900091	1910	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**EL MONTE, CITY OF (2)**

1901692	2A	1,532	950	378.83	405.36	421.57	438.44	455.97	474.21
1901693	3	807	500	0.00	0.00	0.00	0.00	0.00	0.00
1901694	4	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901695	5	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901699	10	2,420	1,500	441.43	472.34	491.23	510.88	531.32	552.57
1901700	11	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902612	MT VW	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1903137	12	2,742	1,700	47.36	50.68	52.70	54.81	57.01	59.29
8000066	--	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000101	13	4,839	3,000	0.00	0.00	0.00	0.00	0.00	0.00
8000231	14	290	180	234.52	250.93	260.96	271.40	282.26	293.55
8000232	15	274	170	254.86	291.46	303.12	315.24	327.85	340.96
8000233	16	403	250	433.61	463.97	482.53	501.83	521.91	542.78
SUBTOTAL:		13,307	8,250	1,790.61	1,934.73	2,012.12	2,092.61	2,176.31	2,263.36

**EL MONTE CEMETERY ASSOCIATION**

8000017	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**FRUIT STREET WATER COMPANY**

1901199	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**GATES, JAMES RICHARD (1)**

8000215	NA	NA	NA	0.36	1.00	1.00	1.00	1.00	1.00
SUBTOTAL:				0.36	1.00	1.00	1.00	1.00	1.00

**GLENDORA, CITY OF (2)**

1900826	11-E	1,452	900	354.10	900.00	900.00	900.00	900.00	900.00
1900827	12-E	3,226	2,000	1,418.27	2,000.00	2,020.00	2,020.00	2,020.00	2,020.00
1900828	10-E	1,048	650	268.99	650.00	660.00	660.00	660.00	660.00
1900829	8-E	2,742	1,700	1,538.41	1,700.00	1,720.00	1,720.00	1,720.00	1,720.00
1900830	9-E	2,742	1,700	2,038.60	1,700.00	1,720.00	1,720.00	1,720.00	1,720.00
1900831	7-G	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901523	1-E	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901524	4-E	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901525	3-G	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901526	2-E	807	500	406.95	500.00	500.00	500.00	500.00	500.00
8000003	--	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000149	5-E	2,903	1,800	941.50	1,800.00	1,820.00	1,820.00	1,820.00	1,820.00
8000184	13-E	1,290	800	739.07	800.00	810.00	810.00	810.00	810.00
SUBTOTAL:		16,211	10,050	7,705.89	10,050.00	10,150.00	10,150.00	10,150.00	10,150.00

**GOEDERT, LILLIAN**

8000027	GOEDERT	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**GOLDEN STATE WATER COMPANY (SOUTHERN CALIFORNIA WATER COMPANY)/SAN DIMAS DISTRICT (1)**

1902148	BAS-3	968	600	0.00	0.00	0.00	0.00	0.00	0.00
1902149	BAS-4	1,210	750	0.00	0.00	0.00	0.00	0.00	0.00
1902150	HIGHWAY	1,129	700	225.85	1,050.00	1,050.00	1,060.00	1,060.00	1,070.00
1902151	ART-1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902152	ART-2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902154	L H-2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902266	COL-1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902267	COL-2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902268	COL-4	726	450	0.00	0.00	0.00	0.00	0.00	0.00
1902269	COL-5	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902270	COL-6	686	425	0.00	0.00	0.00	0.00	0.00	0.00
1902271	COL-7	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00

RECORDATION NUMBER	WELL NAME	WELL CAPACITY		2022-23 PRODUCTION	PROJECTED GROUNDWATER DEMANDS				
		ACRE-FEET	GPM		2023-24	2024-25	2025-26	2026-27	2027-28
1902272	COL-8	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902286	CITY	323	200	143.98	300.00	300.00	300.00	300.00	300.00
1902842	ART-3	403	250	99.48	380.00	380.00	380.00	380.00	380.00
1902287	MALON	605	375	456.63	560.00	560.00	570.00	570.00	570.00
8000212	HIGHWAY 2	1,613	1,000	390.47	1,500.00	1,510.00	1,510.00	1,520.00	1,520.00
SUBTOTAL:		7,662	4,750	1,316.41	3,790.00	3,800.00	3,820.00	3,830.00	3,840.00
<b>GOLDEN STATE WATER COMPANY (SOUTHERN CALIFORNIA WATER COMPANY)/SAN GABRIEL DISTRICT (1)</b>									
1900510	1 S G	1,774	1,100	1,231.82	1,360.00	1,360.00	1,370.00	1,370.00	1,380.00
1900511	2 S G	1,452	900	227.74	740.00	740.00	750.00	750.00	750.00
1900512	2 GAR	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900513	1 GAR	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900514	3 SAX	565	350	0.00	0.00	0.00	0.00	0.00	0.00
1900515	1 SAX	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000146	4 SAX	1,532	950	1.19	0.00	0.00	0.00	0.00	0.00
1902144	1 EAR	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902017	1 JEF	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902018	2 JEF	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902019	3 JEF	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902020	1 AZU	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902024	1 ENC	1,936	1,200	795.31	740.00	740.00	750.00	750.00	750.00
1902027	1 PER	697	432	111.39	270.00	270.00	270.00	270.00	270.00
1902030	1 GRA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902031	2 GID	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902032	1 GID	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902034	1 FAR	1,936	1,200	0.86	250.00	250.00	250.00	250.00	250.00
1902035	2 ENC	968	600	380.39	740.00	740.00	750.00	750.00	750.00
1902461	2 GRA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902948	2 FAR	1,210	750	0.00	120.00	120.00	120.00	120.00	130.00
8000073	3 ENC	1,048	650	457.55	400.00	400.00	400.00	410.00	410.00
8000111	4 JEF	2,097	1,300	775.45	1,610.00	1,610.00	1,620.00	1,620.00	1,630.00
8000221	3 GAR	NA	NA	655.62	560.00	560.00	560.00	560.00	560.00
SUBTOTAL:		15,214	9,432	4,637.32	6,790.00	6,790.00	6,840.00	6,850.00	6,880.00
<b>GOULD ELECTRONICS INC. AND JOHNSON CONTROLS INC. (1)</b>									
SEW	SEW	NA	NA	22.10	40.00	40.00	40.00	40.00	40.00
DEW	DEW	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				22.10	40.00	40.00	40.00	40.00	40.00
<b>GREEN, WALTER</b>									
8000027	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000028	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00
<b>HANSEN, ALICE</b>									
8000029	2946	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00
<b>HANSON AGGREGATES WEST, INC. (LIVINGSTON-GRAHAM) (1)</b>									
1900961	1 DUA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900963	1 KIN	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901492	1 EL	3,302	2,047	56.19	60.00	60.00	60.00	60.00	60.00
1901493	3 EL	4,563	2,829	89.26	110.00	110.00	110.00	110.00	110.00
1903006	4 EL	356	221	0.00	0.00	0.00	0.00	0.00	0.00
--	Temp	NA	NA	0.00	4.00	4.00	4.00	4.00	4.00
SUBTOTAL:		8,221	5,097	145.45	174.00	174.00	174.00	174.00	174.00
<b>HARTLEY, DAVID</b>									
8000029	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

RECORDATION NUMBER	WELL NAME	WELL CAPACITY		2022-23 PRODUCTION	PROJECTED GROUNDWATER DEMANDS				
		ACRE-FEET	GPM		2023-24	2024-25	2025-26	2026-27	2027-28

**HEMLOCK MUTUAL WATER COMPANY (1)**

1901178	NORTH	219	136	23.47	30.00	30.00	30.00	30.00	30.00
1902806	SOUTH	516	320	38.34	40.00	40.00	40.00	40.00	40.00
SUBTOTAL:		736	456	61.81	70.00	70.00	70.00	70.00	70.00

**HERMETIC SEAL CORPORATION (1)**

EW-21/22	EW-21/22	NA	NA	37.97	50.00	50.00	50.00	50.00	50.00
SUBTOTAL:				37.97	50.00	50.00	50.00	50.00	50.00

**IBY PROPERTY OWNER, LLC (MOLSON COORS USA, LLC) (1)**

8000034	--	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000075	2	5,533	3,430	11.75	50.00	50.00	50.00	50.00	50.00
8000076	--	5,533	3,430	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		11,065	6,860	11.75	50.00	50.00	50.00	50.00	50.00

**INDUSTRY WATERWORKS SYSTEM, CITY OF (2)**

1902581	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902582	2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902583	5TH AVE	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000078	3	2,016	1,250	0.00	0.00	0.00	0.00	384.00	384.00
8000096	4	2,016	1,250	0.00	0.00	0.00	0.00	768.00	768.00
8000097	5	1,936	1,200	1,106.34	1,920.00	1,920.00	1,920.00	768.00	768.00
SUBTOTAL:		5,968	3,700	1,106.34	1,920.00	1,920.00	1,920.00	1,920.00	1,920.00

**KIYAN, HIDEO**

1902970	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**LA PUENTE VALLEY COUNTY WATER DISTRICT (2)**

1901459	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901460	2	1,936	1,200	1,532.57	1,932.00	1,932.00	1,932.00	1,932.00	1,932.00
1902859	3	2,016	1,250	59.19	4.00	4.00	4.00	4.00	4.00
8000062	4	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000209	5	2,016	1,250	2,130.87	2,016.00	2,016.00	2,016.00	2,016.00	2,016.00
8000238	IZ-1	NA	NA	7.51	6.00	6.00	6.00	6.00	6.00
8000239	IZ-2	NA	NA	0.00	2.00	2.00	2.00	2.00	2.00
8000240	IZ-EAST	NA	NA	13.14	8.00	8.00	8.00	8.00	8.00
8000241	IZ-WEST	NA	NA	26.53	14.00	14.00	14.00	14.00	14.00
8000242	MZ-1	NA	NA	13.10	11.00	11.00	11.00	11.00	11.00
8000243	MZ-2	NA	NA	11.34	11.00	11.00	11.00	11.00	11.00
8000244	MZ-3	NA	NA	10.89	9.00	9.00	9.00	9.00	9.00
SUBTOTAL:		5,968	3,700	3,805.14	4,013.00	4,013.00	4,013.00	4,013.00	4,013.00

**LA VERNE, CITY OF**

1902322	SNIDO	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**LAKIN, KELLY**

8000158	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**LANDEROS, JOHN**

8000031	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**LOS ANGELES, COUNTY OF (1)**

RECORDATION NUMBER	WELL NAME	WELL CAPACITY		2022-23 PRODUCTION	PROJECTED GROUNDWATER DEMANDS				
		ACRE-FEET	GPM		2023-24	2024-25	2025-26	2026-27	2027-28
1902666	6	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000070	1 SF	3,349	2,076	690.24	820.00	820.00	820.00	820.00	820.00
8000074	2 SF	458	284	35.45	30.00	30.00	30.00	30.00	30.00
8000088	B RED	174	108	0.00	0.00	0.00	0.00	0.00	0.00
8000089	N LK	1,323	820	0.00	0.00	0.00	0.00	0.00	0.00
8000090	600	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902158	BN PK	2,087	1,294	0.00	0.00	0.00	0.00	0.00	0.00
8000150	3A	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
EPA (LE L)	WNOU	NA	NA	1,838.22	2,800.00	2,800.00	2,800.00	2,800.00	2,800.00
SUBTOTAL:		10,101	6,262	2,563.91	3,650.00	3,650.00	3,650.00	3,650.00	3,650.00
<b>LOS FLORES MUTUAL WATER COMPANY</b>									
11902098	1-LO	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
21902098	1-HI	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00
<b>LOUCKS, DAVID</b>									
8000032	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00
<b>MAECHTLIN, J.J. TRUSTEE</b>									
1902321	OLD60	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902322	SNIDO	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902323	M & N	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00
<b>MANNING BROS. ROCK &amp; SAND COMPANY</b>									
1900117	36230	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00
<b>MAPLE WATER COMPANY (SUBURBAN WATER SYSTEMS)</b>									
1900042	2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000109	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00
<b>MARTINEZ, FRANCES MERCY</b>									
8000033	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00
<b>METROPOLITAN WATER DISTRICT OF SOUTHERN CALIFORNIA</b>									
1900693	2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900694	3	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00
<b>MONROVIA, CITY OF (2)</b>									
1900417	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900418	2	2,742	1,700	95.61	1,140.00	1,170.00	1,200.00	1,230.00	1,260.00
1900419	3	2,742	1,700	1,596.45	1,110.00	1,140.00	1,170.00	1,190.00	1,220.00
1900420	4	2,903	1,800	1,367.96	1,520.00	1,560.00	1,600.00	1,640.00	1,670.00
1940104	5	3,871	2,400	31.15	1,760.00	1,810.00	1,850.00	1,900.00	1,940.00
8000171	6	3,871	2,400	2,608.04	1,600.00	1,640.00	1,680.00	1,720.00	1,760.00
SUBTOTAL:		16,130	10,000	5,699.21	7,130.00	7,320.00	7,500.00	7,680.00	7,850.00
<b>MONROVIA NURSERY</b>									
1902456	DIV 4	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

RECORDATION NUMBER	WELL NAME	WELL CAPACITY		2022-23 PRODUCTION	PROJECTED GROUNDWATER DEMANDS				
		ACRE-FEET	GPM		2023-24	2024-25	2025-26	2026-27	2027-28

**MONTEREY PARK, CITY OF (2)**

1900453	1	968	600	425.01	270.00	280.00	280.00	290.00	300.00
1900454	2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900455	3	968	600	532.58	700.00	710.00	730.00	740.00	760.00
1900456	4	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900457	5	2,903	1,800	2.76	600.00	610.00	630.00	640.00	660.00
1900458	6	968	600	0.00	0.00	0.00	0.00	0.00	0.00
1902372	7	1,290	800	0.00	0.00	0.00	0.00	0.00	0.00
1902373	8	2,903	1,800	0.00	0.00	0.00	0.00	0.00	0.00
1902690	9	2,903	1,800	6.27	10.00	10.00	10.00	10.00	10.00
1902818	10	2,903	1,800	1,489.67	1,780.00	1,820.00	1,860.00	1,910.00	1,950.00
1903033	12	3,226	2,000	1,571.49	2,360.00	2,420.00	2,470.00	2,530.00	2,580.00
1903092	14	1,129	700	0.00	0.00	0.00	0.00	0.00	0.00
8000126	FERN	1,613	1,000	12.90	240.00	250.00	250.00	260.00	270.00
8000196	15	3,226	2,000	1,550.15	1,790.00	1,820.00	1,870.00	1,910.00	1,950.00
SUBTOTAL:		25,002	15,500	5,590.83	7,750.00	7,920.00	8,100.00	8,290.00	8,480.00

**MOON VALLEY NURSERY OF CALIFORNIA, INC. (COINER, JAMES W., DBA COINER NURSERY) (1)**

1903072	5R	NA	NA	57.55	50.00	50.00	50.00	50.00	50.00
SUBTOTAL:				57.55	50.00	50.00	50.00	50.00	50.00

**MUNOZ, RALPH (1)**

8000219	MUNOZ	NA	NA	0.70	1.00	1.00	1.00	1.00	1.00
SUBTOTAL:				0.70	1.00	1.00	1.00	1.00	1.00

**NAMIMATSU FARMS INC.**

1901034	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**NICK TOMOVICH & SON**

8000037	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**NO. 17 WALNUT PLACE MUTUAL WATER COMPANY**

8000038	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**OWL ROCK PRODUCTS (ROBERTSON'S READY MIX)**

1900043	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902241	NA	3,205	1,987	0.00	0.00	0.00	0.00	0.00	0.00
1903119	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		3,205	1,987	0.00	0.00	0.00	0.00	0.00	0.00

**PARK WATER CO.**

1901307	26-A	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000039	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**PICO COUNTY WATER DISTRICT**

8000040	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**POLOPOLUS, ET AL**

1902169	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00



RECORDATION NUMBER	WELL NAME	WELL CAPACITY		2022-23 PRODUCTION	PROJECTED GROUNDWATER DEMANDS				
		ACRE-FEET	GPM		2023-24	2024-25	2025-26	2026-27	2027-28
<b>PROGRESSIVE BUDDHIST ASSOCIATION (1)</b>									
8000228	--	48	30	0.37	1.00	1.00	1.00	1.00	1.00
SUBTOTAL:		48	30	0.37	1.00	1.00	1.00	1.00	1.00
<b>RICHWOOD MUTUAL WATER COMPANY</b>									
1901521	1 SOUTH	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901522	2 NORTH	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00
<b>ROWLAND WATER DISTRICT (1)</b>									
--	--	NA	NA	0.00	4.00	4.00	4.00	4.00	4.00
SUBTOTAL:				0.00	4.00	4.00	4.00	4.00	4.00
<b>RURBAN HOMES MUTUAL WATER COMPANY (1)</b>									
1900120	1-NORTH	726	450	0.00	0.00	0.00	0.00	0.00	0.00
1900121	2-SOUTH	484	300	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		1,210	750	0.00	0.00	0.00	0.00	0.00	0.00
<b>RUTH, ROY</b>									
8000041	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00
<b>S.L.S. &amp; N. INC. (1)</b>									
8000151	NA	NA	NA	28.72	30.00	30.00	30.00	30.00	30.00
SUBTOTAL:				28.72	30.00	30.00	30.00	30.00	30.00
<b>SAN GABRIEL COUNTRY CLUB (1)</b>									
1900547	1	226	140	38.78	40.00	40.00	40.00	40.00	40.00
1902979	2	750	465	182.57	200.00	200.00	200.00	200.00	200.00
SUBTOTAL:		976	605	221.35	240.00	240.00	240.00	240.00	240.00
<b>SAN GABRIEL COUNTY WATER DISTRICT (2)</b>									
1901669	5 BRA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901670	6 BRA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901671	7	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901672	8	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902785	9	1,613	1,000	1,790.69	1,800.00	1,800.00	1,800.00	1,800.00	1,800.00
1902786	10	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000067	11	1,129	700	70.41	80.00	80.00	80.00	80.00	80.00
8000123	12	4,274	2,650	656.01	750.00	750.00	750.00	750.00	750.00
8000133	14	3,871	2,400	542.78	700.00	700.00	700.00	700.00	700.00
8000220	15	3,871	2,400	590.36	705.00	705.00	705.00	705.00	705.00
SUBTOTAL:		14,759	9,150	3,650.25	4,035.00	4,035.00	4,035.00	4,035.00	4,035.00
<b>SAN GABRIEL VALLEY WATER COMPANY (1)</b>									
1900725	G4A	1,534	951	408.86	470.00	480.00	490.00	490.00	490.00
1900733	5A	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902635	B1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000112	B5C	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000038	--	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900729	1B	1,792	1,111	3.29	370.00	380.00	390.00	390.00	390.00
1902946	1C	3,268	2,026	0.00	0.00	0.00	0.00	0.00	0.00
8000081	1B4	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000082	1B5	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000102	1D	3,524	2,185	2,522.11	3,310.00	3,360.00	3,420.00	3,420.00	3,420.00
1900749	2C	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902857	2D	3,684	2,284	207.73	1,030.00	1,050.00	1,070.00	1,070.00	1,070.00
8000065	2E	3,226	2,000	1,312.70	290.00	290.00	300.00	300.00	300.00
1900736	8A	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900746	8B	1,887	1,170	881.84	200.00	200.00	200.00	200.00	200.00
1900747	8C	2,299	1,425	1,674.92	1,310.00	1,330.00	1,360.00	1,360.00	1,360.00
1903103	8D	3,629	2,250	446.41	1,700.00	1,720.00	1,760.00	1,760.00	1,760.00
8000113	8E	4,412	2,735	8.40	440.00	440.00	450.00	450.00	450.00

RECORDATION NUMBER	WELL NAME	WELL CAPACITY		2022-23 PRODUCTION	PROJECTED GROUNDWATER DEMANDS				
		ACRE-FEET	GPM		2023-24	2024-25	2025-26	2026-27	2027-28
1900739	11A	3,557	2,205	2,018.17	2,530.00	2,570.00	2,620.00	2,620.00	2,620.00
1900745	11B	2,894	1,794	0.62	50.00	50.00	50.00	50.00	50.00
1902713	11C	1,578	978	3.05	30.00	30.00	30.00	30.00	30.00
8000083	11B7	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902858	B4B	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902947	B4C	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900718	B5A	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900719	B5B	4,741	2,939	3,253.34	3,100.00	3,150.00	3,210.00	3,210.00	3,210.00
1900721	B6B	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1903093	B6C	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000084	B6B2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000098	B6D	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902525	B2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000122	B7E	826	512	396.64	400.00	400.00	410.00	410.00	410.00
1901435	B7A	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901436	B8	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901437	B9	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901439	B11A	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901440	B7B	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000068	B7C	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000094	B7D	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000099	B9B	1,327	823	542.63	580.00	590.00	610.00	610.00	610.00
8000108	B11B	2,855	1,770	606.08	830.00	840.00	860.00	860.00	860.00
8000172	1E	4,274	2,650	345.06	1,190.00	1,200.00	1,230.00	1,230.00	1,230.00
8000160	B5D	3,805	2,359	1,234.96	1,710.00	1,740.00	1,770.00	1,770.00	1,770.00
8000169	8F	4,794	2,972	803.08	690.00	700.00	710.00	710.00	710.00
NA	G4B	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
NA	1F	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000197	2F	NA	1,576	120.21	300.00	310.00	310.00	310.00	310.00
NA	B11C	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000203	B24A	3,736	2,316	7.13	130.00	130.00	130.00	130.00	130.00
8000204	B24B	3,668	2,274	0.67	0.00	0.00	0.00	0.00	0.00
8000187	B25A	3,892	2,413	2,858.07	3,670.00	3,720.00	3,790.00	3,790.00	3,790.00
8000188	B25B	3,968	2,460	3,002.89	3,370.00	3,430.00	3,490.00	3,490.00	3,490.00
8000189	B26A	1,011	627	935.61	1,000.00	1,020.00	1,040.00	1,040.00	1,040.00
8000190	B26B	1,800	1,116	1,305.76	1,040.00	1,050.00	1,070.00	1,070.00	1,070.00
8000205	B5E	4,654	2,885	5,165.64	4,030.00	4,090.00	4,170.00	4,170.00	4,170.00
8000226	11D	2,823	1,750	323.63	800.00	810.00	830.00	830.00	830.00
NA	B24C	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
NA	B24D	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		85,457	54,556	30,389.50	34,570.00	35,080.00	35,770.00	35,770.00	35,770.00
<b>SLOAN RANCHES</b>									
1901198	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000045	2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00
<b>SIERRA LA VERNE COUNTRY CLUB (1)</b>									
8000124	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000125	2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000192	15 OFFSITE	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00
<b>SIERRA MADRE, CITY OF (1)</b>									
8000193	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00
<b>SONOCO PRODUCTS COMPANY (1)</b>									
1912786	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902971	2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000137	2	NA	NA	78.51	80.00	80.00	80.00	80.00	80.00
SUBTOTAL:				78.51	80.00	80.00	80.00	80.00	80.00

RECORDATION NUMBER	WELL NAME	WELL CAPACITY		2022-23 PRODUCTION	PROJECTED GROUNDWATER DEMANDS				
		ACRE-FEET	GPM		2023-24	2024-25	2025-26	2026-27	2027-28
<b>SOUTH COVINA WATER SERVICE</b>									
1901606	102	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00
<b>SOUTH PASADENA, CITY OF (2)</b>									
1901679	GRAV 2	1,129	700	1.56	240.00	240.00	240.00	240.00	240.00
1901681	2 WIL	1,936	1,200	0.00	0.00	0.00	0.00	0.00	0.00
1901682	3 WIL	3,161	1,960	1,809.52	2,225.00	2,225.00	2,225.00	2,225.00	2,225.00
1903086	4 WIL	1,774	1,100	969.94	1,335.00	1,335.00	1,335.00	1,335.00	1,335.00
SUBTOTAL:		8,000	4,960	2,781.02	3,800.00	3,800.00	3,800.00	3,800.00	3,800.00
<b>SOUTHERN CALIFORNIA EDISON COMPANY (1)</b>									
1900342	1EB86	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900343	2EB76	211	131	0.00	0.00	0.00	0.00	0.00	0.00
8000046	110RH	NA	NA	0.03	10.00	10.00	10.00	10.00	10.00
8000047	MURAT	2,420	1,500	0.00	0.00	0.00	0.00	0.00	0.00
1900344	38EIS	1,415	877	0.00	0.00	0.00	0.00	0.00	0.00
1900344	38W	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		4,045	2,508	0.03	10.00	10.00	10.00	10.00	10.00
<b>STERLING MUTUAL WATER COMPANY (1)</b>									
1902085	SOUTH	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902096	NORTH	397	246	48.45	40.00	40.00	40.00	40.00	40.00
8000132	NEW SO	436	270	30.48	50.00	50.00	50.00	50.00	50.00
SUBTOTAL:		832	516	78.93	90.00	90.00	90.00	90.00	90.00
<b>SUBURBAN WATER SYSTEMS (2)</b>									
1900337	152W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901429	201W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901430	201W2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901431	201W3	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901432	201W5	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901433	201W4	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901434	201W6	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901596	147W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901597	142W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901598	139W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901599	139W2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901600	139W3	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901602	140W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901604	148W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901608	105W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901609	106W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901610	111W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901611	112W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901612	113W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901613	114W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901614	117W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901615	120W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901616	122W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901617	123W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901618	124W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901619	125W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901620	126W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901621	131W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901622	133W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901623	134W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901624	135W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901625	136W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901627	202W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902119	149W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902519	150W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902760	147W2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902761	153W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902762	154W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902763	157W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1903067	140W3	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000069	139W4	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000077	147W3	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000087	125W2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000092	126W2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00

RECORDATION NUMBER	WELL NAME	WELL CAPACITY		2022-23 PRODUCTION	PROJECTED GROUNDWATER DEMANDS				
		ACRE-FEET	GPM		2023-24	2024-25	2025-26	2026-27	2027-28
8000093	140W4	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000145	140W5	4,516	2,800	0.02	1,048.41	1,048.41	1,048.41	1,048.41	1,048.41
8000095	139W5	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000152	139W6	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902518	151W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902819	155W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902820	155W2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901605	101W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901607	103W1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000181	121W1	2,742	1,700	943.24	1,611.11	1,611.11	1,611.11	1,611.11	1,611.11
8000183	142W2	4,033	2,500	4,086.57	3,711.22	3,711.22	3,711.22	3,711.22	3,711.22
8000195	201W7	4,839	3,000	3,717.92	5,806.83	5,806.83	5,806.83	5,806.83	5,806.83
8000198	201W8	4,516	2,800	205.16	2,318.86	2,318.86	2,318.86	2,318.86	2,318.86
8000207	151W2	5,162	3,200	1,677.50	4,894.85	4,894.85	4,894.85	4,894.85	4,894.85
8000208	201W9	5,162	3,200	2,986.49	2,341.33	2,341.33	2,341.33	2,341.33	2,341.33
8000210	201W10	5,807	3,600	2,193.43	2,636.94	2,636.94	2,636.94	2,636.94	2,636.94
SUBTOTAL:		36,776	22,800	15,810.33	24,369.55	24,369.55	24,369.55	24,369.55	24,369.55
<b>SUNNY SLOPE WATER COMPANY (2)</b>									
1900026	8	2,645	1,640	300.70	660.00	710.00	750.00	800.00	840.00
1902792	9	3,008	1,763	65.38	710.00	760.00	810.00	860.00	910.00
8000048	10	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000157	13	3,008	1,865	1,498.03	760.00	810.00	860.00	910.00	960.00
SUBTOTAL:		8,662	5,268	1,864.11	2,130.00	2,280.00	2,420.00	2,570.00	2,710.00
<b>TEXACO INC.</b>									
1900001	14	519	322	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		519	322	0.00	0.00	0.00	0.00	0.00	0.00
<b>TRAN, HIEU (1)</b>									
8000218	TRAN	NA	NA	4.55	5.00	5.00	5.00	5.00	5.00
SUBTOTAL:				4.55	5.00	5.00	5.00	5.00	5.00
<b>TYLER NURSERY</b>									
8000049	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00
<b>UNITED CONCRETE PIPE CORPORATION</b>									
8000067	NA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00
<b>UNITED ROCK PRODUCTS CORPORATION (1)</b>									
1900106	IRW-1	NA	NA	422.19	470.00	470.00	470.00	470.00	470.00
1902532	SIERRA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1903062	IRW-2	NA	NA	170.38	40.00	40.00	40.00	40.00	40.00
PIT 2 PUMP	PIT 2 PUMP	NA	NA	24.58	30.00	30.00	30.00	30.00	30.00
SUBTOTAL:				617.15	540.00	540.00	540.00	540.00	540.00
<b>UNITED STATES ENVIRONMENTAL PROTECTION AGENCY</b>									
NA	EW4-3	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
NA	EW4-4	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
NA	EW4-8	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
NA	EW4-9	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

RECORDATION NUMBER	WELL NAME	WELL CAPACITY		2022-23 PRODUCTION	PROJECTED GROUNDWATER DEMANDS				
		ACRE-FEET	GPM		2023-24	2024-25	2025-26	2026-27	2027-28

**VALENCIA HEIGHTS WATER COMPANY (2)**

8000051	1	NA	NA	378.69	0.00	0.00	0.00	0.00	0.00
8000052	2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000054	4	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000055	3A	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000120	5	0	0	0.00	0.00	0.00	0.00	0.00	0.00
8000180	6	807	500	0.00	352.56	367.52	367.52	371.79	376.07
8000211	7	1,081	670	0.00	472.44	492.48	492.48	498.21	503.93
SUBTOTAL:		1,887	1,170	378.69	825.00	860.00	860.00	870.00	880.00

**VALECITO WATER COMPANY**

1901435	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901436	2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901437	3	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901438	4	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901439	5	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901440	6	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**VALLEY COUNTY WATER DISTRICT (3)**

1900027	E MAIN	2,903	1,800	1,696.85	2,109.59	2,109.59	2,109.59	2,109.59	2,109.59
1900028	W MAIN	2,000	1,240	761.99	947.34	947.34	947.34	947.34	947.34
1900029	MORADA	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900031	PADDY	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900032	E NIXON (JOAN)	5,646	3,500	1,055.21	1,311.88	1,311.88	1,311.88	1,311.88	1,311.88
1900034	ARROW	5,484	3,400	3,676.13	4,033.00	4,033.00	4,033.00	4,033.00	4,033.00
1900035	B DAL	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901307	11	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902356	W NIXON (JOAN)	4,516	2,800	2,152.60	2,676.20	2,676.20	2,676.20	2,676.20	2,676.20
8000039	PALM	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000060	LANTE (SA1-3)	5,484	3,400	319.75	4,033.00	4,033.00	4,033.00	4,033.00	4,033.00
8000185	SA1-1	1,613	1,000	306.75	1,613.00	1,613.00	1,613.00	1,613.00	1,613.00
8000186	SA1-2	0	0	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		27,647	17,140	9,969.28	16,724.00	16,724.00	16,724.00	16,724.00	16,724.00

**VALLEY VIEW MUTUAL WATER COMPANY (2)**

1900363	1	310	192	0.00	0.00	0.00	0.00	0.00	0.00
1900364	2	766	475	487.63	529.00	529.00	529.00	529.00	529.00
1900365	3	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:		1,076	667	487.63	529.00	529.00	529.00	529.00	529.00

**VIA TRUST**

1903012	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**VULCAN MATERIALS COMPANY (CALMAT COMPANY) (1)**

1902920	E DUR	6,386	3,959	0.00	0.00	0.00	0.00	0.00	0.00
1903088	1 REL	4,068	2,522	181.85	210.00	210.00	210.00	210.00	210.00
8000063	W DUR	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000235	TEMP/NEW PERM	NA	NA	721.22	440.00	440.00	440.00	440.00	440.00
SUBTOTAL:		10,454	6,481	903.07	650.00	650.00	650.00	650.00	650.00

**WHITTIER, CITY OF (2)**

1901745	9	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901746	10	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901747	11	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901748	12	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1901749	13	1,073	665	261.81	10.00	9.00	8.00	7.00	7.00
8000021	FROM	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
8000071	15	5,968	3,700	1,064.75	56.00	50.00	45.00	41.00	37.00
8000110	16	5,726	3,550	43.53	54.00	48.00	44.00	39.00	35.00
8000135	17	6,775	4,200	0.00	64.00	57.00	51.00	46.00	41.00
8000136	18	6,775	4,200	0.00	64.00	57.00	51.00	46.00	41.00
SUBTOTAL:		26,316	16,315	1,370.09	248.00	221.00	199.00	179.00	161.00

RECORDATION NUMBER	WELL NAME	WELL CAPACITY		2022-23 PRODUCTION	PROJECTED GROUNDWATER DEMANDS				
		ACRE-FEET	GPM		2023-24	2024-25	2025-26	2026-27	2027-28

**WILMOTT, ERMA M.**

8000006	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**WOODLAND, RICHARD**

1902949	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1902950	2	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**WORKMAN MILL INVESTMENT COMPANY (RINCON DITCH COMPANY) (1)**

1902790	4	2,153	1,335	0.00	10.00	10.00	10.00	10.00	10.00
SUBTOTAL:				0.00	10.00	10.00	10.00	10.00	10.00

**WORKMAN MILL INVESTMENT COMPANY (RINCON IRRIGATION COMPANY) (1)**

1900132	1	NA	NA	0.00	0.00	0.00	0.00	0.00	0.00
1900095	2	1,428	885	0.00	0.00	0.00	0.00	0.00	0.00
SUBTOTAL:				0.00	0.00	0.00	0.00	0.00	0.00

**WORKMAN MILL INVESTMENT COMPANY (ROSE HILLS MEMORIAL PARK) (1)**

1900052	3	1,192	739	0.00	0.00	0.00	0.00	0.00	0.00
1900094	1	673	417	0.00	10.00	10.00	10.00	10.00	10.00
SUBTOTAL:				0.00	10.00	10.00	10.00	10.00	10.00

<b>TOTAL</b>		<b>540,775</b>	<b>336,734</b>	<b>161,603.59</b>	<b>206,062.22</b>	<b>207,006.79</b>	<b>208,135.23</b>	<b>208,244.74</b>	<b>209,013.51</b>
--------------	--	----------------	----------------	-------------------	-------------------	-------------------	-------------------	-------------------	-------------------

**NOTES :**

GROUNDWATER PRODUCTION AND DEMANDS IN ACRE-FEET

GPM : GALLONS PER MINUTE

NA : NOT AVAILABLE

(1) GROUNDWATER DEMANDS PROJECTED BY WATERMASTER

(2) PROJECTED GROUNDWATER DEMANDS PROVIDED BY PRODUCER

(3) PROJECTED GROUNDWATER DEMANDS PROVIDED BY PRODUCER AND ADJUSTED BY WATERMASTER

---

## **APPENDIX B.**

# **SIMULATED CHANGES IN GROUNDWATER ELEVATIONS AT WELLS OR WELLFIELDS IN MAIN SAN GABRIEL BASIN**

**B**





## APPENDIX B

### SIMULATED CHANGES IN GROUNDWATER ELEVATION AT WELLS OR WELLFIELDS IN MAIN SAN GABRIEL BASIN UNDER PROJECTED FIVE CONSECUTIVE DRY HYDROLOGICAL CONDITIONS WITH WATER RESOURCE DEVELOPMENT ASSESSMENT

WELL OR WELLFIELD	RECORDATION NUMBER	WELL STATUS	SIMULATED ELEVATION (1)		CHANGE (2) (FEET)	REMARKS
			2022-23	2027-28		
<b>ADAMS RANCH MUTUAL WATER COMPANY</b>						
01	1902106	Inactive	158.30	145.40	-12.90	
02	1902689	Inactive	158.30	145.40	-12.90	
03	8000182	Inactive	157.60	144.70	-12.90	
<b>ALHAMBRA, CITY OF</b>						
MOEL (08)	1900010	Active	142.60	132.50	-10.10	Groundwater Demands Projected by Watermaster
09	1900011	Standby	147.60	140.10	-7.50	Groundwater Demands Projected by Watermaster
10	1900012	Inactive	148.50	139.10	-9.40	
12	1900013	Standby	148.70	140.40	-8.30	Groundwater Demands Projected by Watermaster
13	1900014	Active	146.60	133.90	-12.70	
14	1900015	Active	147.10	136.00	-11.10	Groundwater Demands Projected by Watermaster
15	1900016	Active	142.00	131.20	-10.80	Groundwater Demands Projected by Watermaster
LON 1	1903014	Active	145.40	135.50	-9.90	Groundwater Demands Projected by Watermaster
LON 2	1900017	Active	105.50	101.40	-4.10	Groundwater Demands Projected by Watermaster
GARF	1900018	Inactive	151.60	144.60	-7.00	
11	1903014	Active	145.40	135.50	-9.90	Groundwater Demands Projected by Watermaster
07	1903097	Inactive	145.90	136.30	-9.60	
<b>AMARILLO MUTUAL WATER COMPANY</b>						
01	1900791	Active	156.80	143.50	-13.30	Projected Groundwater Demands Provided by Producer
02	1900792	Active	156.80	143.50	-13.30	Projected Groundwater Demands Provided by Producer
<b>ARCADIA, CITY OF</b>						
LON 1	1901013	Active	200.30	180.30	-20.00	Projected Groundwater Demands Provided by Producer
LON 2	1901014	Active	200.30	180.90	-19.40	Projected Groundwater Demands Provided by Producer
CAM REAL 3	8000213	Active	190.50	166.00	-24.50	Projected Groundwater Demands Provided by Producer
ST JO 2	8000177	Inactive	191.20	171.40	-19.80	Projected Groundwater Demands Provided by Producer
BAL 2	1902791	Inactive	165.80	153.60	-12.20	
PECK 1	1902854	Active	194.30	164.30	-30.00	Projected Groundwater Demands Provided by Producer
L OAK 1	8000127	Active	188.70	165.60	-23.10	Projected Groundwater Demands Provided by Producer
LGY 3	8000214	Active	178.90	152.90	-26.00	Projected Groundwater Demands Provided by Producer
<b>AZUSA, CITY OF (AZUSA AGRICULTURE WATER COMPANY, AZUSA VALLEY WATER COMPANY)</b>						
05 (01)	1902533	Active	551.20	545.10	-6.10	Projected Groundwater Demands Provided by Producer
06 (03)	1902535	Active	551.80	545.00	-6.80	Projected Groundwater Demands Provided by Producer
GENESIS 2 (05)	1902537	Inactive	228.10	211.90	-16.20	
01 (07)	8000072	Active	553.50	545.80	-7.70	Projected Groundwater Demands Provided by Producer
03 (08)	8000086	Active	553.40	545.70	-7.70	Projected Groundwater Demands Provided by Producer

WELL OR WELLFIELD	RECORDATION NUMBER	WELL STATUS	SIMULATED ELEVATION (1)		CHANGE (2) (FEET)	REMARKS
			2022-23	2027-28		
02 (1 NORTH)	1902457	Active	553.50	545.80	-7.70	Projected Groundwater Demands Provided by Producer
04 (2 SOUTH)	1902458	Active	553.40	545.70	-7.70	Projected Groundwater Demands Provided by Producer
08 (AVWC 04)	1902115	Active	592.00	579.70	-12.30	Projected Groundwater Demands Provided by Producer
07 (AVWC 05)	1902116	Active	552.00	545.10	-6.90	Projected Groundwater Demands Provided by Producer
09 (AVWC 06)	1902117	Inactive	225.10	211.00	-14.10	
10 (AVWC 08)	8000103	Active	224.40	210.30	-14.10	Projected Groundwater Demands Provided by Producer
11	8000178	Active	553.60	545.80	-7.80	Projected Groundwater Demands Provided by Producer
12	8000179	Active	553.60	545.80	-7.80	Projected Groundwater Demands Provided by Producer
<b>CALIFORNIA-AMERICAN WATER COMPANY/DUARTE SYSTEM</b>						
STA FE	1900354	Active	258.00	216.00	-42.00	Projected Groundwater Demands Provided by Producer
B V	1900355	Standby	229.90	202.40	-27.50	
B V 2	8000216	Active	229.90	202.40	-27.50	Projected Groundwater Demands Provided by Producer
FISH C	1900358	Inactive	553.80	546.10	-7.70	
WILEY	1902907	Active	552.60	546.90	-5.70	Projected Groundwater Demands Provided by Producer
CR HV	1903018	Active	249.00	208.70	-40.30	Projected Groundwater Demands Provided by Producer
ENCANTO	8000139	Active	590.90	576.40	-14.50	Projected Groundwater Demands Provided by Producer
LAS L2	8000140	Active	590.70	576.30	-14.40	Projected Groundwater Demands Provided by Producer
BACON	1900497	Active	549.90	546.10	-3.80	Projected Groundwater Demands Provided by Producer
Lemon	8000237	Active	228.00	201.80	-26.20	Projected Groundwater Demands Provided by Producer
<b>CALIFORNIA-AMERICAN WATER COMPANY/SAN MARINO SYSTEM</b>						
GUESS	1900918	Inactive	157.30	144.60	-12.70	
MIVW 2	1900920	Inactive	145.50	147.60	2.10	
RIC 3	8000222	Active	150.50	137.20	-13.30	
GRAND	1900926	Inactive	151.10	138.00	-13.10	
ROSEMEAD	1900927	Inactive	150.50	137.20	-13.30	
ROANOKE	1900934	Inactive	148.20	140.70	-7.50	
LONGDEN	1900935	Active	136.50	126.90	-9.60	Projected Groundwater Demands Provided by Producer
HOWLAND	1902424	Active	166.40	152.00	-14.40	Projected Groundwater Demands Provided by Producer
MAR 3	1903019	Active	145.90	143.80	-2.10	Projected Groundwater Demands Provided by Producer
DELMAR	1903059	Active	135.80	124.70	-11.10	Projected Groundwater Demands Provided by Producer
HALL 2	8000175	Active	167.20	145.40	-21.80	Projected Groundwater Demands Provided by Producer

WELL OR WELLFIELD	RECORDATION NUMBER	WELL STATUS	SIMULATED ELEVATION (1)		CHANGE (2) (FEET)	REMARKS
			2022-23	2027-28		
<b>CALIFORNIA COUNTRY CLUB</b>						
ARTES	1902531	Standby	182.90	160.90	-22.00	
SYCAMORE	1903084	Standby	183.00	161.20	-21.80	
<b>CALIFORNIA DOMESTIC WATER COMPANY</b>						
02	1901181	Active	174.90	151.30	-23.60	Projected Groundwater Demands Provided by Producer
06	1902967	Active	180.60	155.70	-24.90	Projected Groundwater Demands Provided by Producer
03	1903057	Active	174.10	150.40	-23.70	Projected Groundwater Demands Provided by Producer
08	1903081	Active	176.70	159.70	-17.00	Projected Groundwater Demands Provided by Producer
05A	8000100	Active	173.20	149.50	-23.70	Projected Groundwater Demands Provided by Producer
14	8000174	Active	177.10	160.80	-16.30	Projected Groundwater Demands Provided by Producer
<b>CITRUS VALLEY MEDICAL CENTER, QUEEN OF THE VALLEY CAMPUS (QUEEN OF THE VALLEY HOSPITAL)</b>						
NA	8000138	Inactive	199.80	177.50	-22.30	
<b>COVINA IRRIGATING COMPANY</b>						
BAL 3	1900882	Active	204.50	181.40	-23.10	Projected Groundwater Demands Provided by Producer
BAL 1	1900885	Active	205.80	181.50	-24.30	Projected Groundwater Demands Provided by Producer
BAL 2	1900883	Active	205.30	181.50	-23.80	Projected Groundwater Demands Provided by Producer
<b>CROWN CITY PLATING COMPANY</b>						
01	8000012	Inactive	166.60	152.50	-14.10	
<b>DEL RIO MUTUAL WATER COMPANY</b>						
BURKETT	1900331	Active	181.60	159.30	-22.30	Groundwater Demands Projected by Watermaster
<b>DRIFTWOOD DAIRY</b>						
01	1902924	Inactive	182.90	160.60	-22.30	
<b>EAST PASADENA WATER COMPANY, LTD.</b>						
09	1901508	Active	131.20	115.90	-15.30	Projected Groundwater Demands Provided by Producer
11	8000217	Active	131.20	115.90	-15.30	Projected Groundwater Demands Provided by Producer
<b>EL MONTE, CITY OF</b>						
02A	1901692	Active	178.60	156.70	-21.90	Groundwater Demands Projected by Watermaster
03	1901693	Standby	181.00	159.50	-21.50	
04	1901694	Standby	180.80	159.90	-20.90	
10	1901699	Active	182.00	159.10	-22.90	Groundwater Demands Projected by Watermaster
12	1903137	Active	177.60	156.50	-21.10	Groundwater Demands Projected by Watermaster
13	8000101	Active	177.60	158.00	-19.60	Groundwater Demands Projected by Watermaster
14	8000231	Active	167.00	152.10	-14.90	
15	8000232	Active	162.00	148.10	-13.90	Groundwater Demands Projected by Watermaster
16	8000233	Active	163.60	149.40	-14.20	Groundwater Demands Projected by Watermaster

WELL OR WELLFIELD	RECORDATION NUMBER	WELL STATUS	SIMULATED ELEVATION (1)		CHANGE (2) (FEET)	REMARKS
			2022-23	2027-28		

**GLENDORA, CITY OF**

11-E	1900826	Active	518.50	507.20	-11.30	Projected Groundwater Demands Provided by Producer
08-E	1900829	Active	552.50	545.30	-7.20	Projected Groundwater Demands Provided by Producer
09-E	1900830	Active	552.60	545.30	-7.30	Projected Groundwater Demands Provided by Producer
12-E	1900827	Active	552.50	545.30	-7.20	Projected Groundwater Demands Provided by Producer
10-E	1900828	Active	524.70	515.50	-9.20	Projected Groundwater Demands Provided by Producer
07-G	1900831	Inactive	226.60	211.00	-15.60	
13-E	8000184	Active	529.00	522.90	-6.10	Projected Groundwater Demands Provided by Producer
02-E	1901526	Active	530.70	525.00	-5.70	Projected Groundwater Demands Provided by Producer
03-G	1901525	Inactive	220.70	206.70	-14.00	
04-E	1901524	Inactive	220.80	207.00	-13.80	
05-E	8000149	Active	553.50	546.10	-7.40	Projected Groundwater Demands Provided by Producer

**GOLDEN STATE WATER COMPANY (SOUTHERN CALIFORNIA WATER COMPANY)/SAN DIMAS DISTRICT**

BAS-3	1902148	Active	861.30	834.20	-27.10	Groundwater Demands Projected by Watermaster
BAS-4	1902149	Active	850.40	821.60	-28.80	Groundwater Demands Projected by Watermaster
HIGHWAY	1902150	Active	861.30	833.70	-27.60	Groundwater Demands Projected by Watermaster
HIGHWAY 2	8000212	Active	860.40	830.10	-30.30	Groundwater Demands Projected by Watermaster
ART-3	1902842	Active	854.20	825.60	-28.60	Groundwater Demands Projected by Watermaster
COL-4	1902268	Active	604.00	561.80	-42.20	Groundwater Demands Projected by Watermaster
COL-6	1902270	Inactive	605.50	563.20	-42.30	
COL-8	1902272	Inactive	732.80	692.10	-40.70	
CITY	1902286	Active	1159.00	1132.00	-27.00	Groundwater Demands Projected by Watermaster
MALON	1902287	Active	1172.00	1138.00	-34.00	Groundwater Demands Projected by Watermaster

**GOLDEN STATE WATER COMPANY (SOUTHERN CALIFORNIA WATER COMPANY)/SAN GABRIEL VALLEY DISTRICT**

S G 1	1900510	Active	147.80	135.70	-12.10	Groundwater Demands Projected by Watermaster
S G 2	1900511	Active	146.30	135.20	-11.10	Groundwater Demands Projected by Watermaster
GAR 3	8000221	Active	151.60	139.20	-12.40	Groundwater Demands Projected by Watermaster
SAX 3	1900514	Active	148.90	136.00	-12.90	Groundwater Demands Projected by Watermaster
SAX 4	8000146	Active	148.90	136.00	-12.90	Groundwater Demands Projected by Watermaster
JEF 1	1902017	Inactive	200.20	181.40	-18.80	
JEF 4	8000111	Active	200.20	181.40	-18.80	Groundwater Demands Projected by Watermaster
ENC 1	1902024	Active	155.70	142.70	-13.00	Groundwater Demands Projected by Watermaster
ENC 2	1902035	Active	155.20	142.00	-13.20	Groundwater Demands Projected by Watermaster
ENC 3	8000073	Active	154.50	141.20	-13.30	Groundwater Demands Projected by Watermaster
PER 1	1902027	Active	182.60	159.60	-23.00	Groundwater Demands Projected by Watermaster
GRA 2	1902461	Inactive	201.70	184.10	-17.60	
FAR 1	1902034	Active	196.10	175.80	-20.30	Groundwater Demands Projected by Watermaster
FAR 2	1902948	Active	195.10	175.10	-20.00	Groundwater Demands Projected by Watermaster

WELL OR WELLFIELD	RECORDATION NUMBER	WELL STATUS	SIMULATED ELEVATION (1)		CHANGE (2) (FEET)	REMARKS
			2022-23	2027-28		
<b>GOULD ELECTRONICS INC. AND JOHNSON CONTROLS INC.</b>						
SEW	NA	Active	169.06	154.50	-14.56	Groundwater Demands Projected by Watermaster
<b>HANSON AGGREGATES WEST, INC. (LIVINGSTON-GRAHAM)</b>						
EL 4	1903006	Active	204.40	186.00	-18.40	Groundwater Demands Projected by Watermaster
EL 1	1901492	Active	205.20	186.50	-18.70	Groundwater Demands Projected by Watermaster
EL 3	1901493	Active	205.40	186.90	-18.50	Groundwater Demands Projected by Watermaster
<b>HEMLOCK MUTUAL WATER COMPANY</b>						
NORTH	1901178	Active	197.90	178.70	-19.20	Groundwater Demands Projected by Watermaster
SOUTH	1902806	Active	197.60	178.50	-19.10	Groundwater Demands Projected by Watermaster
<b>INDUSTRY WATERWORKS SYSTEM, CITY OF</b>						
01	1902581	Inactive	178.30	155.50	-22.80	
03	8000078	Inactive	178.30	155.50	-22.80	
04	8000096	Inactive	177.80	155.00	-22.80	
02	1902582	Inactive	178.90	156.10	-22.80	
05	8000097	Active	178.80	155.30	-23.50	BPOU Extraction Well Projected Groundwater Demands Provided by Producer
<b>LA PUENTE VALLEY COUNTY WATER DISTRICT</b>						
02	1901460	Active	194.50	171.30	-23.20	BPOU Extraction Well Projected Groundwater Demands Provided by Producer
04	8000062	Inactive	194.60	170.80	-23.80	
03	1902859	Active	195.20	171.50	-23.70	BPOU Extraction Well Projected Groundwater Demands Provided by Producer
05	8000209	Active	194.60	170.80	-23.80	BPOU Extraction Well Projected Groundwater Demands Provided by Producer
<b>LOS ANGELES, COUNTY OF</b>						
KEY WELL	3030F	Monitoring	205.40	190.10	-15.30	
WHI 1	1902579	Inactive	180.10	163.10	-17.00	
SF 1	8000070	Active	231.60	207.00	-24.60	Groundwater Demands Projected by Watermaster
BIG RED	8000088	Inactive	180.60	156.80	-23.80	
NEW LAKE	8000089	Inactive	180.00	162.60	-17.40	
<b>MILLERCOORS LLC (MILLER BREWERIES WEST, L.P./MILLER BREWING COMPANY)</b>						
01	8000075	Inactive	236.90	209.70	-27.20	
02	8000076	Active	241.20	211.20	-30.00	Groundwater Demands Projected by Watermaster
<b>MONROVIA, CITY OF</b>						
02	1900418	Active	199.20	180.50	-18.70	Projected Groundwater Demands Provided by Producer
03	1900419	Active	198.30	179.80	-18.50	Projected Groundwater Demands Provided by Producer
04	1900420	Active	202.70	181.60	-21.10	Projected Groundwater Demands Provided by Producer
05	1940104	Active	202.10	179.10	-23.00	Projected Groundwater Demands Provided by Producer
06	8000171	Active	197.10	178.60	-18.50	Projected Groundwater Demands Provided by Producer

WELL OR WELLFIELD	RECORDATION NUMBER	WELL STATUS	SIMULATED ELEVATION (1)		CHANGE (2) (FEET)	REMARKS
			2022-23	2027-28		
<b>PROGRESSIVE BUDDHIST ASSOCIATION</b>						
Progressive	8000228	Active	584.20	574.90	-9.30	
<b>MONTEREY PARK, CITY OF</b>						
01	1900453	Active	151.90	139.50	-12.40	Projected Groundwater Demands Provided by Producer
03	1900455	Inactive	148.50	139.30	-9.20	
05	1900457	Active	152.70	127.70	-25.00	Projected Groundwater Demands Provided by Producer
06	1900458	Inactive	155.80	138.90	-16.90	
07	1902372	Inactive	164.20	145.60	-18.60	
08	1902373	Inactive	165.60	146.60	-19.00	
09	1902690	Active	166.30	144.60	-21.70	Projected Groundwater Demands Provided by Producer
10	1902818	Active	132.70	129.40	-3.30	Projected Groundwater Demands Provided by Producer
12	1903033	Active	166.90	140.60	-26.30	Projected Groundwater Demands Provided by Producer
14	1903092	Inactive	164.80	145.50	-19.30	
FERN	8000126	Active	153.80	138.80	-15.00	Projected Groundwater Demands Provided by Producer
15	8000196	Active	169.40	148.00	-21.40	Projected Groundwater Demands Provided by Producer
<b>MOON VALLEY NURSERY (COINER, JAMES W., DBA COINER NURSERY)</b>						
03	1902951	Inactive	177.30	154.30	-23.00	
05R	1903072	Active	179.80	157.10	-22.70	Groundwater Demands Projected by Watermaster
<b>OWL ROCK PRODUCTS COMPANY</b>						
NA	1902241	Inactive	213.50	193.50	-20.00	
NA	1903119	Inactive	553.20	546.10	-7.10	Impact from Glendora Extraction
<b>POLOPOLUS ET AL.</b>						
01	1902169	Inactive	209.70	193.70	-16.00	
<b>RURBAN HOMES MUTUAL WATER COMPANY</b>						
NORTH 1	1900120	Active	196.00	178.40	-17.60	Groundwater Demands Projected by Watermaster
SOUTH 2	1900121	Inactive	195.50	178.00	-17.50	
<b>SAN GABRIEL COUNTRY CLUB</b>						
01	1900547	Active	133.10	124.30	-8.80	Impact from Alhambra Extraction Groundwater Demands Projected by Watermaster
<b>SAN GABRIEL COUNTY WATER DISTRICT</b>						
05 BRA	1901669	Inactive	147.90	135.30	-12.60	
08	1901672	Inactive	144.40	136.90	-7.50	
09	1902785	Active	136.90	127.70	-9.20	Projected Groundwater Demands Provided by Producer
10	1902786	Inactive	145.90	135.10	-10.80	
11	8000067	Active	147.60	135.30	-12.30	Projected Groundwater Demands Provided by Producer

WELL OR WELLFIELD	RECORDATION NUMBER	WELL STATUS	SIMULATED ELEVATION (1)		CHANGE (2) (FEET)	REMARKS
			2022-23	2027-28		
11D	8000226	Active	182.30	160.10	-22.20	Projected Groundwater Demands Provided by Producer
12	8000123	Active	147.10	133.70	-13.40	Projected Groundwater Demands Provided by Producer
14	8000133	Active	144.80	131.20	-13.60	Projected Groundwater Demands Provided by Producer
15	8000220	Active	134.10	121.20	-12.90	Projected Groundwater Demands Provided by Producer
<b>SAN GABRIEL VALLEY WATER COMPANY</b>						
G4A	1900725	Active	156.30	143.00	-13.30	Groundwater Demands Projected by Watermaster
B1	1902635	Inactive	181.60	158.40	-23.20	
B5A	1900718	Inactive	169.80	147.70	-22.10	BPOU Extraction Well
B5B	1900719	Active	169.80	147.70	-22.10	Projected Groundwater Demands Provided by Producer
B5C	8000112	Inactive	174.40	151.50	-22.90	
B5D	8000160	Active	169.80	147.70	-22.10	BPOU Extraction Well Projected Groundwater Demands Provided by Producer
B5E	8000205	Active	171.10	149.50	-21.60	BPOU Extraction Well Projected Groundwater Demands Provided by Producer
B25A	8000187	Active	183.80	166.40	-17.40	BPOU Extraction Well Projected Groundwater Demands Provided by Producer
B25B	8000188	Active	183.80	166.40	-17.40	BPOU Extraction Well Projected Groundwater Demands Provided by Producer
B26A	8000189	Active	192.20	167.90	-24.30	BPOU Extraction Well Projected Groundwater Demands Provided by Producer
B26B	8000190	Active	192.20	167.90	-24.30	BPOU Extraction Well Projected Groundwater Demands Provided by Producer
8A	1900736	Inactive	164.70	145.30	-19.40	
8B	1900746	Active	160.50	142.90	-17.60	SEMOU Extraction Well Projected Groundwater Demands Provided by Producer
8C	1900747	Active	150.50	136.80	-13.70	SEMOU Extraction Well Projected Groundwater Demands Provided by Producer
8D	1903103	Active	165.40	149.80	-15.60	SEMOU Extraction Well Projected Groundwater Demands Provided by Producer
8E	8000113	Active	150.50	136.80	-13.70	SEMOU Extraction Well Projected Groundwater Demands Provided by Producer
8F	8000169	Active	162.40	142.80	-19.60	SEMOU Extraction Well Projected Groundwater Demands Provided by Producer
1B	1900729	Active	190.60	173.60	-17.00	Groundwater Demands Projected by Watermaster
1C	1902946	Inactive	190.60	173.60	-17.00	
1D	8000102	Active	190.60	173.60	-17.00	Groundwater Demands Projected by Watermaster
1E	8000172	Active	190.90	173.80	-17.10	Groundwater Demands Projected by Watermaster
2D	1902857	Active	184.30	159.80	-24.50	Groundwater Demands Projected by Watermaster
2E	8000065	Active	177.20	156.90	-20.30	Groundwater Demands Projected by Watermaster
2F	8000197	Active	177.20	156.90	-20.30	Groundwater Demands Projected by Watermaster
11A	1900739	Active	182.30	160.20	-22.10	Groundwater Demands Projected by Watermaster

WELL OR WELLFIELD	RECORDATION NUMBER	WELL STATUS	SIMULATED ELEVATION (1)		CHANGE (2) (FEET)	REMARKS
			2022-23	2027-28		
11B	1900745	Active	182.30	160.10	-22.20	Groundwater Demands Projected by Watermaster
11C	1902713	Active	182.30	160.20	-22.10	Groundwater Demands Projected by Watermaster
B4B	1902858	Inactive	188.40	163.90	-24.50	
B4C	1902947	Inactive	188.40	163.90	-24.50	
B6C	1903093	Inactive	194.70	170.80	-23.90	
B6D	8000098	Inactive	194.70	170.80	-23.90	
B7E	8000122	Active	198.30	176.90	-21.40	Groundwater Demands Projected by Watermaster
B2	1902525	Inactive	181.50	158.40	-23.10	
B11A	1901439	Destroyed	196.50	173.40	-23.10	
B11B	8000108	Active	196.60	173.00	-23.60	Groundwater Demands Projected by Watermaster
B9B	8000099	Active	196.50	174.00	-22.50	Groundwater Demands Projected by Watermaster
B24A	8000203	Active	199.20	178.10	-21.10	BPOU Extraction Well Projected Groundwater Demands Provided by Producer
B24B	8000204	Active	198.70	177.40	-21.30	BPOU Extraction Well Projected Groundwater Demands Provided by Producer
<b>SIERRA LA VERNE COUNTRY CLUB</b>						
01	8000124	Inactive	1147.00	1128.00	-19.00	
<b>SONOCO PRODUCTS COMPANY</b>						
02	1902971	Inactive	185.70	163.70	-22.00	
02	8000137	Active	183.70	162.00	-21.70	Groundwater Demands Projected by Watermaster
<b>SOUTH PASADENA, CITY OF</b>						
GRAV 2	1901679	Inactive	150.80	143.50	-7.30	
WIL 2	1901681	Inactive	140.30	134.70	-5.60	
WIL 3	1901682	Active	135.20	134.10	-1.10	Projected Groundwater Demands Provided by Producer
WIL 4	1903086	Active	137.10	134.60	-2.50	Projected Groundwater Demands Provided by Producer
<b>SOUTHERN CALIFORNIA EDISON COMPANY</b>						
110RH	8000046	Active	208.40	190.00	-18.40	Groundwater Demands Projected by Watermaster
<b>STERLING MUTUAL WATER COMPANY</b>						
NEW SO.	8000132	Active	188.20	163.30	-24.90	Groundwater Demands Projected by Watermaster
NORTH	1902096	Active	188.20	163.30	-24.90	Groundwater Demands Projected by Watermaster
<b>SUBURBAN WATER SYSTEMS</b>						
121W-1	8000181	Active	200.20	179.40	-20.80	Projected Groundwater Demands Provided by Producer
125W-2	8000087	Inactive	216.00	200.90	-15.10	
126W-2	8000092	Inactive	217.70	202.30	-15.40	
139W-2	1901599	Inactive	201.00	177.90	-23.10	
139W-4	8000069	Standby	201.00	177.80	-23.20	
139W-5	8000095	Inactive	200.90	177.70	-23.20	
139W-6	8000152	Inactive	200.80	177.90	-22.90	
140W-3	1903067	Standby	195.60	172.50	-23.10	
140W-4	8000093	Inactive	195.60	172.50	-23.10	
140W-5	8000145	Active	195.50	172.30	-23.20	Projected Groundwater Demands Provided by Producer



WELL OR WELLFIELD	RECORDATION NUMBER	WELL STATUS	SIMULATED ELEVATION (1)		CHANGE (2) (FEET)	REMARKS
			2022-23	2027-28		
142W-2	8000183	Active	198.00	175.80	-22.20	Projected Groundwater Demands Provided by Producer
151W-2	8000207	Active	197.50	175.40	-22.10	Projected Groundwater Demands Provided by Producer
155W-1	1902819	Inactive	280.70	273.20	-7.50	
201W-9	8000208	Active	175.50	157.30	-18.20	Projected Groundwater Demands Provided by Producer
201W-4	1901433	Inactive	178.90	161.10	-17.80	
201W-7	8000195	Active	174.90	155.50	-19.40	Projected Groundwater Demands Provided by Producer
201W-8	8000198	Active	177.40	157.90	-19.50	Projected Groundwater Demands Provided by Producer
201W-10	8000210	Active	178.20	159.90	-18.30	Projected Groundwater Demands Provided by Producer
<b>TRAN,HIEU</b>						
TRAN	8000218	Active	531.20	522.70	-8.50	
<b>SUNNY SLOPE WATER COMPANY</b>						
08	1900026	Active	154.40	137.90	-16.50	Groundwater Demands Projected by Watermaster
09	1902792	Active	153.20	137.30	-15.90	Groundwater Demands Projected by Watermaster
10	8000048	Inactive	156.10	146.60	-9.50	
13	8000157	Active	141.30	129.40	-11.90	Groundwater Demands Projected by Watermaster
<b>TYLER NURSERY</b>						
NA	8000049	Inactive	180.30	157.70	-22.60	
<b>UNITED ROCK PRODUCTS CORPORATION</b>						
IRW-1	1900106	Active	215.80	193.90	-21.90	Groundwater Demands Projected by Watermaster
IRW-2	1903062	Active	215.20	193.70	-21.50	Groundwater Demands Projected by Watermaster
<b>UNITED STATES ENVIRONMENTAL PROTECTION AGENCY</b>						
EW4-3	EPAEW403	Remedial	181.10	163.70	-17.40	WNOU Extraction (Inactive)
EW4-4	EPAEW404	Remedial	180.90	163.40	-17.50	WNOU Extraction (Inactive)
EW4-5	EPAEW405	Remedial	180.50	163.10	-17.40	WNOU Extraction (Active) Groundwater Demands Projected by Watermaster
EW4-9	EPAEW409	Remedial	180.50	163.10	-17.40	WNOU Extraction (Inactive)
EW4-6	8000201	Remedial	180.20	162.70	-17.50	WNOU Extraction (Active) Groundwater Demands Projected by Watermaster
EW4-7	EPAEW407	Remedial	180.90	163.40	-17.50	WNOU Extraction (Active) Groundwater Demands Projected by Watermaster
EW4-8	EPAEW408	Remedial	181.20	163.80	-17.40	WNOU Extraction (Inactive)
<b>VALENCIA HEIGHTS WATER COMPANY</b>						
01	8000051	Inactive	223.10	206.40	-16.70	
02	8000052	Inactive	223.10	206.40	-16.70	
03A	8000055	Inactive	233.20	214.10	-19.10	
04	8000054	Inactive	218.70	202.60	-16.10	
05	8000120	Active	233.90	214.00	-19.90	Projected Groundwater Demands Provided by Producer
06	8000180	Active	222.20	204.60	-17.60	Projected Groundwater Demands Provided by Producer
07	8000211	Active	235.30	215.60	-19.70	Projected Groundwater Demands Provided by Producer

WELL OR WELLFIELD	RECORDATION NUMBER	WELL STATUS	SIMULATED ELEVATION (1)		CHANGE (2) (FEET)	REMARKS
			2022-23	2027-28		

**VALLEY COUNTY WATER DISTRICT**

E MAINE	1900027	Active	209.80	195.20	-14.60	Projected Groundwater Demands Provided by Producer and Adjusted by Watermaster
W MAINE	1900028	Active	209.80	195.20	-14.60	Projected Groundwater Demands Provided by Producer and Adjusted by Watermaster
MORADA	1900029	Inactive	219.90	204.40	-15.50	
E NIXON (JOAN)	1900032	Active	210.60	195.10	-15.50	Projected Groundwater Demands Provided by Producer and Adjusted by Watermaster
W NIXON (JOAN)	1902356	Active	211.00	195.00	-16.00	Projected Groundwater Demands Provided by Producer and Adjusted by Watermaster
ARROW	1900034	Inactive	210.20	195.40	-14.80	BPOU Extraction
LANTE (SA1-3)	8000060	Active	211.40	195.60	-15.80	Projected Groundwater Demands Provided by Producer and Adjusted by Watermaster
PALM	8000039	Inactive	201.50	186.30	-15.20	
B DALTON	1900035	Inactive	201.10	176.90	-24.20	
PADDY LN	1900031	Inactive	197.40	173.00	-24.40	
SA1-1	8000185	Active	216.20	199.40	-16.80	BPOU Extraction Projected Groundwater Demands Provided by Producer and Adjusted by Watermaster
SA1-2	8000186	Standby	212.90	196.90	-16.00	BPOU Extraction Projected Groundwater Demands Provided by Producer and Adjusted by Watermaster

**VALLEY VIEW MUTUAL WATER COMPANY**

01	1900363	Inactive	204.00	187.00	-17.00	
02	1900364	Active	204.00	187.00	-17.00	Projected Groundwater Demands Provided by Producer

**VULCAN MATERIALS COMPANY (CALMAT COMPANY)**

REL 1	1903088	Active	237.00	210.50	-26.50	Groundwater Demands Projected by Watermaster
-------	---------	--------	--------	--------	--------	--

**WHITTIER, CITY OF**

13	1901749	Active	179.50	162.40	-17.10	Groundwater Demands Projected by Watermaster
15	8000071	Active	179.80	162.70	-17.10	Groundwater Demands Projected by Watermaster
16	8000110	Active	179.40	162.00	-17.40	Groundwater Demands Projected by Watermaster
17	8000135	Active	179.50	162.20	-17.30	Groundwater Demands Projected by Watermaster
18	8000136	Active	179.80	162.30	-17.50	Groundwater Demands Projected by Watermaster

**WORKMAN MILL INVESTMENT COMPANY (RINCON DITCH COMPANY)**

04	1902790	Inactive	180.10	163.10	-17.00	
----	---------	----------	--------	--------	--------	--

**WORKMAN MILL INVESTMENT COMPANY (RINCON IRRIGATION COMPANY)**

02	1900095	Inactive	179.90	162.90	-17.00	
----	---------	----------	--------	--------	--------	--

**WORKMAN MILL INVESTMENT COMPANY (ROSE HILLS MEMORIAL PARK)**

03	1900052	Inactive	180.00	162.90	-17.10	
01	1900094	Inactive	180.30	163.50	-16.80	

<b>AVERAGE CHANGE</b>					<b>-18.00</b>	
-----------------------	--	--	--	--	---------------	--

(1) SIMULATED ELEVATION IN FEET ABOVE MEAN SEA LEVEL  
(2) DIFFERENCE BETWEEN 2025-26 AND 2020-21 SIMULATED ELEVATIONS

---

## **APPENDIX C.**

# **HIGHLIGHTS OF VOLATILE ORGANIC COMPOUNDS AND NITRATE CONCENTRATIONS AND WELLS VULNERABLE TO CONTAMINATION**



## APPENDIX C

### HIGHLIGHTS OF VOLATILE ORGANIC COMPOUNDS, NITRATE, AND PERCHLORATE CONCENTRATIONS AND WELLS VULNERABLE TO CONTAMINATION (AS OF DECEMBER 31, 2022)

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE	DATE	
<b>9447 SAN GABRIEL CANYON LLC (VIETNAMESE AMERICAN BUDDHIST CONGREGATION TEMPLE)</b>								
VIETNAMESE TEMPLE	IRRIGATION	ACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>ADAMS RANCH MUTUAL WATER COMPANY</b>								
01	MUNICIPAL	INACTIVE	TCE	2.2	05/88	ND	02/97	
			NITRATE (N)	21.9	04/92	8.8	02/97	
			CLO4	NA	NA	NA	NA	
02	MUNICIPAL	INACTIVE	TCE	3.5	08/86	2.5	09/86	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
03	MUNICIPAL	INACTIVE	TCE	22.0	05/15	14.0	02/16	
			PCE	10.0	05/15	6.6	02/16	
			NITRATE (N)	4.7	03/04	4.5	05/15	
			CLO4	ND	08/08	ND	02/16	
			AS	ND	05/03	ND	05/15	
			CR6	1.1	08/13	1.1	08/13	
<b>ALHAMBRA, CITY OF</b>								
07	MUNICIPAL	INACTIVE	TCE	14.0	04/18	14.0	04/18	VULNERABLE (VOC,NO3(N))
			PCE	0.8	04/07	0.6	04/18	
			C-1,2-DCE	2.0	04/18	2.0	04/18	
			CTC	0.6	02/85	ND	04/18	
			NITRATE (N)	12.0	04/18	12.0	04/18	
			CLO4	2.4	10/07	ND	04/18	
			AS	0.7	07/96	ND	05/17	
			CR6	9.0	07/01	8.3	05/17	
09	MUNICIPAL	STANDBY	TCE	21.1	08/08	6.4	12/22	VULNERABLE (VOC, NO3(N),CLO4)
			C-1,2-DCE	2.3	10/07	ND	10/22	
			NITRATE (N)	14.0	12/16	11.0	12/22	
			CLO4	4.7	02/14	3.8	12/22	
			AS	0.9	07/96	ND	01/20	
			CR6	5.7	12/05	4.0	01/20	
10	IRRIGATION	INACTIVE	TCE	30.1	02/09	22.0	10/10	
			C-1,2-DCE	5.8	03/05	ND	10/10	
			1,1-DCE	0.5	03/05	ND	10/10	
			NITRATE (N)	12.7	01/07	12.4	10/10	
			CLO4	ND	08/97	ND	08/97	
11	MUNICIPAL	ACTIVE	PCE	4.7	05/12	3.2	12/22	VULNERABLE (VOC,NO3(N))
			TCE	4.2	05/89	0.7	12/22	
			C-1,2-DCE	1.5	04/08	ND	07/22	
			NITRATE (N)	10.8	10/12	8.0	12/22	
			CLO4	ND	08/97	ND	04/22	
			AS	0.8	07/96	ND	04/21	
12	MUNICIPAL	STANDBY	TCE	39.4	08/08	20.0	08/21	VULNERABLE (VOC,NO3(N))
			PCE	2.1	04/21	1.1	10/21	
			C-1,2-DCE	41.0	05/17	31.0	08/21	
			1,1-DCE	1.0	04/21	0.8	10/21	
			T-1,2-DCE	0.9	09/08	0.8	10/21	
			NITRATE (N)	9.5	01/14	5.4	07/20	
			CLO4	ND	08/08	ND	04/21	
			AS	ND	08/89	ND	07/20	
			CR6	4.5	09/17	3.5	07/20	
			13	IRRIGATION	ACTIVE	TCE	0.5	
NITRATE (N)	13.3	07/13				13.3	07/13	
CLO4	ND	03/97				ND	01/14	
AS	8.0	06/78				ND	11/10	
CR6	7.1	08/01				4.6	09/13	
14	MUNICIPAL	ACTIVE	TCE	2.4	08/08	1.0	10/19	VULNERABLE (NO3(N))
			NITRATE (N)	10.4	08/12	2.8	10/19	
			CLO4	ND	08/97	ND	04/19	
			AS	0.6	07/96	ND	10/19	
			CR6	5.8	06/01	4.9	10/19	
15	MUNICIPAL	ACTIVE	PCE	0.8	10/14	0.5	12/22	VULNERABLE

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)				REMARKS	
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE		DATE
			NITRATE (N)	6.3	10/12	3.0	12/22	(NO3(N))
			CLO4	ND	08/97	ND	04/22	
			AS	1.5	07/96	ND	04/22	
			CR6	4.1	12/00	3.4	04/22	
GARF	MUNICIPAL	INACTIVE	TCE	11.0	08/82	ND	09/93	
			PCE	0.5	11/87	ND	09/93	
			CTC	0.1	04/80	ND	09/93	
			1,1,2,2-PCA	1.0	11/87	ND	09/93	
			NITRATE (N)	15.4	08/89	12.1	09/93	
			AS	ND	06/80	ND	08/92	
			CLO4	NA	NA	NA	NA	
LON 1	MUNICIPAL	ACTIVE	PCE	0.6	11/22	0.5	12/22	VULNERABLE
			NITRATE (N)	7.5	09/11	6.2	12/22	(NO3(N),CLO4)
			CLO4	5.0	12/97	ND	04/22	
			AS	2.4	07/95	ND	04/22	
			CR6	7.2	06/01	7.2	04/22	
LON 2	MUNICIPAL	ACTIVE	PCE	1.3	06/10	1.0	12/22	VULNERABLE
			NITRATE (N)	11.4	04/86	6.0	12/22	(NO3(N),CLO4)
			CLO4	5.6	07/97	ND	09/22	
			AS	0.8	07/96	ND	05/20	
			CR6	9.5	06/01	8.6	05/20	
MOEL (8)	MUNICIPAL	ACTIVE	TCE	23.0	07/14	10.0	12/22	VULNERABLE
			PCE	1.6	07/08	0.8	12/22	(VOC,NO3(N))
			C-1,2-DCE	2.9	10/20	1.7	10/22	
			NITRATE (N)	17.2	07/08	5.3	12/22	
			CLO4	ND	12/99	ND	04/22	
			AS	0.9	07/96	ND	07/20	
			CR6	7.2	07/17	6.1	07/20	
<b>AMARILLO MUTUAL WATER COMPANY</b>								
01 (SOUTH)	MUNICIPAL	ACTIVE	PCE	5.5	10/99	2.9	01/20	VULNERABLE
			TCE	3.3	11/18	0.7	01/20	(VOC,NO3(N))
			CTC	0.1	08/82	ND	01/20	
			NITRATE (N)	6.2	10/99	3.6	01/20	
			CLO4	ND	08/97	ND	01/20	
			AS	0.5	07/96	ND	08/19	
			CR6	8.6	08/16	5.5	08/19	
02 (NORTH)	MUNICIPAL	INACTIVE	PCE	6.3	08/16	5.7	11/19	VULNERABLE
			TCE	3.1	05/18	2.6	11/19	(VOC,NO3(N))
			NITRATE (N)	6.8	02/96	4.9	11/19	
			CLO4	ND	08/97	ND	08/19	
			AS	0.4	07/96	ND	08/19	
			CR6	8.7	08/19	8.7	08/19	
<b>ANDERSON FAMILY MARITAL TRUST</b>								
01	DOMESTIC	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>ARCADIA, CITY OF</b>								
BAL 1	MUNICIPAL	DESTROYED	VOCS	ND	09/98	ND	09/98	
			NITRATE (N)	11.7	04/78	0.7	09/98	
			CLO4	NA	NA	NA	NA	
BAL 2	MUNICIPAL	INACTIVE	VOCS	ND	05/89	ND	06/09	
			NITRATE (N)	7.5	05/08	6.3	06/09	
			CLO4	ND	08/97	ND	07/08	
			AS	0.7	08/96	ND	03/09	
			CR6	11.1	06/01	11.1	06/01	
CAM REAL 1	MUNICIPAL	DESTROYED	VOCS	ND	01/85	ND	05/92	
			NITRATE (N)	6.3	05/91	5.1	08/92	
			CLO4	NA	NA	NA	NA	
			AS	ND	03/09	ND	08/92	
CAM REAL 2	MUNICIPAL	DESTROYED	VOCS	ND	05/89	ND	06/98	
			NITRATE (N)	13.1	05/92	8.8	05/98	
			CLO4	ND	08/97	ND	12/97	
			AS	0.4	08/96	ND	06/98	
CAM REAL 3	MUNICIPAL	ACTIVE	VOCS	ND	03/11	ND	10/22	
			NITRATE (N)	4.6	04/21	3.9	10/22	
			CLO4	2.5	04/22	2.4	10/22	
			AS	ND	03/10	ND	01/22	
			CR6	8.3	01/19	7.8	01/22	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE	DATE	
L OAK 1	MUNICIPAL	ACTIVE	PCE	1.4	01/08	ND	04/22	VULNERABLE (VOC.NO3(N))
			TCE	10.0	07/18	3.9	10/22	
			NITRATE (N)	7.0	05/15	4.0	10/22	
			CLO4	ND	08/97	ND	04/22	
			AS	0.6	08/96	ND	06/21	
			CR6	4.2	06/21	4.2	06/21	
LGY	MUNICIPAL	DESTROYED	VOCS	ND	01/08	ND	01/08	
			NITRATE (N)	23.5	01/08	23.5	01/08	
			CLO4	6.0	01/08	6.0	01/08	
LGY 3	MUNICIPAL	ACTIVE	VOCS	ND	06/11	ND	10/22	
			NITRATE (N)	2.4	01/20	2.1	01/22	
			CLO4	ND	06/11	ND	01/22	
			AS	ND	03/11	ND	01/20	
			CR6	8.7	01/17	8.1	01/20	
LON 1	MUNICIPAL	ACTIVE	TCE	30.0	07/87	0.7	12/22	VULNERABLE (VOC.NO3(N))
			PCE	3.1	04/19	ND	12/22	
			1,1-DCE	4.1	06/87	ND	07/22	
			1,2-DCA	1.4	07/87	ND	07/22	
			1,1,1-TCA	4.6	07/87	ND	07/22	
			NITRATE (N)	14.0	07/16	9.3	12/22	
			CLO4	ND	12/97	ND	04/22	
			AS	ND	04/85	ND	04/20	
			CR6	3.3	06/17	1.5	04/20	
LON 2	MUNICIPAL	ACTIVE	TCE	62.0	01/85	0.8	12/22	VULNERABLE (VOC.NO3(N))
			PCE	7.7	01/82	ND	12/22	
			CTC	2.6	09/87	ND	07/22	
			1,1-DCE	0.9	05/87	ND	07/22	
			1,1,1-TCA	12.0	01/85	ND	07/22	
			NITRATE (N)	24.6	05/85	13.0	12/22	
			CLO4	2.9	10/22	2.9	10/22	
			AS	0.7	08/96	ND	01/22	
			CR6	5.5	01/22	5.5	01/22	
PECK 1	MUNICIPAL	ACTIVE	VOCS	ND	05/89	ND	04/22	
			NITRATE (N)	2.5	08/09	0.6	04/22	
			CLO4	ND	08/97	ND	04/22	
			AS	2.4	09/94	ND	04/20	
			CR6	1.0	11/00	ND	04/20	
ST JO 1	MUNICIPAL	DESTROYED	TCE	5.4	01/02	4.8	02/02	
			PCE	2.7	08/91	2.2	02/02	
			NITRATE (N)	13.6	06/96	10.4	06/02	
			CLO4	1.0	08/97	ND	01/02	
			AS	0.3	08/96	ND	06/01	
ST JO 2	MUNICIPAL	INACTIVE	TCE	2.4	12/09	1.1	07/17	
			PCE	9.8	09/16	7.8	07/17	
			NITRATE (N)	11.5	12/04	10.0	07/17	
			CLO4	8.6	06/02	ND	07/17	
			AS	ND	06/02	ND	04/17	
			CR6	3.2	11/02	2.6	04/17	
<b>ARCADIA RECLAMATION</b>								
NA	INDUSTRIAL	ACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>ATTALLA, MARY L.</b>								
NA	IRRIGATION	INACTIVE	VOCS	ND	09/96	ND	04/98	
			NITRATE (N)	4.4	04/98	4.4	04/98	
			CLO4	ND	04/98	ND	04/98	
<b>AZUSA ASSOCIATES LLC</b>								
DALTON	IRRIGATION	INACTIVE	VOCS	ND	03/98	ND	03/98	
			NITRATE (N)	1.1	03/98	1.1	03/98	
			CLO4	ND	03/98	ND	03/98	
<b>AZUSA, CITY OF</b>								
AVWC 01	MUNICIPAL	DESTROYED	VOCS	ND	09/97	ND	09/97	
			NITRATE (N)	12.4	08/87	7.3	09/97	
			CLO4	5.6	09/97	5.6	09/97	
AVWC 02	MUNICIPAL	DESTROYED	VOCS	ND	01/98	ND	01/98	
			NITRATE (N)	9.7	01/98	9.7	01/98	
			CLO4	6.9	01/98	6.9	01/98	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE	DATE	
AVWC 07	MUNICIPAL	DESTROYED	TCE	4.5	01/80	ND	03/85	
			NITRATE (N)	24.2	02/77	8.9	12/85	
			CLO4	NA	NA	NA	NA	
GENESIS 1 (OLD 04)	MUNICIPAL	DESTROYED	MTBE	1.2	11/98	1.1	11/98	
			NITRATE (N)	28.6	06/87	24.8	11/98	
			CLO4	7.2	11/98	7.2	11/98	
			AS	5.0	08/79	ND	02/88	
GENESIS 2 (OLD 05)	MUNICIPAL	INACTIVE	TCE	250.0	12/79	3.7	02/08	
			PCE	95.0	04/80	1.0	02/08	
			1,1-DCE	18.0	02/08	18.0	02/08	
			1,1,1-TCA	2.5	02/08	2.5	02/08	
			NITRATE (N)	23.8	02/93	3.6	02/08	
			CLO4	ND	11/98	ND	02/08	
			AS	ND	12/89	ND	02/08	
GENESIS 3 (OLD 06)	MUNICIPAL	DESTROYED	PCE	3.5	03/97	ND	03/97	
			TCE	0.1	01/80	ND	03/97	
			NITRATE (N)	25.5	06/86	ND	04/01	
			CLO4	NA	NA	NA	NA	
01 (OLD 07)	MUNICIPAL	ACTIVE	VOCS	ND	06/87	ND	11/22	VULNERABLE (AS)
			NITRATE (N)	1.2	08/17	0.5	12/22	
			CLO4	ND	07/97	ND	08/22	
			AS	5.1	08/95	2.3	08/22	
			CR6	1.0	11/00	0.1	08/22	
02 (01 NORTH)	MUNICIPAL	ACTIVE	VOCS	ND	06/89	ND	08/22	
			NITRATE (N)	1.2	03/92	0.5	12/22	
			CLO4	ND	07/97	ND	08/22	
			AS	4.3	07/96	3.6	08/20	
			CR6	1.0	11/00	ND	08/20	
03 (OLD 08)	MUNICIPAL	ACTIVE	VOCS	ND	06/87	ND	08/22	
			NITRATE (N)	1.0	03/95	ND	12/22	
			CLO4	ND	07/97	ND	08/22	
			AS	5.0	08/06	3.5	08/18	
			CR6	1.0	11/00	ND	08/18	
04 (02 SOUTH)	MUNICIPAL	ACTIVE	VOCS	ND	06/88	ND	08/22	
			NITRATE (N)	1.2	06/89	ND	12/22	
			CLO4	ND	07/97	ND	08/22	
			AS	5.0	08/05	3.5	08/20	
			CR6	1.0	11/00	ND	08/20	
05 (OLD 01)	MUNICIPAL	ACTIVE	TCE	1.0	12/80	ND	05/22	VULNERABLE (NO3(N))
			PCE	0.3	12/80	ND	05/22	
			NITRATE (N)	5.2	07/95	1.3	05/22	
			CLO4	ND	07/97	ND	05/22	
			AS	2.6	07/95	ND	05/22	
			CR6	1.0	11/00	0.2	05/22	
06 (OLD 03)	MUNICIPAL	ACTIVE	VOCS	ND	03/85	ND	08/22	
			NITRATE (N)	3.2	03/95	1.9	08/22	
			CLO4	ND	07/97	ND	08/22	
			AS	3.5	07/95	1.4	08/22	
			CR6	1.0	11/00	0.1	08/22	
07 (AVWC 05)	MUNICIPAL	ACTIVE	VOCS	ND	06/88	ND	08/22	VULNERABLE (NO3(N))
			NITRATE (N)	5.6	04/95	0.6	12/22	
			CLO4	ND	06/97	ND	08/22	
			AS	3.5	08/14	ND	08/20	
			CR6	1.0	11/00	ND	08/20	
08 (AVWC 04)	MUNICIPAL	ACTIVE	TCE	0.8	03/94	ND	08/22	
			NITRATE (N)	2.7	09/94	0.9	08/22	
			CLO4	ND	07/97	ND	08/22	
			AS	4.2	07/95	2.5	08/22	
			CR6	1.0	11/00	0.2	08/22	
09 (AVWC 06)	MUNICIPAL	INACTIVE	PCE	7.4	12/87	0.6	01/99	
			NITRATE (N)	26.6	12/89	19.0	01/99	
			CLO4	NA	NA	NA	NA	
			AS	ND	02/87	ND	01/99	
10 (AVWC 08)	MUNICIPAL	ACTIVE	PCE	1.2	05/15	ND	11/22	VULNERABLE (NO3(N))
			NITRATE (N)	14.9	05/08	10.0	11/22	
			CLO4	12.6	08/05	6.5	11/22	
			AS	1.8	07/96	ND	11/21	
			CR6	2.6	11/18	2.4	11/21	
11	MUNICIPAL	ACTIVE	VOCS	ND	06/02	ND	08/22	



WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS				
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT						
				VALUE	DATE	VALUE	DATE					
12	MUNICIPAL	ACTIVE	NITRATE (N)	0.8	08/08	0.5	08/22					
			CLO4	ND	06/02	ND	08/22					
			AS	4.0	08/05	2.7	08/20					
			CR6	0.2	08/13	ND	08/20					
			VOCS	ND	06/02	ND	08/22					
			NITRATE (N)	0.9	08/08	0.4	08/22					
			CLO4	ND	06/02	ND	08/22					
			AS	4.0	08/05	3.2	08/20					
			CR6	0.5	08/13	ND	08/20					
			<b>B &amp; B RED-I-MIX CONCRETE INC.</b>									
			03	INDUSTRIAL	INACTIVE	VOCS	NA		NA	NA	NA	
						NITRATE (N)	NA		NA	NA	NA	
CLO4	NA	NA				NA	NA					
<b>BANKS, GALE &amp; VICKI</b>												
NA	IRRIGATION	ACTIVE	VOCS	ND	08/96	ND	11/20					
			NITRATE (N)	4.7	10/98	4.1	11/20					
			CLO4	ND	09/97	ND	09/97					
<b>BASELINE WATER COMPANY</b>												
01	IRRIGATION	DESTROYED	VOCS	ND	02/98	ND	02/98					
			NITRATE (N)	22.5	02/98	22.5	02/98					
			CLO4	12.9	02/98	12.9	02/98					
02	IRRIGATION	DESTROYED	VOCS	ND	11/98	ND	11/98					
			NITRATE (N)	16.8	11/98	16.8	11/98					
			CLO4	10.6	11/98	10.6	11/98					
03	IRRIGATION	DESTROYED	VOCS	NA	NA	NA	NA					
			NITRATE (N)	NA	NA	NA	NA					
			CLO4	NA	NA	NA	NA					
<b>BEVERLY ACRES MUTUAL WATER USERS ASSOCIATION</b>												
ROSE HILLS	MUNICIPAL	DESTROYED	TCE	8.4	10/88	2.5	03/93					
			PCE	6.0	10/88	2.8	03/93					
			C-1,2-DCE	8.0	08/86	2.4	03/93					
			NITRATE (N)	5.1	08/86	3.3	09/90					
			CLO4	NA	NA	NA	NA					
			AS	ND	09/89	ND	08/91					
<b>BIRENBAUM, MAX</b>												
NA	NON-POTABLE	INACTIVE	VOCS	NA	NA	NA	NA					
			NITRATE (N)	NA	NA	NA	NA					
			CLO4	NA	NA	NA	NA					
<b>BOTELLO WATER COMPANY</b>												
NA	MUNICIPAL	INACTIVE	VOCS	NA	NA	NA	NA					
			CLO4	NA	NA	NA	NA					
<b>BURBANK DEVELOPMENT COMPANY</b>												
BURB	NON-POTABLE	INACTIVE	VOCS	NA	NA	NA	NA					
			NITRATE (N)	NA	NA	NA	NA					
			CLO4	NA	NA	NA	NA					
<b>CALIFORNIA-AMERICAN WATER COMPANY/DUARTE SYSTEM</b>												
B V	MUNICIPAL	STANDBY	VOCS	ND	02/85	ND	02/22	VULNERABLE (AS)				
			NITRATE (N)	0.9	10/10	0.8	08/22					
			CLO4	ND	06/97	ND	02/22					
			AS	6.0	07/93	2.0	08/22					
			CR6	1.0	12/00	0.1	08/22					
			VOCS	ND	03/12	ND	02/22					
B V 2	MUNICIPAL	ACTIVE	NITRATE (N)	1.0	08/22	1.0	08/22					
			CLO4	ND	09/12	ND	05/22					
			AS	2.1	08/19	2.0	08/22					
			CR6	1.0	04/11	0.1	08/22					
			VOCS	ND	09/15	ND	05/22					
			NITRATE (N)	2.3	10/81	1.1	08/22					
BACON	MUNICIPAL	ACTIVE	CLO4	ND	06/97	ND	05/22	VULNERABLE (AS)				
			AS	6.0	09/93	1.6	08/22					
			CR6	0.5	08/22	0.5	08/22					
			VOCS	ND	06/88	ND	02/22					
			NITRATE (N)	0.9	10/10	0.8	08/22					
CR HV	MUNICIPAL	ACTIVE	CLO4	ND	06/97	ND	05/22					
			AS	6.0	09/93	1.6	08/22					
			CR6	0.5	08/22	0.5	08/22					
			VOCS	ND	06/88	ND	02/22					
			NITRATE (N)	0.9	10/10	0.8	08/22					

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)				REMARKS	
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE		DATE
ENCANTO	MUNICIPAL	ACTIVE	NITRATE (N)	2.5	03/19	1.2	08/22	
			CLO4	ND	06/97	ND	05/22	
			AS	3.0	09/04	1.8	08/22	
			CR6	1.0	12/00	0.3	08/22	
			VOCS	ND	12/92	ND	02/22	
ENCANTO	MUNICIPAL	ACTIVE	NITRATE (N)	2.6	12/92	0.7	08/22	
			CLO4	ND	06/97	ND	05/22	
			AS	4.6	08/95	3.2	08/22	
			CR6	1.0	12/00	0.2	08/22	
			VOCS	ND	12/92	ND	02/22	
FISH C	MUNICIPAL	INACTIVE	VOCS	ND	02/85	ND	03/14	
			NITRATE (N)	1.5	11/94	0.6	12/13	
			CLO4	ND	06/97	ND	09/14	
			AS	13.0	09/80	ND	10/10	
			CR6	1.0	12/00	0.1	03/13	
LAS L	MUNICIPAL	DESTROYED	VOCS	ND	02/85	ND	06/91	
			NITRATE (N)	2.7	08/80	0.9	09/91	
			CLO4	NA	NA	NA	NA	
			AS	18.0	06/78	NA	11/94	
LAS L2	MUNICIPAL	ACTIVE	TCE	1.6	08/96	ND	02/22	
			NITRATE (N)	3.7	12/92	1.0	08/22	
			CLO4	ND	06/97	ND	05/22	
			AS	3.1	08/95	1.8	08/22	
			CR6	1.0	06/01	0.4	08/22	
LEMON	MUNICIPAL	ACTIVE	VOCS	ND	11/19	ND	02/22	
			NITRATE (N)	4.7	12/21	3.6	11/22	
			CLO4	ND	08/19	ND	11/22	
			AS	2.1	02/22	2.1	02/22	
			CR6	0.9	02/22	0.9	02/22	
MT AVE	MUNICIPAL	DESTROYED	TCE	16.5	07/87	ND	09/93	
			PCE	1.0	08/82	ND	09/93	
			1,1,1-TCA	8.4	04/85	ND	09/93	
			1,1-DCE	3.4	07/87	ND	09/93	
			T-1,2-DCE	2.0	04/85	ND	09/93	
			NITRATE (N)	14.7	05/89	2.3	09/93	
			CLO4	NA	NA	NA	NA	
			AS	ND	05/89	ND	05/89	
			AS	ND	05/89	ND	05/89	
STA FE	MUNICIPAL	ACTIVE	TCE	3.3	04/84	ND	06/22	VULNERABLE (VOC)
			NITRATE (N)	1.6	03/82	1.0	06/22	
			CLO4	ND	06/97	ND	06/22	
			AS	3.0	08/79	2.1	06/22	
			CR6	1.0	12/00	0.4	06/22	
WILEY	MUNICIPAL	ACTIVE	VOCS	ND	09/01	ND	02/22	
			NITRATE (N)	2.5	03/81	1.7	08/22	
			CLO4	ND	06/97	ND	05/22	
			AS	2.0	09/09	1.6	08/22	
			CR6	1.0	12/00	0.2	08/22	
<b>CALIFORNIA-AMERICAN WATER COMPANY/SAN MARINO SYSTEM</b>								
BR 1	MUNICIPAL	DESTROYED	CTC	0.5	12/96	0.5	12/96	
			TCE	27.0	07/93	27.0	12/96	
			PCE	9.0	07/93	7.7	12/96	
			NITRATE (N)	7.1	12/96	7.1	12/96	
			CLO4	NA	NA	NA	NA	
BR 2	MUNICIPAL	DESTROYED	AS	1.0	03/81	ND	10/81	
			TCE	17.0	12/96	17.0	12/96	
			PCE	6.4	12/96	6.4	12/96	
			NITRATE (N)	5.7	07/93	5.7	12/96	
			CLO4	NA	NA	NA	NA	
DELMAR	MUNICIPAL	ACTIVE	AS	ND	03/81	ND	10/81	
			VOCS	ND	06/88	ND	02/22	
			NITRATE (N)	5.3	11/22	5.3	11/22	
			CLO4	ND	06/97	ND	11/22	
			AS	5.0	07/96	3.1	05/22	
DELMAR	MUNICIPAL	ACTIVE	CR6	13.0	07/19	4.9	05/22	VULNERABLE (NO3(N))
			TCE	4.8	03/07	2.6	11/22	
			PCE	2.6	05/20	1.6	11/22	
			NITRATE (N)	2.5	09/03	1.8	05/22	
			CLO4	ND	08/97	ND	05/22	
GRAND	MUNICIPAL	ACTIVE	AS	0.4	07/96	ND	05/22	VULNERABLE (VOC)
			AS	0.4	07/96	ND	05/22	
			CR6	11.0	02/22	9.7	11/22	
			CLO4	ND	08/97	ND	05/22	
			NITRATE (N)	2.5	09/03	1.8	05/22	
GUESS	MUNICIPAL	DESTROYED	TCE	5.2	09/99	5.2	12/01	
			AS	2.0	09/09	1.6	08/22	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE	DATE	
			PCE	5.4	12/01	5.4	12/01	
			NITRATE (N)	4.5	05/01	4.3	09/01	
			CLO4	ND	08/97	ND	03/00	
			AS	0.4	07/96	ND	02/01	
			CR6	7.8	10/00	4.8	06/01	
HALL	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
HALL 2	MUNICIPAL	ACTIVE	VOCS	ND	03/01	ND	02/22	VULNERABLE (NO3(N))
			NITRATE (N)	7.1	11/21	3.0	05/22	
			CLO4	ND	03/00	ND	05/22	
			AS	ND	09/01	ND	05/22	
			CR6	11.0	08/21	9.3	05/22	
HOWLAND	MUNICIPAL	ACTIVE	TCE	6.9	07/89	ND	11/22	VULNERABLE (VOC)
			PCE	3.6	03/01	ND	11/22	
			C-1,2-DCE	3.3	11/87	ND	02/22	
			NITRATE (N)	4.7	09/16	1.6	05/22	
			CLO4	ND	08/97	ND	08/22	
			AS	0.7	07/96	ND	05/22	
			CR6	7.6	05/22	7.6	05/22	
IVAR 1	MUNICIPAL	DESTROYED	PCE	7.4	06/99	6.2	06/00	
			TCE	1.7	06/99	ND	06/00	
			NITRATE (N)	6.6	09/94	5.9	09/01	
			CLO4	ND	08/97	ND	03/01	
			AS	0.5	10/96	0.5	10/96	
IVAR 2	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	5.4	12/84	5.4	12/84	
			CLO4	NA	NA	NA	NA	
			AS	ND	10/81	ND	10/81	
LONGDEN	MUNICIPAL	ACTIVE	PCE	17.0	09/18	12.0	02/20	VULNERABLE (VOC,NO3(N),CLO4)
			TCE	0.9	03/18	0.8	02/20	
			NITRATE (N)	16.0	03/18	15.0	06/19	
			CLO4	5.5	06/16	ND	02/20	
			AS	4.6	06/01	ND	06/19	
			CR6	4.3	05/15	4.0	06/19	
MAR 1	MUNICIPAL	DESTROYED	VOCS	ND	01/85	ND	01/85	
			NITRATE (N)	20.1	03/79	8.8	01/84	
			CLO4	NA	NA	NA	NA	
			AS	2.0	03/81	ND	10/81	
MAR 2	MUNICIPAL	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	7.5	01/84	7.5	01/84	
			CLO4	NA	NA	NA	NA	
			AS	1.0	03/81	ND	10/81	
MAR 3	MUNICIPAL	ACTIVE	VOCS	ND	01/85	ND	04/22	
			NITRATE (N)	4.0	04/22	2.2	12/22	
			CLO4	ND	06/97	ND	04/22	
			AS	1.0	05/00	ND	04/22	
			CR6	11.0	11/22	11.0	11/22	
MIVW 1	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	7.0	03/01	7.0	03/01	
			CLO4	NA	NA	NA	NA	
MIVW 2	MUNICIPAL	ACTIVE	VOCS	ND	07/87	ND	02/22	VULNERABLE (NO3(N))
			NITRATE (N)	10.0	03/16	6.6	12/22	
			CLO4	ND	06/97	2.0	11/22	
			AS	0.6	07/96	ND	05/22	
			CR6	11.0	05/21	11.0	11/22	
RIC 1	MUNICIPAL	DESTROYED	VOCS	ND	02/85	ND	12/90	
			NITRATE (N)	5.3	08/89	2.7	11/94	
			CLO4	NA	NA	NA	NA	
			AS	ND	09/80	ND	11/94	
RIC 2	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
RIC 3	MUNICIPAL	ACTIVE	TCE	1.4	03/19	0.7	08/22	
			PCE	1.1	11/21	0.7	08/22	
			NITRATE (N)	3.3	03/21	3.3	02/22	
			CLO4	ND	09/16	ND	08/22	
			AS	ND	09/16	ND	03/19	
			CR6	10.0	03/21	9.1	08/22	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)						REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT			
				VALUE	DATE	VALUE	DATE		
ROANOKE	MUNICIPAL	INACTIVE	TCE	5.0	06/00	4.7	12/00		
			PCE	1.2	04/90	ND	09/00		
			C-1,2-DCE	0.5	09/00	ND	12/00		
			NITRATE (N)	7.5	05/89	6.6	12/00		
			CLO4	5.6	06/97	ND	03/00		
			AS	0.8	07/96	ND	02/01		
			CR6	5.0	10/00	4.9	06/01		
ROSEMEAD	MUNICIPAL	INACTIVE	TCE	6.1	03/12	3.8	05/14		
			PCE	3.4	03/09	ND	05/14		
			NITRATE (N)	8.6	12/13	6.6	05/14		
			CLO4	ND	08/97	ND	05/14		
			AS	0.4	07/96	ND	05/14		
			CR6	11.0	10/00	5.2	06/11		
09	MUNICIPAL	ACTIVE	VOCS	ND	06/88	ND	08/22		
			NITRATE (N)	1.4	09/12	1.0	03/17		
			CLO4	ND	07/97	ND	03/17		
			AS	0.9	08/96	ND	04/15		
			CR6	9.4	07/01	8.4	10/14		
11	MUNICIPAL	ACTIVE	VOCS	ND	12/11	ND	04/22		
			NITRATE (N)	0.8	09/16	0.7	03/17		
			CLO4	ND	12/11	ND	03/17		
			AS	ND	05/14	ND	04/15		
			CR6	5.9	10/14	5.9	10/14		
<b>CALIFORNIA COUNTRY CLUB</b>									
ARTES	IRRIGATION	STANDBY	VOCS	ND	05/87	ND	10/10		
			NITRATE (N)	6.6	10/10	6.6	10/10		
			CLO4	NA	NA	NA	NA		
CLUB	IRRIGATION	INACTIVE	PCE	189.0	11/87	189.0	11/87		
			1,1,2,2-PCA	24.0	11/87	24.0	11/87		
			NITRATE (N)	NA	NA	NA	NA		
			CLO4	NA	NA	NA	NA		
SYCAMORE	IRRIGATION	STANDBY	PCE	7.1	09/02	0.6	10/10		
			TCE	0.7	09/01	ND	10/10		
			NITRATE (N)	28.9	10/07	4.3	10/10		
			CLO4	ND	02/98	ND	02/98		
<b>CALIFORNIA DOMESTIC WATER COMPANY</b>									
01-E	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA		
			NITRATE (N)	NA	NA	NA	NA		
			CLO4	NA	NA	NA	NA		
02	MUNICIPAL	DESTROYED	CTC	0.7	09/96	ND	01/20		
			PCE	3.7	09/12	0.6	01/20		
			TCE	4.0	10/99	ND	01/20		
			NITRATE (N)	6.1	02/15	4.5	04/21		
			CLO4	5.6	10/99	ND	05/17		
			AS	7.4	12/11	ND	05/17		
			CR6	5.1	09/18	1.9	04/17		
02A	MUNICIPAL	ACTIVE	VOCS	ND	04/20	ND	01/22		
			NITRATE (N)	2.2	04/20	1.7	12/22		
			AS	2.2	04/20	2.2	04/20		
			CR6	2.3	04/20	2.3	04/20		
03	MUNICIPAL	ACTIVE	CTC	5.3	02/01	1.7	10/22	VULNERABLE (VOC,NO3(N),CLO4)	
			PCE	32.0	11/12	16.0	12/22		
			TCE	54.0	10/20	36.0	12/22		
			1,1-DCE	7.1	10/20	3.4	10/22		
			C-1,2-DCE	5.0	10/20	2.4	10/22		
			NITRATE (N)	10.8	01/07	5.0	12/22		
			CLO4	16.0	11/19	14.0	12/22		
			AS	3.3	12/11	2.1	04/20		
			CR6	3.3	11/00	2.8	04/20		
05	MUNICIPAL	DESTROYED	PCE	2.0	02/85	ND	12/90		
			NITRATE (N)	2.9	03/84	2.9	03/84		
			CLO4	NA	NA	NA	NA		
			AS	40.0	06/78	ND	03/84		
05A	MUNICIPAL	ACTIVE	CTC	1.9	08/96	ND	10/22	VULNERABLE (VOC,NO3(N),AS)	
			PCE	20.0	11/15	13.0	12/22		
			TCE	19.0	11/15	2.5	12/22		
			1,1-DCE	2.7	10/08	2.6	10/22		
			C-1,2-DCE	1.6	10/08	1.4	10/22		
			NITRATE (N)	8.7	05/22	7.7	12/22		

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS				
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT						
				VALUE	DATE	VALUE	DATE					
06	MUNICIPAL	ACTIVE	CLO4	5.2	05/22	3.8	12/22	VULNERABLE (VOC,NO3(N),CLO4)				
			AS	7.6	07/17	2.1	04/20					
			CR6	2.0	04/17	1.9	04/20					
			CTC	3.5	12/06	ND	10/22					
			PCE	39.0	10/14	15.0	12/22					
			TCE	44.0	10/14	16.0	12/22					
			1,1-DCE	6.2	10/14	5.5	10/22					
			C-1,2-DCE	4.5	10/14	3.5	10/22					
			NITRATE (N)	7.7	04/11	2.1	12/22					
			CLO4	7.8	04/17	ND	12/22					
AS	3.2	04/04	ND	04/20								
CR6	2.2	04/17	2.1	04/20								
08	MUNICIPAL	ACTIVE	PCE	35.0	10/22	19.0	12/22	VULNERABLE (VOC,NO3(N),CLO4,AS)				
			TCE	33.0	10/22	21.0	12/22					
			CTC	1.1	09/93	ND	04/22					
			NITRATE (N)	6.6	10/22	6.0	12/22					
			CLO4	5.1	10/22	4.1	12/22					
			AS	6.0	09/94	2.0	04/20					
			CR6	3.2	11/00	2.4	04/20					
10	MUNICIPAL	ACTIVE	PCE	100.0	01/22	45.0	12/22	VULNERABLE (VOC,NO3(N), CLO4)				
			TCE	120.0	01/22	41.0	12/22					
			CTC	1.4	09/19	0.8	10/22					
			1,1-DCE	16.0	01/22	6.9	10/22					
			C-1,2-DCE	10.0	01/22	4.5	10/22					
			NITRATE (N)	7.1	04/21	4.6	12/22					
			CLO4	16.0	01/22	7.3	12/22					
			AS	2.7	12/19	2.7	12/19					
			CR6	2.7	10/16	ND	01/18					
			13-N	MUNICIPAL	DESTROYED	VOCS	NA		NA	NA	NA	
NITRATE (N)	NA	NA				NA	NA					
CLO4	NA	NA				NA	NA					
14	MUNICIPAL	INACTIVE	CTC	4.4	10/07	ND	10/22	VULNERABLE (VOC,NO3(N),CLO4)				
			PCE	16.0	11/12	2.1	12/22					
			TCE	21.0	10/20	ND	12/22					
			1,2-DCA	1.0	06/08	ND	10/22					
			C-1,2-DCE	2.5	10/20	ND	10/22					
			1,1-DCE	3.3	10/20	0.7	10/22					
			NITRATE (N)	16.9	12/14	2.5	12/22					
			CLO4	16.0	12/12	ND	12/22					
			AS	4.5	04/01	2.0	01/20					
			CR6	5.1	04/17	3.7	01/20					
			<b>CEDAR AVENUE MUTUAL WATER COMPANY</b>									
			01 SOUTH	MUNICIPAL	DESTROYED	PCE	2.2		09/90	ND	06/94	
						NITRATE (N)	6.1		08/93	2.0	06/94	
CLO4	NA	NA				NA	NA					
AS	NA	09/89				ND	08/93					
02 NORTH	MUNICIPAL	DESTROYED	PCE	0.8	04/92	ND	06/94					
			NITRATE (N)	4.5	01/86	1.7	08/93					
			CLO4	NA	NA	NA	NA					
			AS	ND	09/89	ND	09/92					
<b>CEMEX CONSTRUCTION MATERIALS L.P. (AZ TWO)</b>												
02	INDUSTRIAL	DESTROYED	PCE	700.0	01/85	2.8	09/03					
			TCE	940.0	04/85	6.3	09/03					
			CTC	2.2	09/02	ND	09/03					
			1,1-DCE	350.0	01/87	7.2	09/03					
			1,1-DCA	1.0	08/01	ND	09/03					
			1,1,1-TCA	430.0	01/87	3.6	09/03					
			VC	19.0	12/87	ND	09/03					
			NITRATE (N)	17.8	09/02	16.5	09/03					
			CLO4	4.2	06/97	ND	09/98					
			<b>CHAMPION MUTUAL WATER COMPANY</b>									
01	MUNICIPAL	DESTROYED	PCE	3.0	09/86	ND	06/98					
			NITRATE (N)	NA	NA	NA	NA					
			CLO4	NA	NA	NA	NA					
02	MUNICIPAL	DESTROYED	PCE	0.6	06/88	ND	09/13					
			NITRATE (N)	6.3	09/10	5.0	06/14					
			CLO4	ND	09/97	ND	09/13					
			AS	3.6	08/98	2.4	09/13					
			CR6	1.0	06/01	0.7	09/13					
03	MUNICIPAL	DESTROYED	PCE	1.3	09/96	ND	12/14					

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)				REMARKS	
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE		DATE
			FREON 113	18.0	03/07	ND	03/15	
			NITRATE (N)	5.4	03/09	4.1	03/15	
			CLO4	ND	03/98	ND	12/14	
			AS	13.2	05/98	2.8	03/15	
			CR6	1.0	06/01	ND	09/14	
<b>CHEVRON USA INC.</b>								
TEMP 1	NON-POTABLE	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>CITRUS VALLEY MEDICAL CENTER, QUEEN OF THE VALLEY CAMPUS</b>								
01	NON-POTABLE	DESTROYED	VOCS	ND	09/96	ND	10/10	
			NITRATE (N)	23.7	02/98	18.7	10/10	
			CLO4	24.0	02/98	24.0	02/98	
<b>CLAYTON MANUFACTURING COMPANY</b>								
02	INDUSTRIAL	DESTROYED	TCE	150.0	08/01	47.0	09/03	
			PCE	30.0	08/01	ND	09/03	
			1,1-DCE	10.0	08/01	1.7	09/03	
			C-1,2-DCE	1.7	08/01	ND	09/03	
			1,1-DCA	15.0	08/01	ND	09/03	
			1,2-DCA	13.0	08/01	ND	09/03	
			1,1,1-TCA	1.1	08/01	ND	09/03	
			NITRATE (N)	19.7	08/01	9.0	09/03	
			CLO4	4.0	09/97	4.0	09/97	
<b>CORCORAN BROTHERS</b>								
01	NON-POTABLE	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>COUNTY SANITATION DISTRICT NO. 18</b>								
E08A	REMEDIAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
E09A	REMEDIAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
E10A	REMEDIAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
E11A	REMEDIAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
EX1	REMEDIAL	ACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
EX2	REMEDIAL	ACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
EX3	REMEDIAL	ACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
EX4	REMEDIAL	ACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
LE1	REMEDIAL	DESTROYED	TCE	4.2	06/86	3.7	09/86	
			PCE	0.8	09/86	0.8	09/86	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
LE2	REMEDIAL	DESTROYED	TCE	0.1	06/86	ND	09/86	
			PCE	NA	06/86	ND	09/86	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
LE3	REMEDIAL	DESTROYED	TCE	1.5	06/86	1.2	09/86	
			PCE	1.6	06/86	0.8	09/86	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE	DATE	
LE4	REMEDIAL	DESTROYED	TCE	5.1	09/86	5.1	09/86	
			PCE	2.0	09/86	2.0	09/86	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>COVINA, CITY OF</b>								
01	MUNICIPAL	DESTROYED	PCE	0.6	01/99	0.6	01/99	
			NITRATE (N)	27.1	01/99	27.1	01/99	
			CLO4	NA	NA	NA	NA	
02 (GRAND)	MUNICIPAL	DESTROYED	VOCS	ND	06/88	ND	09/98	
			NITRATE (N)	26.2	08/89	23.3	04/99	
			CLO4	23.0	09/97	22.0	09/98	
			AS	3.3	08/97	3.3	08/97	
03	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	16.3	10/73	16.3	10/73	
			CLO4	NA	NA	NA	NA	
<b>COVINA IRRIGATING COMPANY</b>								
BAL 1	MUNICIPAL	ACTIVE	TCE	200.0	07/80	ND	07/22	VULNERABLE (VOC,NO3(N))
			PCE	7.6	07/80	ND	07/22	
			1,1-DCE	0.5	10/06	ND	07/22	
			NITRATE (N)	9.8	10/21	2.6	12/22	
			CLO4	1.5	10/06	ND	12/22	
			AS	4.7	12/89	3.3	07/21	
			CR6	1.0	10/00	ND	07/21	
BAL 2	MUNICIPAL	ACTIVE	TCE	195.0	06/80	ND	04/22	VULNERABLE (VOC,NO3(N),CLO4)
			PCE	7.9	06/80	ND	04/22	
			1,1-DCE	0.8	07/07	ND	10/22	
			NITRATE (N)	10.6	03/10	7.3	10/22	
			CLO4	5.5	03/09	3.4	10/22	
			AS	4.0	08/76	3.4	07/21	
			CR6	3.5	10/19	1.4	07/21	
BAL 3	MUNICIPAL	ACTIVE	TCE	225.0	01/80	ND	07/22	VULNERABLE (VOC,NO3(N),CLO4)
			PCE	10.0	02/85	ND	07/22	
			CTC	3.0	04/85	ND	07/22	
			1,1-DCA	4.0	04/85	ND	07/22	
			1,2-DCA	3.7	02/85	ND	07/22	
			1,1-DCE	2.1	04/85	ND	07/22	
			T-1,2-DCE	2.9	02/85	ND	07/22	
			1,1,1-TCA	5.2	04/85	ND	07/22	
			NITRATE (N)	12.9	08/89	4.6	12/22	
			CLO4	5.6	09/08	2.4	12/22	
			AS	3.5	08/18	3.2	07/21	
			CR6	3.5	08/18	ND	07/21	
			CONTR	MUNICIPAL	DESTROYED	PCE	1.4	
NITRATE (N)	28.3	12/89				24.4	03/94	
CLO4	NA	NA				NA	NA	
AS	ND	12/89				ND	12/92	
VALEN	MUNICIPAL	DESTROYED	PCE	2.4	08/85	0.6	09/97	
			NITRATE (N)	16.5	06/81	15.7	09/97	
			CLO4	6.4	09/97	6.4	09/97	
<b>CREVOLIN, A.J.</b>								
NA	DOMESTIC	DESTROYED	VOCS	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>CROWN CITY PLATING COMPANY</b>								
01	INDUSTRIAL	INACTIVE	TCE	1.2	09/04	1.2	09/04	
			T-1,2-DCE	1.4	05/87	ND	09/04	
			NITRATE (N)	1.7	09/04	0.8	09/08	
			CLO4	ND	09/97	ND	10/07	
<b>DAVIDSON OPTRONICS INC.</b>								
NA	INDUSTRIAL	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>DAWES, MARY K.</b>								
04	IRRIGATION	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE	DATE	
			CLO4	NA	NA	NA	NA	
<b>DEL RIO MUTUAL WATER COMPANY</b>								
BURKETT	MUNICIPAL	ACTIVE	TCE	2.2	06/90	ND	07/22	VULNERABLE (VOC,NO3(N))
			PCE	3.7	03/97	ND	07/22	
			NITRATE (N)	7.0	12/03	1.1	07/22	
			CLO4	ND	09/97	ND	07/21	
			AS	2.6	03/02	2.1	09/20	
			CR6	3.4	07/01	ND	09/20	
KLING	MUNICIPAL	INACTIVE	PCE	1.3	08/86	ND	02/89	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>DRIFTWOOD DAIRY</b>								
01	INDUSTRIAL	INACTIVE	PCE	13.9	06/98	13.9	06/98	
			1,1,1-TCA	0.3	03/93	ND	06/98	
			NITRATE (N)	14.7	03/93	10.6	06/98	
			CLO4	ND	06/98	ND	06/98	
<b>DUNNING, GEORGE</b>								
1910	IRRIGATION	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>EL MONTE, CITY OF</b>								
02A	MUNICIPAL	ACTIVE	PCE	13.0	03/98	2.3	12/22	VULNERABLE (VOC,NO3(N),AS)
			TCE	5.3	01/95	ND	12/22	
			NITRATE (N)	8.5	06/16	5.7	12/22	
			CLO4	ND	07/97	ND	07/22	
			AS	10.0	03/73	ND	07/20	
			CR6	4.0	07/20	4.0	07/20	
03	MUNICIPAL	STANDBY	PCE	23.6	12/00	10.0	12/22	VULNERABLE (VOC,NO3(N),AS)
			1,1,1-TCA	1.0	11/93	ND	10/22	
			NITRATE (N)	16.2	08/89	8.6	12/22	
			CLO4	ND	07/97	ND	10/22	
			AS	10.0	03/73	ND	10/20	
			CR6	3.2	12/17	3.2	10/20	
04	MUNICIPAL	STANDBY	PCE	60.0	12/19	60.0	12/19	VULNERABLE (VOC,NO3(N),AS)
			TCE	7.8	02/80	ND	12/19	
			NITRATE (N)	13.1	11/14	5.8	12/19	
			CLO4	ND	07/97	ND	12/19	
			AS	10.0	03/73	ND	12/19	
			CR6	2.8	07/01	1.1	12/19	
05	MUNICIPAL	DESTROYED	TCE	150.0	07/93	70.0	12/96	
			PCE	51.0	07/93	32.0	12/96	
			CTC	4.3	07/93	1.4	12/96	
			NITRATE (N)	12.2	12/96	5.9	06/99	
			CLO4	5.9	06/97	5.9	06/97	
			AS	10.0	04/73	10.0	04/73	
10	MUNICIPAL	ACTIVE	TCE	7.2	09/81	ND	12/22	VULNERABLE (VOC,NO3(N),AS)
			PCE	17.7	12/93	1.2	10/22	
			NITRATE (N)	9.3	04/16	3.9	12/22	
			CLO4	2.2	07/22	2.1	10/22	
			AS	20.0	03/73	ND	05/20	
			CR6	1.8	05/20	1.8	05/20	
11	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	4.9	07/79	4.9	07/79	
			CLO4	NA	NA	NA	NA	
			AS	20.0	03/73	3.0	08/79	
12	MUNICIPAL	ACTIVE	TCE	87.0	04/19	40.0	12/22	VULNERABLE (VOC,NO3(N))
			PCE	39.0	04/19	17.0	12/22	
			CTC	1.0	06/92	ND	10/22	
			C-1,2-DCE	0.9	10/16	ND	10/22	
			NITRATE (N)	9.3	06/05	7.7	12/22	
			CLO4	1.1	07/21	ND	07/22	
			AS	ND	05/84	ND	07/22	
			CR6	5.7	08/22	5.7	08/22	
13	MUNICIPAL	ACTIVE	PCE	8.8	10/21	7.3	12/22	VULNERABLE (VOC,NO3(N))
			TCE	21.0	10/21	13.0	12/22	
			NITRATE (N)	5.3	06/16	3.4	12/22	
			CLO4	ND	07/97	ND	08/22	
			AS	1.3	08/96	0.9	08/22	



WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)						REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT			
				VALUE	DATE	VALUE	DATE		
14 (DEW-1)	MUNICIPAL	ACTIVE	CR6	5.3	07/16	5.2	08/22	VULNERABLE (VOC)	
			PCE	4.4	05/20	2.1	12/22		
			TCE	12.0	05/19	8.9	12/22		
			C-1,2-DCE	2.0	07/22	1.0	10/22		
			NITRATE (N)	3.4	08/22	2.8	12/22		
			CLO4	1.2	07/21	ND	10/22		
			AS	ND	05/19	ND	04/22		
			CR6	5.6	04/22	0.5	10/22		
15 (DEW-2)	MUNICIPAL	ACTIVE	PCE	6.6	05/20	5.0	12/22	VULNERABLE (VOC,NO3(N),CLO4)	
			TCE	10.0	07/22	10.0	12/22		
			NITRATE (N)	6.3	07/21	4.9	12/22		
			CLO4	8.9	12/19	ND	10/22		
			AS	ND	05/19	ND	04/22		
			CR6	4.4	10/20	0.2	10/22		
16 (DEW-3)	MUNICIPAL	ACTIVE	PCE	15.0	05/20	11.0	12/22	VULNERABLE (VOC,NO3(N))	
			TCE	42.0	04/22	35.0	12/22		
			CTC	0.6	05/19	ND	10/22		
			NITRATE (N)	7.3	11/22	6.4	12/22		
			CLO4	1.6	07/21	ND	10/22		
			AS	ND	05/19	ND	04/22		
			CR6	6.1	07/21	5.9	10/22		
MT VW	IRRIGATION	DESTROYED	PCE	2.1	08/85	ND	01/01		
			TCE	2.0	01/85	ND	01/01		
			NITRATE (N)	6.8	02/87	2.3	01/01		
			CLO4	ND	09/97	ND	11/97		
			AS	ND	02/84	ND	02/84		
<b>EL MONTE CEMETERY ASSOCIATION</b>									
NA	IRRIGATION	INACTIVE	VOCS	NA	NA	NA	NA		
			NITRATE (N)	NA	NA	NA	NA		
			CLO4	NA	NA	NA	NA		
<b>FRUIT STREET WATER COMPANY</b>									
NA	IRRIGATION	DESTROYED	VOCS	NA	NA	NA	NA		
			NITRATE (N)	NA	NA	NA	NA		
			CLO4	NA	NA	NA	NA		
<b>GATES, JAMES RICHARD</b>									
GATES 1	IRRIGATION	ACTIVE	VOCS	NA	NA	NA	NA		
			NITRATE (N)	NA	NA	NA	NA		
			CLO4	NA	NA	NA	NA		
01	NA	DESTROYED	VOCS	NA	NA	NA	NA		
			NITRATE (N)	NA	NA	NA	NA		
			CLO4	NA	NA	NA	NA		
<b>GLENDORA, CITY OF</b>									
01-E	MUNICIPAL	DESTROYED	TCE	0.8	12/80	ND	09/07		
			NITRATE (N)	8.6	10/88	7.9	08/08		
			CLO4	ND	06/97	ND	03/03		
			AS	2.8	07/98	ND	03/08		
			CR6	1.0	05/01	1.0	05/01		
02-E	MUNICIPAL	ACTIVE	VOCS	ND	03/85	ND	01/22	VULNERABLE (NO3(N))	
			NITRATE (N)	15.8	05/78	1.2	12/22		
			CLO4	ND	07/97	ND	01/22		
			AS	0.7	08/96	ND	01/22		
			CR6	1.3	09/16	0.2	01/22		
03-G	MUNICIPAL	INACTIVE	TCE	0.5	12/79	ND	05/97		
			PCE	0.5	05/97	0.5	05/97		
			NITRATE (N)	36.7	08/83	25.1	08/99		
			CLO4	NA	NA	NA	NA		
04-E	MUNICIPAL	INACTIVE	TCE	0.7	08/80	ND	08/91		
			PCE	0.1	07/81	ND	08/91		
			NITRATE (N)	28.5	06/83	12.8	08/91		
			CLO4	NA	NA	NA	NA		
			AS	ND	07/74	ND	07/74		
05-E	MUNICIPAL	ACTIVE	VOCS	ND	02/95	ND	07/22	VULNERABLE (AS)	
			NITRATE (N)	0.7	05/95	0.4	04/22		
			CLO4	ND	07/97	ND	04/22		
			AS	5.3	04/98	3.1	04/22		
			CR6	1.0	11/00	0.1	04/22		

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)				REMARKS	
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE		DATE
07-G	MUNICIPAL	INACTIVE	TCE	302.0	01/81	ND	04/98	
			PCE	25.0	01/81	1.9	04/98	
			1,1-DCE	435.0	05/84	ND	04/98	
			C-1,2-DCE	21.0	05/82	ND	04/98	
			1,1-DCA	5.0	05/84	ND	04/98	
			1,2-DCA	12.1	12/93	ND	04/98	
			1,1,1-TCA	3200.0	05/84	64	04/98	
			NITRATE (N)	23.9	04/98	17.1	04/98	
			CLO4	5.3	04/98	5.3	04/98	
			AS	ND	07/74	ND	08/95	
08-E	MUNICIPAL	ACTIVE	VOCS	ND	08/02	ND	01/22	
			NITRATE (N)	1.5	08/86	0.3	07/22	
			CLO4	ND	07/97	ND	07/22	
			AS	3.2	08/96	2.1	09/20	
			CR6	1.0	11/00	ND	09/20	
09-E	MUNICIPAL	ACTIVE	VOCS	ND	05/89	ND	07/22	
			NITRATE (N)	0.9	08/96	0.4	07/22	
			CLO4	ND	07/97	ND	07/22	
			AS	2.6	09/17	2.0	09/20	
			CR6	1.0	11/00	ND	09/20	
10-E	MUNICIPAL	ACTIVE	VOCS	ND	07/97	ND	01/22	VULNERABLE (NO3(N),AS)
			NITRATE (N)	17.6	05/77	6.8	12/22	
			CLO4	ND	07/97	ND	01/22	
			AS	7.0	08/79	ND	03/20	
			CR6	1.2	03/17	ND	03/20	
11-E	MUNICIPAL	ACTIVE	VOCS	ND	05/82	ND	07/22	VULNERABLE (NO3(N),CLO4)
			NITRATE (N)	26.5	08/73	8.3	12/22	
			CLO4	4.9	12/10	2.0	10/22	
			AS	3.2	07/98	ND	07/22	
			CR6	1.9	07/22	1.9	07/22	
12-E	MUNICIPAL	ACTIVE	TCE	0.9	12/80	ND	07/22	
			NITRATE (N)	1.1	07/98	0.4	07/22	
			CLO4	ND	06/97	ND	07/22	
			AS	4.4	07/97	2.2	07/21	
			CR6	1.0	11/00	ND	07/21	
13-E	MUNICIPAL	ACTIVE	VOCS	ND	06/04	ND	01/22	VULNERABLE (NO3(N))
			NITRATE (N)	6.6	12/09	2.9	12/22	
			CLO4	ND	06/04	ND	04/22	
			AS	2.2	09/15	ND	04/22	
			CR6	0.6	09/13	0.3	04/22	
<b>GOEDERT, LILLIAN</b>								
GOEDERT	IRRIGATION	DESTROYED	VOCS	ND	06/98	ND	06/98	
			NITRATE (N)	1.6	06/98	1.6	06/98	
			CLO4	ND	06/98	ND	06/98	
<b>GOLDEN STATE WATER COMPANY/SAN DIMAS DISTRICT</b>								
ART-1	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	13.6	10/74	13.6	10/74	
			CLO4	NA	NA	NA	NA	
			AS	ND	07/74	ND	07/74	
ART-2	MUNICIPAL	DESTROYED	VOCS	ND	06/89	ND	05/07	
			NITRATE (N)	5.9	08/07	2.1	09/07	
			CLO4	ND	08/97	ND	09/07	
			AS	0.8	08/96	ND	05/07	
ART-3	MUNICIPAL	ACTIVE	VOCS	ND	05/89	ND	11/21	VULNERABLE (NO3(N),CLO4)
			NITRATE (N)	31.6	05/14	14.0	08/22	
			CLO4	21.0	05/14	7.1	09/22	
			AS	0.7	08/96	ND	05/22	
			CR6	2.0	05/22	2.0	05/22	
BAS-3	MUNICIPAL	ACTIVE	VOCS	ND	06/89	ND	09/19	VULNERABLE (NO3(N),CLO4)
			NITRATE (N)	28.0	05/16	5.2	11/19	
			CLO4	21.0	10/14	4.3	11/19	
			AS	4.0	08/76	ND	09/19	
			CR6	1.8	05/16	ND	09/19	
BAS-4	MUNICIPAL	DESTROYED	VOCS	ND	03/85	ND	06/16	
			NITRATE (N)	24.8	01/13	12.0	12/16	
			CLO4	23.0	03/13	7.6	12/16	
			AS	1.0	08/96	ND	05/16	
			CR6	2.3	05/16	2.3	05/16	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE	DATE	
CITY	IRRIGATION	ACTIVE	VOCS	ND	06/88	ND	05/08	VULNERABLE (NO3(N))
			NITRATE (N)	10.1	09/93	7.0	11/08	
			CLO4	ND	08/97	ND	08/08	
			AS	0.7	08/96	ND	08/06	
			CR6	0.2	12/00	ND	07/01	
COL-1	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	21.0	09/75	2.3	10/76	
			CLO4	NA	NA	NA	NA	
COL-2	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	26.5	10/76	26.5	10/76	
			CLO4	NA	NA	NA	NA	
			AS	18.0	06/78	18.0	06/78	
COL-4	MUNICIPAL	DESTROYED	VOCS	ND	09/97	ND	05/19	
			NITRATE (N)	14.5	03/83	5.4	11/19	
			CLO4	2.9	04/11	ND	05/19	
			AS	0.7	08/96	ND	05/19	
			CR6	1.7	02/17	ND	05/19	
COL-5	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
COL-6	MUNICIPAL	DESTROYED	PCE	7.2	07/85	ND	02/11	
			NITRATE (N)	12.7	06/85	8.1	03/11	
			CLO4	2.1	03/11	2.1	03/11	
			AS	4.0	08/76	ND	05/10	
			CR6	1.0	07/01	1.0	07/01	
COL-7	MUNICIPAL	DESTROYED	PCE	22.0	12/87	3.1	11/99	
			TCE	9.9	01/80	ND	09/99	
			1,1-DCE	1.1	03/85	ND	09/99	
			1,1,1-TCA	1.7	07/85	ND	09/99	
			NITRATE (N)	26.7	05/79	15.4	01/00	
			CLO4	4.2	01/02	4.2	01/02	
			AS	0.9	08/96	ND	01/00	
COL-8	MUNICIPAL	INACTIVE	PCE	0.2	09/80	ND	12/96	
			NITRATE (N)	27.1	06/83	11.5	12/96	
			CLO4	NA	NA	NA	NA	
			AS	6.0	08/79	ND	03/85	
HIGHWAY	MUNICIPAL	ACTIVE	TCE	0.6	12/80	ND	08/22	VULNERABLE (NO3(N),CLO4)
			PCE	0.1	12/80	ND	08/22	
			NITRATE (N)	19.0	08/15	6.1	09/22	
			CLO4	12.0	08/15	ND	09/22	
			AS	0.8	08/96	0.7	08/22	
			CR6	1.0	07/01	0.9	08/22	
HIGHWAY 2	MUNICIPAL	ACTIVE	VOCS	ND	10/10	ND	02/22	VULNERABLE (NO3(N))
			NITRATE (N)	6.1	11/15	3.7	12/22	
			CLO4	ND	10/10	ND	11/22	
			AS	0.8	11/22	0.8	11/22	
			CR6	1.7	10/10	0.6	11/22	
L HILL 2	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
MALON	MUNICIPAL	ACTIVE	VOCS	ND	08/96	ND	08/21	VULNERABLE (NO3(N))
			NITRATE (N)	9.5	09/87	5.7	12/22	
			CLO4	ND	08/97	ND	08/22	
			AS	0.7	08/96	ND	08/18	
			CR6	1.0	07/01	ND	09/15	
<b>GOLDEN STATE WATER COMPANY/SAN GABRIEL VALLEY DISTRICT (SOUTH ARCADIA)</b>								
AZU 1	MUNICIPAL	DESTROYED	TCE	15.0	07/93	0.6	01/95	
			PCE	1.9	07/93	ND	01/95	
			NITRATE (N)	16.5	12/90	7.9	07/02	
			CLO4	NA	NA	NA	NA	
			AS	0.6	08/96	0.6	08/96	
EARL 1	MUNICIPAL	DESTROYED	PCE	6.0	09/03	6.0	09/03	
			NITRATE (N)	1.6	08/03	1.6	09/03	
			CLO4	ND	08/97	ND	08/03	
			AS	0.5	08/96	ND	07/01	
ENC 1	MUNICIPAL	ACTIVE	TCE	21.0	04/03	1.6	12/22	VULNERABLE (VOC,NO3(N),CLO4)
			PCE	3.5	04/03	0.5	12/22	
			NITRATE (N)	17.5	08/91	1.8	11/22	
			CLO4	5.7	02/13	ND	12/22	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)						REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT			
				VALUE	DATE	VALUE	DATE		
ENC 2	MUNICIPAL	ACTIVE	AS	ND	07/89	ND	05/22	VULNERABLE (VOC)	
			CR6	9.3	05/22	9.3	05/22		
			TCE	29.1	02/01	1.3	12/22		
			PCE	6.4	02/15	0.5	12/22		
			NITRATE (N)	4.7	02/09	1.5	12/22		
			CLO4	1.5	03/10	ND	12/22		
ENC 3	MUNICIPAL	ACTIVE	AS	0.7	08/96	ND	08/20	VULNERABLE (VOC,NO3(N),AS)	
			CR6	7.9	08/17	6.2	08/20		
			TCE	23.0	08/21	13.0	12/22		
			PCE	8.1	08/21	6.4	12/22		
			NITRATE (N)	9.8	07/93	3.7	11/22		
			CLO4	1.9	03/10	ND	12/22		
FAR 1	MUNICIPAL	ACTIVE	AS	16.3	07/90	ND	08/20	VULNERABLE (VOC)	
			CR6	8.1	08/20	8.1	08/20		
			TCE	11.9	10/80	ND	11/22		
			PCE	3.1	10/87	ND	02/22		
			NITRATE (N)	2.9	07/89	0.4	05/22		
			CLO4	ND	08/97	ND	05/22		
FAR 2	MUNICIPAL	ACTIVE	AS	2.7	08/97	ND	05/22	VULNERABLE (VOC)	
			CR6	1.6	05/16	0.4	05/22		
			TCE	12.9	07/80	ND	11/22		
			PCE	2.6	10/87	ND	08/22		
			NITRATE (N)	2.8	07/90	0.9	08/22		
			CLO4	ND	08/97	ND	08/21		
GAR 1	MUNICIPAL	DESTROYED	AS	0.9	08/96	ND	08/20	VULNERABLE (VOC)	
			CR6	2.6	08/17	1.1	08/20		
			VOCS	ND	08/99	ND	07/03		
			PCE	4.5	10/03	4.5	10/03		
			NITRATE (N)	1.9	08/03	1.7	09/03		
			CLO4	ND	08/97	ND	08/03		
GAR 2	MUNICIPAL	DESTROYED	AS	0.5	08/96	ND	08/03	VULNERABLE (VOC)	
			CLO4	ND	08/97	ND	08/03		
			PCE	12.0	07/03	11.0	08/03		
			TCE	2.2	08/03	2.2	08/03		
			NITRATE (N)	1.6	08/97	1.0	07/02		
			CLO4	ND	08/97	ND	08/03		
GAR 3	MUNICIPAL	ACTIVE	AS	0.5	08/96	ND	08/03	VULNERABLE (VOC)	
			CR6	7.2	05/22	7.2	05/22		
			TCE	0.8	02/17	ND	05/18		
			PCE	17.0	12/22	17.0	12/22		
			NITRATE (N)	3.8	02/17	2.0	12/22		
			CLO4	ND	06/16	ND	12/22		
GID 1	MUNICIPAL	DESTROYED	AS	ND	06/16	ND	05/22	VULNERABLE (VOC)	
			CR6	7.2	05/22	7.2	05/22		
			TCE	6.6	04/85	4.1	09/93		
			PCE	0.9	09/93	0.9	09/93		
			NITRATE (N)	9.2	09/93	9.2	09/93		
			CLO4	NA	NA	NA	NA		
GID 2	MUNICIPAL	DESTROYED	CLO4	NA	NA	NA	NA	VULNERABLE (VOC)	
			TCE	86.0	05/87	5.2	09/93		
			PCE	20.0	05/87	1.5	09/93		
			CTC	3.0	05/87	ND	09/93		
			NITRATE (N)	10.3	09/93	10.3	09/93		
			CLO4	NA	NA	NA	NA		
GRA 1	MUNICIPAL	DESTROYED	AS	18.0	06/78	ND	08/94	VULNERABLE (VOC)	
			CLO4	NA	NA	NA	NA		
			TCE	33.0	09/88	25.4	11/94		
			PCE	2.5	11/93	0.6	11/94		
			NITRATE (N)	19.6	08/89	10.0	07/95		
			CLO4	NA	NA	NA	NA		
GRA 2	MUNICIPAL	INACTIVE	AS	18.0	06/78	ND	08/94	VULNERABLE (VOC)	
			CLO4	NA	NA	NA	NA		
			TCE	31.3	08/89	24.6	08/94		
			PCE	3.3	09/94	3.3	09/94		
			1,1-DCE	4.8	08/94	4.8	08/94		
			NITRATE (N)	18.5	07/90	10.0	07/95		
JEF 1	MUNICIPAL	INACTIVE	AS	ND	01/89	ND	08/94	VULNERABLE (VOC)	
			CLO4	NA	NA	NA	NA		
			TCE	340.0	01/80	98.0	01/85		
			PCE	23.0	03/81	8.0	01/85		
			1,1,1-TCA	31.0	01/85	31.0	01/85		
			NITRATE (N)	11.7	07/83	11.0	03/86		
JEF 2	MUNICIPAL	DESTROYED	CLO4	NA	NA	NA	NA	VULNERABLE (VOC)	
			TCE	260.0	01/80	140.0	01/85		
			PCE	15.0	03/81	6.0	01/85		
			1,1-DCE	20.0	01/85	20.0	01/85		
			1,1,1-TCA	54.0	01/85	54.0	01/85		
			CLO4	NA	NA	NA	NA		

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE	DATE	
			NITRATE (N)	15.4	06/77	13.8	06/79	
			CLO4	NA	NA	NA	NA	
JEF 3	MUNICIPAL	DESTROYED	TCE	121.0	02/81	4.9	08/92	
			PCE	12.0	03/81	0.6	08/92	
			1,1,1-TCA	29.0	04/85	ND	08/92	
			T-1,2-DCE	2.4	04/85	ND	08/92	
			NITRATE (N)	11.7	12/84	5.3	08/92	
			CLO4	NA	NA	NA	NA	
			AS	ND	12/84	ND	08/86	
JEF 4	MUNICIPAL	ACTIVE	VOCS	ND	08/89	ND	08/22	
			NITRATE (N)	3.3	07/89	0.8	08/22	
			CLO4	ND	08/97	ND	08/22	
			AS	0.7	08/96	ND	08/18	
			CR6	1.3	07/01	ND	08/15	
PER 1	MUNICIPAL	ACTIVE	TCE	25.8	10/80	0.8	11/22	VULNERABLE
			PCE	6.8	07/87	ND	11/22	(VOC,NO3(N))
			NITRATE (N)	8.6	12/11	3.1	11/22	
			CLO4	ND	08/97	ND	11/22	
			AS	0.9	08/96	ND	08/18	
			CR6	5.6	08/15	5.6	08/15	
S G 1	MUNICIPAL	ACTIVE	PCE	46.0	04/06	9.2	12/22	VULNERABLE
			TCE	6.8	12/03	0.7	12/22	(VOC,NO3(N),CLO4)
			C-1,2-DCE	1.8	11/04	ND	11/22	
			1,1-DCA	1.8	06/04	ND	11/22	
			1,1-DCE	0.7	11/04	ND	11/22	
			FREON 11	1.2	08/03	ND	11/21	
			NITRATE (N)	6.1	04/02	3.1	12/22	
			CLO4	8.1	08/03	2.0	12/22	
			AS	2.7	08/94	0.7	08/22	
			CR6	5.9	12/01	5.8	08/22	
S G 2	MUNICIPAL	ACTIVE	PCE	28.0	05/11	1.5	12/22	VULNERABLE
			TCE	3.6	06/99	ND	11/22	(VOC,NO3(N),CLO4)
			1,1-DCE	0.7	04/11	ND	11/22	
			C-1,2-DCE	1.2	02/01	ND	08/22	
			NITRATE (N)	17.0	08/16	10.0	12/22	
			CLO4	7.0	02/03	2.0	12/22	
			AS	0.8	08/96	ND	08/18	
			CR6	8.0	08/15	8.0	08/15	
SAX 1	MUNICIPAL	DESTROYED	PCE	1.4	04/97	0.9	12/97	
			NITRATE (N)	7.5	10/97	7.5	10/97	
			CLO4	ND	08/97	ND	12/97	
			AS	0.3	08/96	0.3	08/96	
SAX 3	MUNICIPAL	INACTIVE	PCE	1.3	09/19	1.3	09/19	VULNERABLE
			NITRATE (N)	6.2	11/96	2.4	06/19	(NO3(N))
			CLO4	ND	08/97	ND	06/19	
			AS	0.4	08/96	ND	06/19	
			CR6	5.8	08/16	4.2	06/19	
SAX 4	MINICIPAL	ACTIVE	PCE	1.1	05/22	ND	11/22	VULNERABLE
			TCE	0.5	12/16	ND	11/22	(AS)
			NITRATE (N)	2.7	08/99	1.4	11/22	
			CLO4	ND	08/97	ND	11/22	
			AS	8.0	11/19	3.9	11/22	
			CR6	4.8	11/14	2.0	11/22	
<b>GREEN, WALTER</b>								
NA	IRRIGATION	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
NA	NON-POTABLE	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>HALL (W.E.) COMPANY</b>								
NA	DOMESTIC	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>HANSEN, ALICE</b>								
2946C	IRRIGATION	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)				REMARKS	
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE		DATE

**HANSON AGGREGATES WEST, INC. (FORMERLY LIVINGSTON-GRAHAM)**

DUA 1	INDUSTRIAL	INACTIVE	VOCS	NA	NA	NA	NA
			NITRATE (N)	NA	NA	NA	NA
			CLO4	NA	NA	NA	NA
EL 1	INDUSTRIAL	ACTIVE	VOCS	ND	05/98	ND	10/20
			NITRATE (N)	3.8	02/93	2.7	10/20
			CLO4	ND	03/98	ND	03/98
EL 3	INDUSTRIAL	ACTIVE	VOCS	ND	06/98	ND	10/20
			NITRATE (N)	5.0	05/93	1.5	10/20
			CLO4	ND	03/98	ND	03/98
EL 4	INDUSTRIAL	INACTIVE	VOCS	ND	12/87	ND	10/17
			NITRATE (N)	1.4	06/98	1.0	10/17
			CLO4	NA	NA	NA	NA
KIN 1	INDUSTRIAL	DESTROYED	VOCS	NA	NA	NA	NA
			NITRATE (N)	NA	NA	NA	NA
			CLO4	NA	NA	NA	NA

**HARTLEY, DAVID**

NA	DOMESTIC	INACTIVE	VOCS	ND	10/95	ND	10/95
			NITRATE (N)	25.1	01/96	16.9	04/96
			CLO4	NA	NA	NA	NA

**HEMLOCK MUTUAL WATER COMPANY**

NORTH	MUNICIPAL	ACTIVE	PCE	51.7	04/82	ND	07/22	VULNERABLE (VOC)
			TCE	0.7	12/87	ND	07/22	
			NITRATE (N)	4.3	12/06	0.6	10/22	
			CLO4	ND	09/97	ND	10/22	
			AS	2.7	12/08	ND	11/20	
			CR6	1.0	12/00	ND	11/20	
SOUTH	MUNICIPAL	ACTIVE	PCE	210.0	12/87	ND	10/22	VULNERABLE (VOC,NO3(N))
			TCE	0.9	04/89	ND	07/22	
			NITRATE (N)	7.4	12/94	0.5	10/22	
			CLO4	ND	09/97	ND	07/22	
			AS	2.1	08/96	ND	09/20	
			CR6	1.1	12/00	ND	09/20	

**IBY PROPERTY OWNER, LLC (MOLSON COORS USA LLC/MILLERCOORS LLC)**

01	INDUSTRIAL	INACTIVE	VOCS	ND	01/92	ND	10/09
			NITRATE (N)	2.2	01/93	1.0	10/09
			CLO4	ND	06/97	ND	06/08
			AS	3.9	06/08	3.9	06/08
02	INDUSTRIAL	ACTIVE	VOCS	ND	01/92	ND	11/19
			NITRATE (N)	3.2	10/92	0.7	11/19
			CLO4	ND	06/97	ND	06/14
			AS	3.5	05/08	3.3	06/13
CR6	ND	12/14	ND	12/14			
N BREWER	INDUSTRIAL	INACTIVE	VOCS	NA	NA	NA	NA
			NITRATE (N)	NA	NA	NA	NA
			CLO4	NA	NA	NA	NA

**INDUSTRY WATERWORKS SYSTEM, CITY OF**

01	MUNICIPAL	INACTIVE	TCE	40.0	01/80	1.7	10/92
			PCE	9.0	04/80	5.0	10/92
			CTC	5.7	10/92	5.7	10/92
			1,1-DCE	15.3	10/92	15.3	10/92
			1,2-DCA	0.6	10/92	0.6	10/92
			NITRATE (N)	13.6	10/92	13.6	10/92
			CLO4	NA	NA	NA	NA
			AS	ND	01/80	ND	01/80
			AS	ND	01/80	ND	01/80
02	MUNICIPAL	INACTIVE	TCE	19.0	01/80	2.3	04/81
			PCE	10.0	04/81	10.0	04/81
			NITRATE (N)	12.5	02/86	12.5	02/86
			CLO4	100.0	04/99	100.0	04/99
			AS	ND	01/80	ND	01/80
03	MUNICIPAL	INACTIVE	PCE	2.6	09/80	1.6	07/06
			TCE	12.0	07/06	12.0	07/06
			CTC	0.5	07/06	0.5	07/06
			1,2-DCA	0.5	07/06	0.5	07/06
			NITRATE (N)	7.0	08/00	ND	07/06
			CLO4	120.0	04/99	ND	07/06
			CLO4	120.0	04/99	ND	07/06

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)				REMARKS					
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT						
				VALUE	DATE	VALUE		DATE				
04	MUNICIPAL	INACTIVE	AS	5.4	07/95	ND	08/04					
			CR6	6.9	11/00	6.9	11/00					
			PCE	2.4	08/01	0.5	07/06					
			TCE	8.0	11/01	1.7	07/06					
			1,1-DCE	0.9	09/02	0.6	07/06					
			1,2-DCA	1.0	11/01	ND	07/06					
			CTC	0.7	11/01	ND	07/05					
			NITRATE (N)	9.5	06/02	7.5	04/07					
			CLO4	14.8	06/01	6.5	01/06					
			AS	6.9	07/95	2.8	08/01					
			CR6	8.9	11/00	8.4	06/01					
			05	MUNICIPAL	ACTIVE	PCE	14.0		11/19	7.9	11/22	VULNERABLE (VOC,NO3(N),CLO4,AS)
						TCE	6.8		04/96	3.1	11/22	
1,2-DCA	0.7	09/02				ND	08/22					
1,1-DCE	3.6	11/19				2.6	11/22					
NITRATE (N)	7.3	07/16				6.2	11/22					
CLO4	11.0	04/04				ND	05/17					
AS	6.8	07/95				2.3	11/21					
CR6	8.3	05/11				7.9	11/21					
05TH AVE	MUNICIPAL	DESTROYED				TCE	0.3	12/80	0.3	12/80		
						NITRATE (N)	NA	NA	NA	NA		
			CLO4	NA	NA	NA	NA					
<b>KNIGHT, KATHRYN M.</b>												
NA	DOMESTIC	INACTIVE	VOCS	NA	NA	NA	NA					
			NITRATE (N)	NA	NA	NA	NA					
			CLO4	NA	NA	NA	NA					
<b>LANDEROS, JOHN</b>												
NA	DOMESTIC	INACTIVE	VOCS	NA	NA	NA	NA					
			NITRATE (N)	NA	NA	NA	NA					
			CLO4	NA	NA	NA	NA					
<b>LA PUENTE VALLEY COUNTY WATER DISTRICT</b>												
01	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA					
			NITRATE (N)	NA	NA	NA	NA					
			CLO4	NA	NA	NA	NA					
02	MUNICIPAL	ACTIVE	TCE	120.0	12/12	25.0	12/22	VULNERABLE (VOC,NO3(N),CLO4)				
			PCE	6.6	03/00	1.1	12/22					
			CTC	8.5	12/02	1.5	10/22					
			1,1-DCA	2.1	11/03	ND	10/22					
			1,2-DCA	6.1	03/00	0.9	10/22					
			1,1-DCE	1.6	12/00	ND	10/22					
			C-1,2-DCE	1.9	04/10	0.5	10/22					
			NITRATE (N)	8.2	05/22	6.5	12/22					
			CLO4	183.0	02/98	20.0	12/22					
			AS	1.9	04/06	ND	06/22					
			CR6	4.2	06/22	4.2	06/22					
			03	MUNICIPAL	ACTIVE	TCE	72.0		03/11	ND	06/22	VULNERABLE (VOC,NO3(N),CLO4)
						PCE	6.3		04/85	ND	06/22	
CTC	8.5	11/04				ND	06/22					
1,1-DCE	0.9	10/95				ND	06/22					
1,2-DCA	6.7	02/99				ND	06/22					
C-1,2-DCE	1.4	01/97				ND	06/22					
1,1-DCA	0.5	09/01				ND	06/22					
NITRATE (N)	21.5	01/80				8.5	10/22					
CLO4	174.0	02/98				8.3	12/22					
AS	2.1	08/04				1.2	10/22					
CR6	4.6	10/22				4.6	10/22					
04	MUNICIPAL	INACTIVE				TCE	84.3	03/00	46.0	04/04		
						PCE	6.6	03/00	2.9	04/04		
			CTC	7.6	04/95	1.9	04/04					
			1,1-DCA	0.7	04/04	0.7	04/04					
			1,2-DCA	8.1	03/00	4.4	04/04					
			1,1-DCE	1.3	04/97	0.5	04/04					
			C-1,2-DCE	15.6	11/98	1.7	04/04					
			NITRATE (N)	5.6	04/95	4.1	04/04					
			CLO4	159.0	06/97	71.2	04/04					
			AS	2.3	09/94	ND	11/98					
CR6	4.3	11/00	4.3	11/00								
05	MUNICIPAL	ACTIVE	TCE	43.0	03/08	4.1	12/22	VULNERABLE (VOC,NO3(N),CLO4)				
			PCE	3.8	03/08	0.5	03/22					
			CTC	2.3	03/08	ND	03/22					
			1,1-DCA	0.5	03/08	ND	03/22					

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)				REMARKS	
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE		DATE
			1,2-DCA	2.7	03/08	ND	03/22	
			1,1-DCE	0.5	03/08	ND	03/22	
			C-1,2-DCE	0.8	11/08	ND	03/22	
			NITRATE (N)	8.3	03/21	8.3	12/22	
			CLO4	65.0	03/08	12.0	12/22	
			AS	1.1	03/08	ND	03/21	
			CR6	4.1	03/21	4.1	03/21	
<b>LA VERNE, CITY OF</b>								
SNIDO	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
W15-L	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
W24-L	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>LEE, PAUL</b>								
01	DOMESTIC	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
02	DOMESTIC	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
03	DOMESTIC	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
04	DOMESTIC	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>LOS ANGELES, COUNTY OF</b>								
02	NON POTABLE	DESTROYED	PCE	6.6	09/04	6.6	09/04	
			TCE	1.3	09/04	1.3	09/04	
			1,2-DCA	0.5	01/96	ND	09/04	
			NITRATE (N)	2.4	09/04	2.4	09/04	
			CLO4	ND	08/97	ND	08/97	
03	IRRIGATION	DESTROYED	PCE	2.1	06/94	2.1	06/94	
			TCE	0.7	06/94	0.7	06/94	
			NITRATE (N)	1.1	06/94	1.1	06/94	
			CLO4	NA	NA	NA	NA	
03A	IRRIGATION	DESTROYED	PCE	2.5	11/99	ND	10/08	
			NITRATE (N)	0.5	08/96	ND	10/08	
			CLO4	ND	08/97	ND	08/97	
04	IRRIGATION	DESTROYED	1,1,1-TCA	0.7	05/87	ND	11/87	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
05	IRRIGATION	DESTROYED	PCE	39.0	09/03	35.7	10/08	
			TCE	1.3	09/03	ND	10/08	
			NITRATE (N)	4.1	09/03	3.2	10/08	
			CLO4	ND	08/97	ND	08/97	
06	IRRIGATION	DESTROYED	PCE	7.4	08/96	2.8	11/99	
			TCE	8.3	08/96	2.9	11/99	
			1,1-DCA	2.0	08/96	ND	11/99	
			1,1-DCE	1.4	08/96	ND	11/99	
			C-1,2-DCE	4.5	08/96	0.8	11/99	
			NITRATE (N)	2.6	08/96	1.9	11/99	
			CLO4	NA	NA	NA	NA	
600	IRRIGATION	INACTIVE	VOCS	ND	07/98	ND	07/98	
			NITRATE (N)	1.1	07/98	1.1	07/98	
			CLO4	ND	07/98	ND	07/98	
BIG RED	NON POTABLE	INACTIVE	1,2-DCA	0.6	01/96	ND	10/09	
			NITRATE (N)	2.7	09/02	ND	10/09	
			CLO4	ND	08/97	ND	08/97	
NEW LAKE	NON POTABLE	INACTIVE	PCE	19.7	02/00	ND	11/10	
			TCE	0.9	02/00	ND	11/10	
			NITRATE (N)	5.0	02/00	4.1	11/10	



WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE	DATE	
			CLO4	ND	08/97	ND	08/97	
SF 1	NON POTABLE	ACTIVE	TCE	4.3	09/04	ND	10/20	
			PCE	7.6	09/04	ND	10/20	
			VC	1.4	12/87	ND	10/20	
			NITRATE (N)	3.6	09/02	1.9	10/20	
			CLO4	ND	06/97	ND	05/10	
SF 2	NON POTABLE	ACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
WHI 1	NON POTABLE	INACTIVE	PCE	3.8	09/04	1.4	11/10	
			TCE	1.0	09/04	ND	11/10	
			NITRATE (N)	1.7	10/09	1.2	11/10	
			CLO4	ND	08/97	ND	08/97	
<b>LOS FLORES MUTUAL WATER COMPANY</b>								
HI 1	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
LO 1	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>LOUCKS, DAVID</b>								
NA	DOMESTIC	INACTIVE	VOCS	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>MAECHTLEN ESTATE</b>								
M-N	DOMESTIC	INACTIVE	VOCS	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
OLD60	DOMESTIC	INACTIVE	VOCS	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
SNIDO	DOMESTIC	INACTIVE	VOCS	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>MANNING BROTHERS ROCK AND SAND COMPANY</b>								
36230	INDUSTRIAL	DESTROYED	TCE	520.0	12/79	100.0	01/80	
			CLO4	NA	NA	NA	NA	
<b>MAPLE WATER COMPANY</b>								
01	MUNICIPAL	DESTROYED	VOCS	ND	06/89	ND	07/96	
			NITRATE (N)	15.4	09/94	12.5	07/96	
			CLO4	NA	NA	NA	NA	
			AS	1.3	07/96	1.3	07/96	
02	MUNICIPAL	DESTROYED	VOCS	ND	06/89	ND	07/96	
			NITRATE (N)	14.2	11/89	12.5	07/96	
			CLO4	NA	NA	NA	NA	
			AS	1.3	07/96	1.3	07/96	
<b>MARTINEZ, FRANCES M.</b>								
NA	DOMESTIC	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>METROPOLITAN WATER DISTRICT OF SOUTHERN CALIFORNIA</b>								
02	NON-POTABLE	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
03	NON-POTABLE	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>MOON VALLEY NURSERY (COINER, JAMES W., DBA COINER NURSERY)</b>								
03	NON-POTABLE	INACTIVE	PCE	293.5	02/98	170.0	10/01	
			TCE	10.2	11/87	3.4	10/01	
			CTC	1.6	08/87	1.6	10/01	
			1,1-DCE	6.7	02/98	4.6	10/01	
			C-1,2-DCE	6.8	07/96	2.7	10/01	
			1,1,1-TCA	22.0	02/98	12.0	10/01	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)						REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT			
				VALUE	DATE	VALUE	DATE		
05R	NON-POTABLE	ACTIVE	NITRATE (N)	15.1	10/01	10.1	09/07		
			CLO4	9.0	02/98	ND	09/98		
			PCE	7.7	02/98	1.0	10/20		
			TCE	1.6	10/01	ND	10/20		
			CTC	2.7	07/96	ND	10/20		
			1,1-DCE	5.5	10/01	ND	10/20		
			NITRATE (N)	24.8	10/09	7.7	10/20		
			CLO4	9.0	02/98	4.0	09/98		
<b>MONROVIA, CITY OF</b>									
01	MUNICIPAL	DESTROYED	TCE	46.8	11/92	12.0	04/02		
			PCE	3.9	03/81	0.8	04/02		
			1,1-DCE	1.2	08/96	0.9	04/02		
			1,1,1-TCA	2.1	08/87	ND	07/01		
			NITRATE (N)	17.6	02/01	13.6	03/02		
			CLO4	11.1	02/01	8.4	04/02		
			AS	2.5	10/00	2.5	10/00		
02	MUNICIPAL	ACTIVE	TCE	167.0	08/82	9.5	12/22	VULNERABLE (VOC,CLO4,NO3(N))	
			PCE	11.0	08/82	0.6	12/22		
			1,1,1-TCA	7.1	02/87	ND	07/22		
			1,1-DCE	3.4	06/87	0.7	10/22		
			1,2-DCA	1.5	02/87	ND	07/22		
			NITRATE (N)	16.0	04/18	14.0	12/22		
			CLO4	6.9	04/15	5.3	12/22		
			AS	0.9	08/96	ND	04/22		
			CR6	7.1	04/16	4.0	04/22		
03	MUNICIPAL	ACTIVE	TCE	18.0	08/82	1.9	12/22	VULNERABLE (VOC,NO3(N))	
			PCE	17.0	08/82	ND	12/22		
			1,1-DCE	0.8	12/08	ND	10/22		
			NITRATE (N)	11.2	05/76	2.6	12/22		
			CLO4	ND	08/97	ND	12/22		
			AS	3.6	08/97	ND	04/22		
			CR6	5.8	08/13	1.7	04/22		
04	MUNICIPAL	ACTIVE	TCE	6.5	02/91	ND	12/22	VULNERABLE (VOC,NO3(N))	
			PCE	1.0	02/91	ND	12/22		
			1,1-DCE	1.1	01/05	ND	10/22		
			NITRATE (N)	6.5	06/91	1.5	12/22		
			CLO4	ND	08/97	ND	12/22		
			AS	3.8	08/97	0.9	10/22		
			CR6	1.1	07/01	2.9	10/22		
05	MUNICIPAL	ACTIVE	TCE	8.2	10/18	1.4	12/22	VULNERABLE (VOC,NO3(N))	
			PCE	1.0	10/02	ND	12/22		
			1,1-DCE	1.0	10/02	ND	10/22		
			NITRATE (N)	6.6	01/91	3.6	12/22		
			CLO4	ND	08/97	ND	12/22		
			AS	1.0	08/96	ND	05/22		
			CR6	1.5	04/16	0.8	05/22		
06	MUNICIPAL	ACTIVE	TCE	28.0	10/20	14.0	12/22	VULNERABLE (VOC,NO3(N),CLO4)	
			PCE	2.8	01/19	1.6	10/22		
			1,1-DCE	0.8	10/07	0.6	10/22		
			NITRATE (N)	9.5	06/14	5.7	12/22		
			CLO4	4.9	06/14	ND	12/22		
			AS	ND	10/99	ND	04/22		
			CR6	3.5	04/16	3.0	04/22		
<b>MONROVIA NURSERY</b>									
DIV 4	IRRIGATION	DESTROYED	VOCS	ND	08/96	ND	02/07		
			NITRATE (N)	48.1	09/04	45.6	02/07		
			CLO4	ND	02/98	ND	02/98		
DIV 8	IRRIGATION	INACTIVE	VOCS	NA	NA	NA	NA		
			NITRATE (N)	NA	NA	NA	NA		
			CLO4	NA	NA	NA	NA		
<b>MONTEREY PARK, CITY OF</b>									
01	MUNICIPAL	ACTIVE	PCE	64.1	12/08	21.0	12/22	VULNERABLE (VOC,NO3(N),CLO4)	
			TCE	4.1	05/04	ND	11/22		
			1,1-DCE	0.6	05/04	ND	11/22		
			1,1-DCA	1.0	05/04	ND	11/22		
			C-1,2-DCE	1.0	03/04	ND	11/22		
			NITRATE (N)	5.4	12/12	2.4	12/22		
			CLO4	4.7	05/04	ND	12/22		
			AS	0.5	07/96	ND	08/20		
			CR6	6.2	11/00	4.7	08/20		

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE	DATE	
02	MUNICIPAL	DESTROYED	PCE	6.4	04/98	6.4	04/98	
			NITRATE (N)	4.1	07/95	2.9	07/97	
			CLO4	3.0	07/97	ND	03/98	
			AS	0.4	07/96	0.4	07/96	
03	MUNICIPAL	ACTIVE	PCE	39.0	08/22	35.0	12/22	VULNERABLE (VOC,CLO4,AS)
			TCE	2.7	05/04	1.1	12/22	
			C-1,2-DCE	0.8	05/04	ND	11/22	
			NITRATE (N)	3.0	07/97	2.2	12/22	
			CLO4	4.2	05/04	ND	12/22	
			AS	12.9	08/89	2.7	08/22	
			CR6	3.5	08/22	3.5	08/22	
04	MUNICIPAL	DESTROYED	PCE	0.4	01/80	ND	11/87	
			NITRATE (N)	1.4	09/87	1.4	09/87	
			CLO4	NA	NA	NA	NA	
05	MUNICIPAL	ACTIVE	PCE	40.0	06/13	2.9	11/22	VULNERABLE (VOC,NO3(N),CLO4)
			TCE	7.0	01/92	ND	11/22	
			C-1,2-DCE	2.0	11/01	ND	11/22	
			1,1-DCA	1.1	11/01	ND	11/22	
			1,1-DCE	0.7	11/01	ND	11/22	
			NITRATE (N)	6.1	11/15	4.6	11/22	
			CLO4	6.5	02/01	ND	11/22	
			AS	1.5	10/12	ND	11/21	
CR6	4.9	11/21	4.9	11/21				
06	MUNICIPAL	INACTIVE	PCE	13.6	03/01	3.1	05/05	
			TCE	6.4	05/89	3.1	05/05	
			C-1,2-DCE	1.3	01/99	1.2	05/05	
			1,1-DCA	0.8	11/01	0.6	05/05	
			NITRATE (N)	6.8	06/03	5.6	05/05	
			CLO4	5.9	04/02	5.9	04/02	
			AS	2.2	09/00	ND	08/02	
			CR6	4.1	11/00	3.4	05/01	
07	MUNICIPAL	INACTIVE	PCE	6.0	09/10	6.0	09/10	
			NITRATE (N)	2.9	08/89	0.6	08/10	
			CLO4	ND	08/97	ND	08/10	
			AS	28.4	07/96	2.1	08/09	
			CR6	5.3	02/07	5.1	01/10	
08	MUNICIPAL	INACTIVE	PCE	2.5	02/05	1.9	03/09	
			NITRATE (N)	3.8	08/05	ND	11/08	
			CLO4	ND	08/97	ND	11/08	
			AS	45.0	03/09	45.0	03/09	
			CR6	6.7	12/01	6.7	12/01	
09	MUNICIPAL	ACTIVE	PCE	13.0	05/15	ND	11/22	VULNERABLE (VOC,AS)
			TCE	1.3	04/97	ND	11/22	
			NITRATE (N)	4.1	07/12	ND	11/22	
			CLO4	ND	08/97	ND	11/22	
			AS	15.0	06/07	13.0	02/22	
			CR6	3.4	11/00	2.6	02/22	
10	MUNICIPAL	ACTIVE	PCE	17.0	02/12	14.0	12/22	VULNERABLE (VOC,NO3(N),CLO4,AS)
			TCE	2.6	05/04	0.7	12/22	
			C-1,2-DCE	0.8	05/04	ND	11/22	
			NITRATE (N)	7.3	12/22	7.3	12/22	
			CLO4	4.3	05/04	ND	12/22	
			AS	6.7	07/98	1.9	08/22	
			CR6	6.6	11/00	6.5	08/22	
12	MUNICIPAL	ACTIVE	PCE	85.0	05/02	37.0	12/22	VULNERABLE (VOC,NO3(N),CLO4)
			TCE	5.4	10/95	2.0	12/22	
			1,1-DCA	1.3	05/12	0.7	11/22	
			1,1-DCE	0.5	05/12	ND	11/22	
			C-1,2-DCE	1.4	05/12	ND	11/22	
			NITRATE (N)	6.1	08/07	2.6	12/22	
			CLO4	15.0	09/97	ND	12/22	
			AS	ND	04/81	ND	08/22	
			CR6	4.6	02/07	3.6	08/22	
14	MUNICIPAL	INACTIVE	PCE	2.2	05/02	0.7	05/06	
			TCE	2.9	11/02	1.5	05/06	
			1,1-DCA	0.8	08/02	ND	05/06	
			C-1,2-DCE	1.0	11/02	ND	05/06	
			NITRATE (N)	2.3	10/06	2.3	10/06	
			CLO4	ND	08/97	ND	05/03	
			AS	41.0	08/05	39.0	03/06	
CR6	1.0	11/00	1.0	05/01				
15	MUNICIPAL	ACTIVE	PCE	190.0	02/12	40.0	12/22	VULNERABLE (VOC,NO3(N))
			TCE	3.6	03/15	2.2	12/22	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)				REMARKS	
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE		DATE
			C-1,2-DCE	0.8	08/16	0.7	11/22	
			1,1-DCA	0.7	08/16	ND	11/22	
			NITRATE (N)	5.2	11/08	3.4	12/22	
			CLO4	2.4	07/06	ND	12/22	
			AS	ND	09/06	ND	08/18	
			CR6	2.9	02/07	ND	08/15	
FERN	MUNICIPAL	ACTIVE	PCE	12.0	08/10	ND	12/22	VULNERABLE (VOC,AS)
			TCE	2.8	10/16	ND	12/22	
			C-1,2-DCE	0.7	03/04	ND	11/22	
			NITRATE (N)	1.5	03/04	ND	12/22	
			CLO4	2.0	08/97	ND	12/22	
			AS	16.0	07/16	16.0	11/22	
			CR6	1.5	11/00	ND	11/22	
<b>MUNOZ, RALPH</b>								
MUNOZ	IRRIGATION	ACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>NAMIMATSU FARMS</b>								
NA	IRRIGATION	INACTIVE	VOCS	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>OWL ROCK PRODUCTS COMPANY</b>								
NA	INDUSTRIAL	INACTIVE	VOCS	ND	05/87	ND	10/09	
			NITRATE (N)	2.0	08/89	ND	10/09	
			CLO4	NA	NA	NA	NA	
NA	INDUSTRIAL	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
NA	INDUSTRIAL	INACTIVE	VOCS	ND	10/02	ND	10/20	
			NITRATE (N)	ND	10/17	ND	10/20	
			CLO4	NA	NA	NA	NA	
<b>PICO COUNTY WATER DISTRICT</b>								
NA	MUNICIPAL	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>POLOPOLUS ET AL.</b>								
01	IRRIGATION	INACTIVE	PCE	330.0	10/96	270.0	03/98	
			TCE	498.9	09/92	180.0	03/98	
			1,1-DCA	22.0	03/98	22.0	03/98	
			1,2-DCA	1.2	06/96	0.9	03/98	
			1,1-DCE	115.3	09/92	22.0	03/98	
			T-1,2-DCE	1.5	06/87	ND	03/98	
			1,1,1-TCA	53.0	09/92	12.0	03/98	
			CTC	0.8	06/96	0.6	03/98	
			NITRATE (N)	11.5	07/91	6.7	03/98	
			CLO4	ND	03/98	ND	03/98	
<b>PROGRESSIVE BUDDHIST ASSOCIATION</b>								
NA	IRRIGATION	ACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>RICHWOOD MUTUAL WATER COMPANY</b>								
NORTH 2	MUNICIPAL	DESTROYED	PCE	93.0	05/83	4.0	12/93	
			TCE	3.0	03/81	ND	05/92	
			CTC	0.2	10/80	ND	05/92	
			NITRATE (N)	5.6	02/84	4.5	06/99	
			CLO4	NA	NA	NA	NA	
			AS	ND	06/90	ND	09/92	
SOUTH 1	MUNICIPAL	DESTROYED	PCE	96.0	05/83	3.4	12/93	
			TCE	0.7	12/82	ND	05/92	
			NITRATE (N)	6.5	06/99	6.5	06/99	
			CLO4	NA	NA	NA	NA	
			AS	ND	06/90	ND	09/92	
<b>ROY, RUTH</b>								
NA	DOMESTIC	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE	DATE	
			CLO4	NA	NA	NA	NA	
<b>RURBAN HOMES MUTUAL WATER COMPANY</b>								
NORTH 1	MUNICIPAL	INACTIVE	PCE	16.0	11/80	ND	09/18	VULNERABLE (VOC.NO3(N))
			1,1-DCE	0.9	09/08	ND	09/18	
			FREON 11	13.3	05/04	ND	09/18	
			FREON 113	64.4	05/04	ND	09/18	
			NITRATE (N)	6.8	03/01	2.4	09/18	
			CLO4	ND	09/97	ND	09/18	
			AS	3.0	08/03	2.6	09/18	
			CR6	1.0	06/01	ND	09/15	
SOUTH 2	MUNICIPAL	INACTIVE	PCE	24.3	02/81	ND	03/13	
			1,1-DCE	1.7	10/08	ND	03/13	
			FREON 11	14.1	05/04	ND	03/13	
			FREON 113	54.2	05/04	ND	03/13	
			NITRATE (N)	8.6	03/07	4.7	03/13	
			CLO4	ND	09/97	ND	06/11	
			AS	3.0	08/03	2.1	09/12	
			CR6	1.0	06/01	ND	12/01	
<b>SAN GABRIEL COUNTRY CLUB</b>								
01	IRRIGATION	ACTIVE	PCE	3.8	12/20	3.8	12/20	
			NITRATE (N)	15.1	07/96	8.0	12/20	
			CLO4	8.5	07/97	5.4	08/05	
02	IRRIGATION	ACTIVE	VOCS	ND	05/87	ND	12/20	
			NITRATE (N)	12.0	12/19	12.0	12/20	
			CLO4	1.4	12/97	1.1	08/05	
<b>SAN GABRIEL COUNTY WATER DISTRICT</b>								
05 BRA	MUNICIPAL	INACTIVE	TCE	0.9	01/97	ND	03/01	
			PCE	1.9	02/99	1.0	03/01	
			NITRATE (N)	19.0	08/89	16.0	03/01	
			CLO4	ND	09/97	ND	09/00	
			AS	0.6	08/96	ND	08/98	
			CR6	7.0	12/00	7.0	12/00	
06 BRA	MUNICIPAL	DESTROYED	VOCS	ND	02/99	ND	02/99	
			NITRATE (N)	24.6	08/72	13.0	03/00	
			CLO4	3.0	02/99	3.0	02/99	
07	MUNICIPAL	DESTROYED	VOCS	ND	09/89	ND	10/11	
			NITRATE (N)	10.8	03/03	7.9	10/11	
			CLO4	5.6	03/03	ND	10/11	
			AS	1.3	08/96	ND	07/09	
			CR6	4.5	07/01	4.5	07/01	
08	MUNICIPAL	INACTIVE	VOCS	ND	01/90	ND	03/91	
			NITRATE (N)	17.2	01/82	5.3	08/93	
			CLO4	NA	NA	NA	NA	
			AS	ND	06/78	ND	08/90	
09	MUNICIPAL	ACTIVE	PCE	3.9	07/18	3.3	10/22	VULNERABLE (VOC.NO3(N))
			NITRATE (N)	11.5	03/03	5.1	12/22	
			CLO4	ND	09/97	ND	07/22	
			AS	ND	09/89	ND	07/21	
			CR6	8.1	12/02	7.8	07/21	
10	MUNICIPAL	INACTIVE	PCE	18.0	08/93	1.9	11/98	
			NITRATE (N)	11.3	05/89	7.0	11/98	
			CLO4	5.5	11/98	5.5	11/98	
			AS	ND	06/78	ND	11/98	
11	MUNICIPAL	ACTIVE	PCE	5.0	01/19	4.7	10/22	VULNERABLE (VOC.NO3(N))
			TCE	0.7	10/18	ND	10/22	
			NITRATE (N)	16.0	10/20	13.0	12/22	
			CLO4	2.4	10/21	2.2	10/22	
			AS	ND	06/78	ND	07/22	
			CR6	25.0	12/00	7.6	07/22	
12	MUNICIPAL	ACTIVE	TCE	0.8	09/02	ND	07/22	VULNERABLE (AS)
			PCE	1.2	10/18	ND	10/22	
			NITRATE (N)	2.3	07/21	1.0	12/22	
			CLO4	ND	09/97	ND	07/22	
			AS	7.0	10/96	5.9	07/20	
			CR6	7.6	07/01	6.3	07/20	
14	MUNICIPAL	ACTIVE	PCE	0.6	09/02	ND	07/22	
			NITRATE (N)	4.4	02/17	1.0	11/22	
			CLO4	ND	09/97	ND	07/22	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)				REMARKS	
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE		DATE
15	MUNICIPAL	ACTIVE	AS	3.1	07/08	2.9	07/20	VULNERABLE (VOC,NO3(N))
			CR6	4.6	07/01	3.1	07/20	
			TCE	0.6	09/21	ND	10/22	
			PCE	3.4	04/19	2.3	10/22	
			NITRATE (N)	7.6	09/21	6.6	12/22	
			CLO4	ND	12/14	ND	04/22	
			AS	2.7	04/20	2.7	04/20	
CR6	3.6	11/14	1.7	04/20				
<b>SAN GABRIEL VALLEY WATER COMPANY</b>								
1B	MUNICIPAL	ACTIVE	PCE	46.0	04/81	ND	05/22	VULNERABLE (VOC,NO3(N))
			TCE	1.8	02/80	ND	11/21	
			FREON 113	22.3	08/08	ND	05/22	
			NITRATE (N)	5.1	05/08	1.6	05/22	
			CLO4	ND	08/97	ND	08/21	
			AS	2.9	07/96	2.0	08/20	
			CR6	1.0	05/14	1.0	08/20	
1C	MUNICIPAL	DESTROYED	VOCS	ND	07/98	ND	08/17	
			NITRATE (N)	1.9	08/11	1.1	08/17	
			CLO4	ND	10/99	ND	08/17	
			AS	2.6	09/94	2.1	08/15	
			CR6	1.0	05/01	ND	08/15	
1D	MUNICIPAL	ACTIVE	VOCS	ND	07/98	ND	09/22	
			NITRATE (N)	1.1	07/89	0.8	09/22	
			CLO4	ND	08/97	ND	09/22	
			AS	2.0	11/06	ND	08/21	
			CR6	1.0	05/01	ND	11/15	
1E	MUNICIPAL	ACTIVE	PCE	0.7	09/02	ND	11/22	VULNERABLE (CLO4)
			NITRATE (N)	1.1	11/16	0.9	09/22	
			CLO4	5.0	06/00	ND	09/22	
			AS	2.7	11/08	ND	08/20	
			CR6	1.0	05/01	ND	08/20	
2C	MUNICIPAL	DESTROYED	TCE	15.2	12/80	ND	11/05	
			PCE	3.0	10/87	ND	11/05	
			NITRATE (N)	3.7	08/04	1.2	08/05	
			CLO4	ND	08/97	ND	02/03	
			AS	ND	07/89	ND	08/05	
2D	MUNICIPAL	ACTIVE	TCE	25.0	12/80	ND	11/22	VULNERABLE (VOC)
			PCE	0.9	03/17	ND	11/22	
			NITRATE (N)	1.9	08/15	1.2	11/22	
			CLO4	ND	08/97	ND	11/22	
			AS	ND	07/89	ND	08/20	
			CR6	3.2	08/17	1.3	08/20	
2E	MUNICIPAL	ACTIVE	TCE	18.0	01/80	ND	12/22	VULNERABLE (VOC)
			PCE	3.6	09/16	1.2	12/22	
			NITRATE (N)	4.5	08/15	2.0	11/22	
			CLO4	ND	08/97	ND	11/22	
			AS	ND	07/89	ND	08/20	
			CR6	3.8	08/17	1.7	08/20	
2F	MUNICIPAL	ACTIVE	TCE	1.3	02/15	ND	12/22	
			PCE	1.4	11/18	ND	12/22	
			NITRATE (N)	2.5	08/15	1.0	12/22	
			CLO4	ND	09/06	ND	11/22	
			AS	0.7	03/06	ND	12/21	
			CR6	3.1	08/15	2.0	12/21	
8A	MUNICIPAL	INACTIVE	PCE	0.6	11/87	ND	02/97	
			NITRATE (N)	9.1	02/97	9.1	02/97	
			CLO4	NA	NA	NA	NA	
			AS	ND	07/89	ND	07/89	
8B	MUNICIPAL	ACTIVE	PCE	220.0	02/09	110.0	12/22	VULNERABLE (VOC,NO3(N))
			TCE	1.2	11/15	1.1	12/22	
			NITRATE (N)	5.2	08/08	4.0	10/22	
			CLO4	3.0	08/97	ND	12/22	
			AS	0.4	07/96	ND	08/21	
			CR6	2.9	11/02	2.4	08/15	
8C	MUNICIPAL	ACTIVE	PCE	170.0	05/09	160.0	11/22	VULNERABLE (VOC,CLO4)
			TCE	1.5	11/22	1.5	11/22	
			NITRATE (N)	4.5	07/98	2.2	12/22	
			CLO4	4.0	03/08	ND	12/22	
			AS	0.5	07/96	ND	08/21	
			CR6	3.5	08/21	3.5	08/21	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE	DATE	
8D	MUNICIPAL	ACTIVE	PCE	180.0	11/18	120.0	12/22	VULNERABLE (VOC,NO3(N),AS)
			TCE	1.8	12/22	1.8	12/22	
			C-1,2-DCE	0.8	05/04	ND	05/22	
			CTC	0.6	06/88	ND	05/22	
			NITRATE (N)	6.6	06/09	4.0	12/22	
			CLO4	2.3	03/08	ND	12/22	
			AS	29.5	09/94	ND	05/20	
			CR6	3.3	11/00	3.0	05/20	
			8E	MUNICIPAL	ACTIVE	PCE	19.0	
NITRATE (N)	1.6	07/01				0.3	12/22	
CLO4	ND	08/97				ND	12/22	
AS	2.8	08/95				0.9	08/22	
CR6	4.8	08/16				4.3	08/22	
8F	MUNICIPAL	ACTIVE	VOCS	ND	10/98	ND	08/22	
			NITRATE (N)	4.3	11/10	0.3	08/22	
			CLO4	ND	01/99	ND	12/22	
			AS	2.9	11/19	1.8	08/22	
			CR6	8.4	11/19	6.0	08/22	
11A	MUNICIPAL	ACTIVE	PCE	1.5	02/08	ND	12/22	
			NITRATE (N)	3.3	07/89	1.4	08/22	
			CLO4	ND	08/97	ND	08/22	
			AS	3.9	07/96	3.3	08/21	
			CR6	7.3	05/01	7.3	08/21	
11B	MUNICIPAL	ACTIVE	PCE	17.8	04/90	ND	11/22	VULNERABLE (VOC)
			TCE	4.0	04/90	ND	11/22	
			1,1-DCE	0.2	04/89	ND	02/22	
			C-1,2-DCE	3.0	04/89	ND	02/22	
			NITRATE (N)	4.7	11/20	4.4	02/22	
			CLO4	ND	06/97	ND	02/22	
			AS	4.8	09/94	2.1	02/22	
			CR6	6.1	11/00	1.8	02/22	
			11C	MUNICIPAL	ACTIVE	PCE	4.1	
TCE	0.6	12/91				ND	12/22	
1,1-DCE	1.1	08/08				ND	08/22	
C-1,2-DCE	2.5	03/92				ND	11/22	
NITRATE (N)	2.7	08/06				0.9	08/22	
CLO4	ND	08/97				ND	08/22	
AS	7.5	07/96				2.6	08/21	
CR6	4.8	05/01				0.6	08/21	
11D	MUNICIPAL	ACTIVE				VOCS	ND	05/19
			NITRATE (N)	1.2	11/20	1.2	05/22	
			CLO4	ND	05/19	ND	05/22	
			AS	2.4	05/21	2.4	05/21	
			CR6	1.2	05/21	1.2	05/21	
B1	MUNICIPAL	INACTIVE	TCE	12.0	04/85	ND	08/06	
			PCE	7.3	05/88	ND	08/06	
			C-1,2-DCE	7.2	12/92	ND	08/06	
			1,1-DCE	2.1	08/89	ND	08/06	
			NITRATE (N)	3.9	02/87	0.8	03/05	
			CLO4	ND	08/97	ND	02/03	
			AS	2.8	07/96	2.3	02/05	
B2	MUNICIPAL	INACTIVE	TCE	17.0	03/80	ND	11/98	
			PCE	15.8	06/80	0.7	11/98	
			CTC	1.7	05/82	ND	11/98	
			1,2-DCA	7.7	07/82	ND	11/98	
			1,1,1-TCA	7.6	07/82	ND	11/98	
			C-1,2-DCE	2.6	08/93	ND	11/98	
			NITRATE (N)	2.0	11/98	2.0	11/98	
			CLO4	ND	11/98	ND	11/98	
B4B	MUNICIPAL	INACTIVE	TCE	25.2	02/08	25.2	02/08	
			PCE	43.0	11/07	5.8	02/08	
			CTC	10.0	11/03	6.6	02/08	
			1,2-DCA	1.0	09/07	0.5	02/08	
			1,1-DCE	3.2	11/07	2.3	02/08	
			C-1,2-DCE	4.2	11/07	2.7	02/08	
			NITRATE (N)	3.0	11/07	3.0	11/07	
			CLO4	24.5	04/08	24.5	04/08	
			AS	6.3	08/95	2.0	02/08	
			CR6	4.1	05/01	4.1	05/01	
B4C	MUNICIPAL	INACTIVE	CTC	22.3	02/01	14.0	08/01	
			TCE	15.5	02/01	9.3	08/01	
			PCE	3.4	02/01	2.2	08/01	
			1,1-DCE	2.3	09/01	2.3	09/01	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)				REMARKS	
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE		DATE
			C-1,2-DCE	2.4	09/01	2.4	09/01	
			NITRATE (N)	3.2	02/01	3.2	02/01	
			CLO4	6.0	06/00	ND	07/00	
			AS	5.8	08/95	ND	03/99	
			CR6	3.3	05/01	3.3	05/01	
B5A	MUNICIPAL	INACTIVE	PCE	17.5	03/91	ND	11/05	
			TCE	5.2	03/98	ND	11/05	
			1,1-DCE	2.5	03/85	ND	08/05	
			CTC	1.1	12/91	ND	11/05	
			1,1,1-TCA	3.7	03/90	ND	08/05	
			NITRATE (N)	10.4	07/96	5.7	11/05	
			CLO4	14.0	06/97	4.0	08/05	
			AS	2.8	07/96	2.0	08/05	
			CR6	6.4	11/00	6.2	05/01	
B5B	MUNICIPAL	ACTIVE	TCE	5.8	02/97	2.3	12/22	VULNERABLE (VOC.NO3(N),CLO4)
			PCE	19.0	10/22	13.0	12/22	
			CTC	2.3	02/85	ND	11/22	
			1,1-DCE	1.1	11/19	1.1	11/22	
			1,2-DCA	0.6	09/07	ND	11/22	
			NITRATE (N)	12.7	12/12	9.2	12/22	
			CLO4	12.0	06/97	4.7	12/22	
			AS	2.4	08/16	2.0	11/22	
			CR6	7.1	08/16	5.2	11/22	
B5C	MUNICIPAL	INACTIVE	VOCS	ND	05/89	ND	08/07	
			NITRATE (N)	0.9	05/07	0.9	05/07	
			CLO4	ND	06/97	ND	03/08	
			AS	5.8	08/95	2.0	08/07	
			CR6	5.8	05/01	5.8	05/01	
B5D	MUNICIPAL	ACTIVE	CTC	1.2	11/15	0.9	11/22	VULNERABLE (VOC.NO3(N),CLO4)
			NITRATE (N)	7.4	08/18	0.8	12/22	
			CLO4	5.4	08/20	ND	12/22	
			AS	2.5	08/22	2.5	08/22	
			CR6	4.6	05/01	4.1	08/22	
B5E	MUNICIPAL	ACTIVE	TCE	27.0	11/19	19.0	12/22	VULNERABLE (VOC.NO3(N),CLO4)
			PCE	4.8	05/20	3.9	12/22	
			CTC	5.2	05/07	2.2	11/22	
			1,2-DCA	1.4	11/19	1.0	11/22	
			1,1-DCE	1.6	11/19	1.1	11/22	
			C-1,2-DCE	1.6	10/16	1.3	11/22	
			NITRATE (N)	5.9	08/15	4.6	12/22	
			CLO4	23.0	05/21	22.0	12/22	
			AS	3.0	08/07	2.7	08/19	
			CR6	7.0	02/09	6.7	08/19	
B6B	MUNICIPAL	DESTROYED	TCE	111.0	02/85	35.8	09/92	
			PCE	6.4	10/81	4.3	09/92	
			CTC	17.0	02/85	5.0	09/92	
			1,1-DCE	1.1	04/85	0.5	09/92	
			1,1-DCA	0.6	09/92	0.6	09/92	
			1,2-DCA	8.3	09/92	8.3	09/92	
			NITRATE (N)	19.3	02/91	12.9	09/92	
			CLO4	NA	NA	NA	NA	
B6C	MUNICIPAL	INACTIVE	TCE	84.0	03/88	1.3	08/16	VULNERABLE (VOC.NO3(N),CLO4)
			PCE	12.0	11/81	ND	08/16	
			CTC	13.0	02/85	ND	08/16	
			1,2-DCA	9.0	05/88	ND	08/16	
			1,1-DCE	1.5	06/94	ND	08/16	
			C-1,2-DCE	6.2	04/88	ND	08/16	
			NITRATE (N)	22.0	08/16	22.0	08/16	
			CLO4	370.0	11/05	18.0	08/16	
			AS	3.7	07/96	2.2	08/14	
			CR6	3.9	03/10	2.3	10/14	
B6D	MUNICIPAL	INACTIVE	TCE	140.0	05/11	45.0	05/17	VULNERABLE (VOC.NO3(N),CLO4)
			PCE	7.1	05/09	2.3	05/17	
			CTC	14.0	05/11	4.9	05/17	
			1,1-DCA	1.1	05/09	ND	05/17	
			1,2-DCA	3.7	05/11	1.1	05/17	
			1,1-DCE	1.0	08/08	ND	05/17	
			C-1,2-DCE	2.8	05/09	0.9	05/17	
			NITRATE (N)	6.6	05/15	5.5	08/17	
			CLO4	390.0	11/05	23.0	05/17	
			AS	3.1	07/96	2.4	08/17	
			CR6	2.9	10/14	2.6	08/17	
B7B	MUNICIPAL	DESTROYED	TCE	2.4	03/85	2.4	03/85	
			PCE	1.4	03/85	1.2	03/85	
			NITRATE (N)	2.8	08/87	2.8	08/87	



WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE	DATE	
			CLO4	NA	NA	NA	NA	
B7C	MUNICIPAL	DESTROYED	TCE	15.0	11/10	4.8	11/14	
			PCE	35.0	03/03	15.0	11/14	
			1,1-DCE	6.7	12/89	2.9	11/14	
			C-1,2-DCE	4.7	12/93	0.9	11/14	
			CTC	0.6	02/89	ND	08/14	
			NITRATE (N)	6.4	08/92	3.4	08/14	
			CLO4	ND	06/97	ND	08/14	
			AS	2.0	08/05	ND	08/14	
			CR6	5.0	05/01	3.5	05/11	
B7D	MUNICIPAL	DESTROYED	PCE	5.3	07/87	3.5	09/87	
			TCE	3.9	07/87	3.3	09/87	
			1,1-DCE	5.3	05/87	5.0	09/87	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
B7E	MUNICIPAL	ACTIVE	PCE	1.1	08/15	ND	12/22	
			NITRATE (N)	3.6	11/08	0.6	12/22	
			CLO4	ND	06/97	ND	05/22	
			AS	4.6	03/97	3.1	05/21	
			CR6	4.6	05/18	3.9	05/21	
B8	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
B9	MUNICIPAL	INACTIVE	TCE	37.0	02/85	34.7	01/87	
			PCE	4.9	01/87	4.9	01/87	
			CTC	8.3	01/87	8.3	01/87	
			NITRATE (N)	19.1	02/86	15.4	02/87	
			CLO4	NA	NA	NA	NA	
B9B	MUNICIPAL	ACTIVE	VOCS	ND	06/87	ND	08/22	
			NITRATE (N)	3.4	08/19	0.7	08/22	
			CLO4	1.2	03/08	ND	08/22	
			AS	3.5	08/95	1.5	08/22	
			CR6	9.8	05/01	9.0	08/22	
B11A	MUNICIPAL	DESTROYED	TCE	9.8	08/01	5.8	08/04	
			PCE	21.7	05/92	8.5	08/04	
			1,1-DCE	14.0	08/01	2.8	08/04	
			CTC	0.9	01/88	ND	08/04	
			C-1,2-DCE	1.5	08/01	0.6	09/04	
			1,1-DCA	1.0	08/01	ND	08/04	
			NITRATE (N)	8.5	03/00	8.2	08/04	
			CLO4	8.0	12/97	ND	08/04	
			AS	2.7	07/96	ND	09/02	
			CR6	10.0	06/01	10.0	06/01	
B11B	MUNICIPAL	ACTIVE	TCE	33.0	11/14	4.1	12/22	VULNERABLE (VOC,NO3(N),CLO4)
			PCE	34.5	06/92	5.6	12/22	
			CTC	0.8	08/16	ND	11/22	
			1,1-DCE	64.0	11/14	6.2	11/22	
			1,1-DCA	4.7	11/14	ND	11/22	
			1,1,1-TCA	2.9	10/88	ND	08/22	
			C-1,2-DCE	5.1	11/14	0.6	11/22	
			NITRATE (N)	10.4	11/14	3.6	11/22	
			CLO4	7.0	06/00	2.7	11/22	
			AS	2.2	07/96	ND	09/20	
			CR6	10.3	05/01	8.0	09/20	
B24A	MUNICIPAL	ACTIVE	PCE	0.5	02/19	ND	12/22	
			NITRATE (N)	2.9	02/15	0.4	02/22	
			CLO4	ND	01/07	ND	10/22	
			AS	2.4	02/16	ND	02/22	
			CR6	1.2	08/13	1.1	02/22	
B24B	MUNICIPAL	ACTIVE	PCE	9.2	08/18	ND	11/22	VULNERABLE (VOC)
			TCE	0.7	05/07	0.5	02/22	
			NITRATE (N)	3.4	02/14	1.2	02/22	
			CLO4	ND	01/07	ND	02/22	
			AS	2.8	02/16	ND	02/22	
			CR6	3.3	08/13	2.7	02/22	
B25A (SA3-1S)	MUNICIPAL	ACTIVE	TCE	120.0	11/21	68.0	12/22	VULNERABLE (VOC,NO3(N),CLO4)
			PCE	45.0	02/21	23.0	12/22	
			CTC	5.9	10/07	1.6	11/22	
			1,1-DCA	1.1	05/21	0.9	11/22	
			1,2-DCA	2.0	11/19	1.4	11/22	
			1,1-DCE	8.7	11/19	0.9	11/22	
			C-1,2-DCE	6.3	08/07	4.5	11/22	
			NITRATE (N)	17.6	05/09	11.0	12/22	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)						REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT			
				VALUE	DATE	VALUE	DATE		
			CLO4	55.0	05/19	47.0	12/22		
			AS	3.2	03/10	2.0	06/22		
			CR6	4.0	06/22	4.0	06/22		
B25B (SA3-1D)	MUNICIPAL	ACTIVE	TCE	70.0	11/21	52.0	12/22	VULNERABLE (VOC,NO3(N),CLO4)	
			PCE	13.0	08/16	5.9	12/22		
			CTC	10.0	09/04	4.4	11/22		
			1,1-DCA	1.2	10/07	ND	06/22		
			1,2-DCA	1.6	11/22	1.6	11/22		
			1,1-DCE	4.8	08/14	2.0	11/22		
			C-1,2-DCE	3.1	08/16	2.3	11/22		
			NITRATE (N)	6.1	05/09	2.2	12/22		
			CLO4	43.0	11/21	40.0	12/22		
			AS	3.0	03/06	2.6	06/22		
			CR6	2.8	06/22	2.8	06/22		
B26A (SA3-2S)	MUNICIPAL	ACTIVE	TCE	57.0	05/09	10.0	12/22		VULNERABLE (VOC,NO3(N),CLO4)
			PCE	6.8	12/10	1.0	12/22		
			CTC	5.4	12/10	ND	11/22		
			1,1-DCA	0.8	05/09	ND	11/22		
			1,2-DCA	4.3	11/04	0.6	11/22		
			1,1-DCE	2.0	12/10	ND	11/22		
			C-1,2-DCE	3.3	05/06	ND	11/22		
			NITRATE (N)	20.0	08/21	16.0	12/22		
			CLO4	87.0	07/06	25.0	12/22		
			AS	3.0	03/06	2.2	02/21		
			CR6	5.0	02/21	5.0	02/21		
B26B (SA3-2D)	MUNICIPAL	ACTIVE	TCE	200.0	11/21	94.0	12/22	VULNERABLE (VOC,NO3(N),CLO4)	
			PCE	4.1	11/21	2.6	12/22		
			CTC	17.0	08/16	9.4	11/22		
			1,2-DCA	3.7	11/19	2.5	11/22		
			1,1-DCE	0.6	08/16	0.5	11/22		
			C-1,2-DCE	1.9	11/21	1.4	11/22		
			NITRATE (N)	6.0	05/21	4.0	12/22		
			CLO4	73.0	11/21	56.0	12/22		
			AS	2.9	11/04	2.4	02/21		
			CR6	4.1	02/21	4.1	02/21		
EW4-5	MUNICIPAL	ACTIVE	PCE	29.0	10/06	22.0	12/11		VULNERABLE (VOC)
			TCE	4.1	10/06	1.6	12/11		
			NITRATE (N)	3.6	12/05	2.9	11/11		
			CLO4	ND	12/05	ND	11/11		
			AS	1.1	08/09	1.1	08/09		
EW4-6	MUNICIPAL	ACTIVE	PCE	8.1	06/06	4.7	12/11	VULNERABLE (VOC)	
			TCE	1.1	10/06	0.7	12/11		
			NITRATE (N)	3.4	11/06	3.4	11/11		
			CLO4	ND	05/06	ND	11/11		
			AS	1.0	08/09	1.0	08/09		
EW4-7	MUNICIPAL	ACTIVE	PCE	8.2	01/06	2.0	12/11	VULNERABLE (VOC)	
			TCE	1.8	02/06	ND	12/11		
			NITRATE (N)	4.1	01/06	2.9	11/11		
			CLO4	ND	12/05	ND	11/11		
			AS	1.8	08/09	1.8	08/09		
G4A	MUNICIPAL	ACTIVE	PCE	27.0	05/22	21.0	12/22	VULNERABLE (VOC, NO3(N))	
			TCE	1.8	11/18	0.7	12/22		
			NITRATE (N)	6.3	05/14	4.7	11/22		
			CLO4	1.0	03/08	ND	10/22		
			AS	0.5	07/96	ND	02/21		
			CR6	4.4	11/00	4.4	02/21		
<b>SLOAN RANCHES</b>									
01	IRRIGATION	INACTIVE	VOCS	NA	NA	NA	NA		
			NITRATE (N)	NA	NA	NA	NA		
			CLO4	NA	NA	NA	NA		
02	IRRIGATION	INACTIVE	VOCS	NA	NA	NA	NA		
			NITRATE (N)	NA	NA	NA	NA		
			CLO4	NA	NA	NA	NA		
<b>SOL LONG TERM LLC (SIERRA LA VERNE COUNTRY CLUB)</b>									
01	IRRIGATION	INACTIVE	VOCS	ND	08/96	ND	10/07		
			NITRATE (N)	2.4	05/99	ND	10/07		
			CLO4	ND	03/98	ND	03/98		
02	IRRIGATION	INACTIVE	VOCS	ND	10/08	ND	10/10		
			NITRATE (N)	3.9	08/96	ND	10/10		
			CLO4	28.0	03/98	ND	04/98		

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE	DATE	
15 OFFSITE	IRRIGATION	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>SONOCO PRODUCTS COMPANY</b>								
01	INDUSTRIAL	INACTIVE	TCE	28.6	12/99	1.9	10/17	
			PCE	8.5	12/99	3.4	10/17	
			1,1-DCE	113.0	12/99	2.0	10/17	
			1,1,1-TCA	71.8	12/99	ND	10/17	
			CTC	1.2	07/96	ND	10/17	
			NITRATE (N)	16.4	12/05	14.0	10/17	
			CLO4	ND	06/98	ND	07/04	
02	INDUSTRIAL	ACTIVE	TCE	16.0	10/03	0.7	10/20	
			PCE	1.8	10/03	1.5	10/20	
			1,1-DCE	5.9	02/98	2.0	10/20	
			1,1,1-TCA	2.0	11/87	ND	10/20	
			CTC	0.9	11/87	ND	10/20	
			NITRATE (N)	16.8	12/05	15.0	10/20	
			CLO4	10.0	02/98	ND	07/04	
<b>SOUTH COVINA WATER SERVICE</b>								
102W-1	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>SOUTHERN CALIFORNIA EDISON COMPANY</b>								
110RH	NON-POTABLE	ACTIVE	VOCS	ND	08/89	ND	02/07	
			NITRATE (N)	2.0	02/07	2.0	02/07	
			CLO4	ND	11/97	ND	11/97	
			AS	ND	08/98	ND	08/98	
1EB86	NON-POTABLE	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
2EB76	IRRIGATION	DESTROYED	PCE	4.3	09/04	4.1	02/07	
			TCE	1.3	09/04	0.7	02/07	
			NITRATE (N)	11.6	09/98	6.0	02/07	
			CLO4	2.0	11/97	2.0	11/97	
38EIS	NON-POTABLE	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
38W	NON-POTABLE	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
MURAT	IRRIGATION	DESTROYED	PCE	4.1	09/02	0.6	10/08	
			TCE	0.9	09/02	ND	10/08	
			NITRATE (N)	6.1	09/04	3.2	10/08	
			CLO4	ND	04/98	ND	04/98	
			AS	ND	04/98	ND	04/98	
<b>SOUTH PASADENA, CITY OF</b>								
GRAV 2	MUNICIPAL	ACTIVE	PCE	16.0	07/08	14.0	12/22	VULNERABLE (VOC,NO3(N),CLO4)
			CTC	0.9	07/08	0.6	12/22	
			NITRATE (N)	13.1	04/87	9.1	12/22	
			CLO4	6.9	02/03	3.9	12/22	
			AS	0.7	07/96	0.6	12/22	
			CR6	4.0	06/01	2.5	12/22	
WIL 2	MUNICIPAL	INACTIVE	PCE	23.0	01/88	9.1	03/01	
			TCE	4.6	03/00	4.6	03/01	
			NITRATE (N)	19.6	03/00	17.6	02/01	
			CLO4	5.0	07/97	ND	12/99	
			AS	0.6	07/96	ND	08/99	
WIL 3	MUNICIPAL	ACTIVE	PCE	9.5	08/94	1.5	12/22	VULNERABLE (VOC,NO3(N))
			TCE	1.9	04/13	1.0	12/22	
			NITRATE (N)	14.9	01/83	4.1	12/22	
			CLO4	ND	07/97	ND	12/22	
			AS	2.5	06/18	1.6	08/22	
			CR6	4.2	08/22	4.2	08/22	
WIL 4	MUNICIPAL	ACTIVE	PCE	8.1	06/00	2.3	12/22	VULNERABLE (VOC,NO3(N))
			TCE	2.1	05/07	1.5	12/22	
			NITRATE (N)	7.1	11/22	6.7	12/22	
			CLO4	ND	07/97	ND	12/22	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)				REMARKS	
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE		DATE
			AS	2.0	02/03	ND	05/21	
			CR6	6.0	05/21	6.0	05/21	
<b>SPEEDWAY 605 INC.</b>								
NA	NON-POTABLE	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>STERLING MUTUAL WATER COMPANY</b>								
NEW SO.	MUNICIPAL	ACTIVE	VOCS	ND	06/91	ND	07/22	VULNERABLE (NO3(N))
			NITRATE (N)	7.9	02/10	3.9	10/22	
			CLO4	ND	10/97	ND	07/22	
			AS	2.9	12/00	2.4	08/20	
			CR6	1.1	08/20	1.1	08/20	
NORTH	MUNICIPAL	ACTIVE	VOCS	ND	06/88	ND	07/22	VULNERABLE (NO3(N))
			NITRATE (N)	9.8	02/07	4.6	10/22	
			CLO4	ND	09/97	ND	07/22	
			AS	4.6	08/95	2.6	07/22	
			CR6	1.0	06/01	1.2	07/22	
SOUTH	MUNICIPAL	DESTROYED	VOCS	ND	01/85	ND	06/91	
			NITRATE (N)	5.0	08/18	4.1	05/21	
			CLO4	NA	NA	NA	NA	
			AS	2.6	08/11	2.2	08/17	
<b>SUBURBAN WATER SYSTEMS</b>								
101W-1	MUNICIPAL	DESTROYED	TCE	1.5	07/87	ND	08/89	
			NITRATE (N)	12.2	08/89	12.2	08/89	
			CLO4	NA	NA	NA	NA	
			AS	ND	02/88	ND	08/89	
102W-1	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
102W-2	MUNICIPAL	DESTROYED	TCE	2.0	01/80	ND	06/85	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
103W-1	MUNICIPAL	DESTROYED	TCE	2.5	06/80	ND	07/82	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
105W-1	MUNICIPAL	DESTROYED	PCE	1.4	01/96	1.4	01/96	
			NITRATE (N)	10.4	04/95	10.4	04/95	
			CLO4	NA	NA	NA	NA	
			AS	ND	06/88	ND	06/94	
106W-1	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
111W-1	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	18.6	03/73	18.6	03/73	
			CLO4	NA	NA	NA	NA	
112W-1	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	22.4	07/69	22.4	07/69	
			CLO4	NA	NA	NA	NA	
113W-1	MUNICIPAL	DESTROYED	TCE	0.7	02/80	0.5	03/85	
			NITRATE (N)	19.2	10/85	15.3	02/88	
			CLO4	NA	NA	NA	NA	
114W-1	MUNICIPAL	DESTROYED	TCE	2.9	01/80	ND	07/95	
			PCE	0.5	12/93	ND	07/95	
			NITRATE (N)	10.5	08/91	9.0	04/95	
			CLO4	NA	NA	NA	NA	
			AS	ND	11/88	ND	11/94	
117W-1	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
120W-1	MUNICIPAL	DESTROYED	TCE	0.3	07/82	ND	08/96	
			NITRATE (N)	14.9	07/88	13.7	08/96	
			CLO4	NA	NA	NA	NA	
121W-1	MUNICIPAL	ACTIVE	VOCS	ND	10/02	ND	12/22	VULNERABLE (NO3(N),CLO4)
			NITRATE (N)	7.0	07/22	5.3	12/22	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE	DATE	
122W-1	MUNICIPAL	DESTROYED	CLO4	11.0	02/19	7.3	12/22	
			AS	1.6	02/04	ND	05/20	
			CR6	9.6	02/05	6.4	04/13	
122W-1	MUNICIPAL	DESTROYED	TCE	2.6	08/96	2.6	08/96	
			NITRATE (N)	20.3	05/86	13.7	08/96	
			CLO4	NA	NA	NA	NA	
			AS	3.0	08/79	ND	05/85	
123W-1	MUNICIPAL	DESTROYED	TCE	26.8	04/81	ND	08/96	
			PCE	33.0	04/81	ND	08/96	
			NITRATE (N)	10.6	05/76	0.9	08/96	
			CLO4	NA	NA	NA	NA	
124W-1	MUNICIPAL	DESTROYED	TCE	0.5	06/83	ND	08/89	
			NITRATE (N)	13.6	09/84	12.1	08/89	
			CLO4	NA	NA	NA	NA	
			AS	ND	06/80	ND	08/89	
125W-1	MUNICIPAL	DESTROYED	VOCS	ND	01/80	ND	09/81	
			NITRATE (N)	6.8	05/76	4.7	05/79	
			CLO4	NA	NA	NA	NA	
125W-2	MUNICIPAL	INACTIVE	VOCS	ND	03/83	ND	07/95	
			NITRATE (N)	11.3	08/87	9.2	03/95	
			CLO4	NA	NA	NA	NA	
			AS	ND	05/88	ND	08/94	
126W-1	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	4.1	05/75	4.1	05/75	
			CLO4	NA	NA	NA	NA	
126W-2	MUNICIPAL	INACTIVE	VOCS	ND	03/85	ND	08/00	
			NITRATE (N)	8.8	07/91	7.9	03/01	
			CLO4	4.8	07/97	ND	01/98	
			AS	1.3	07/96	ND	08/00	
131W-1	MUNICIPAL	DESTROYED	TCE	56.0	10/93	56.0	10/93	
			PCE	227.0	04/80	52.0	10/93	
			CTC	2.7	10/93	2.7	10/93	
			1,1-DCE	40.0	10/93	40.0	10/93	
			1,1,1-TCA	5.3	10/93	5.3	10/93	
			NITRATE (N)	14.0	09/81	12.5	10/93	
			CLO4	NA	NA	NA	NA	
133W-1	MUNICIPAL	DESTROYED	TCE	0.5	07/87	ND	08/89	
			CTC	0.5	08/89	0.5	08/89	
			NITRATE (N)	11.1	08/89	10.8	09/89	
			CLO4	NA	NA	NA	NA	
			AS	ND	04/81	ND	08/89	
134W-1	MUNICIPAL	DESTROYED	TCE	56.0	10/93	56.0	10/93	
			PCE	0.1	12/80	ND	10/93	
			1,1-DCE	8.6	10/93	8.6	10/93	
			1,1,1-TCA	13.2	03/83	ND	10/93	
			NITRATE (N)	9.7	06/87	9.2	10/93	
			CLO4	NA	NA	NA	NA	
			AS	ND	03/88	ND	07/89	
135W-1	MUNICIPAL	DESTROYED	TCE	0.8	03/85	0.3	05/85	
			NITRATE (N)	13.3	02/86	10.7	09/86	
			CLO4	NA	NA	NA	NA	
136W-1	MUNICIPAL	DESTROYED	PCE	335.0	03/80	66.0	10/93	
			TCE	53.0	03/80	9.1	10/93	
			CTC	2.4	10/93	2.4	10/93	
			1,1-DCE	15.0	10/93	15.0	10/93	
			NITRATE (N)	10.8	01/77	8.5	10/93	
			CLO4	NA	NA	NA	NA	
			AS	5.0	08/79	5.0	08/79	
139W-1	MUNICIPAL	DESTROYED	TCE	34.8	06/81	ND	01/97	
			PCE	5.0	02/88	ND	01/97	
			CTC	0.8	09/80	ND	07/96	
			NITRATE (N)	22.4	05/94	21.0	07/96	
			CLO4	NA	NA	NA	NA	
			AS	3.6	07/95	2.6	07/96	
139W-2	MUNICIPAL	INACTIVE	TCE	18.7	09/80	ND	05/10	
			PCE	12.1	03/80	ND	05/10	
			CTC	0.8	09/80	ND	05/10	
			NITRATE (N)	23.4	10/08	13.2	05/10	
			CLO4	34.0	10/08	15.0	05/10	
			AS	3.2	07/95	2.6	08/01	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)				REMARKS	
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE		DATE
139W-4	MUNICIPAL	STANDBY	TCE	4.7	04/97	ND	11/20	VULNERABLE (VOC,NO3(N),CLO4)
			NITRATE (N)	14.0	11/22	14.0	11/22	
			CLO4	15.0	11/22	15.0	11/22	
			AS	1.5	07/96	ND	12/14	
			CR6	4.1	11/00	3.5	12/14	
139W-5	MUNICIPAL	INACTIVE	TCE	19.0	08/01	19.0	08/01	
			PCE	10.8	05/99	0.7	08/01	
			CTC	1.0	08/01	1.0	08/01	
			1,2-DCA	1.0	02/00	ND	08/01	
			NITRATE (N)	8.2	06/01	8.2	10/09	
			CLO4	12.0	09/97	12.0	10/09	
139W-6	MUNICIPAL	INACTIVE	AS	1.6	07/96	ND	08/01	
			TCE	51.2	02/01	ND	05/10	
			PCE	2.8	02/01	ND	05/10	
			CTC	1.9	02/01	ND	05/10	
			1,2-DCA	1.6	02/01	ND	05/10	
			NITRATE (N)	9.7	10/08	8.2	05/10	
140W-1	MUNICIPAL	DESTROYED	CLO4	35.4	11/00	2.0	05/10	
			AS	2.7	05/96	ND	05/99	
			TCE	1.0	01/80	1.0	01/80	
			NITRATE (N)	19.6	04/73	15.4	05/75	
			CLO4	NA	NA	NA	NA	
140W-3	MUNICIPAL	STANDBY	AS	ND	01/02	ND	01/02	VULNERABLE (VOC,NO3(N),CLO4)
			TCE	13.6	03/80	0.7	11/20	
			PCE	6.1	06/88	6.1	11/20	
			CTC	1.0	09/81	ND	11/20	
			1,1-DCE	7.9	11/20	7.9	11/20	
			1,1-DCA	0.6	11/20	0.6	11/20	
			NITRATE (N)	17.6	03/85	13.0	11/21	
			CLO4	16.0	12/05	7.3	11/21	
			AS	4.0	08/76	2.5	12/14	
140W-4	MUNICIPAL	INACTIVE	CR6	12.7	06/01	8.7	12/14	
			TCE	7.0	01/96	1.5	11/06	
			NITRATE (N)	8.2	10/03	8.2	12/04	
			CLO4	12.6	10/03	11.6	12/04	
140W-5	MUNICIPAL	ACTIVE	AS	2.4	07/95	ND	12/04	VULNERABLE (VOC,NO3(N),CLO4)
			TCE	21.0	02/91	ND	05/18	
			PCE	1.0	06/07	ND	05/18	
			NITRATE (N)	8.1	02/14	7.4	11/21	
			CLO4	15.0	10/12	ND	05/18	
			AS	1.9	07/96	ND	11/21	
142W-1	MUNICIPAL	DESTROYED	CR6	9.8	02/05	6.8	04/13	
			VOCS	ND	02/80	ND	07/82	
			NITRATE (N)	16.7	06/81	16.7	06/81	
			CLO4	NA	NA	NA	NA	
142W-2	MUNICIPAL	ACTIVE	VOCS	ND	03/04	ND	12/22	VULNERABLE (NO3(N),CLO4)
			NITRATE (N)	7.3	02/19	4.2	11/22	
			CLO4	4.3	12/22	4.3	12/22	
			AS	1.6	07/04	ND	08/21	
			CR6	12.0	02/05	6.8	04/13	
147W-1	MUNICIPAL	DESTROYED	TCE	23.0	03/85	23.0	03/85	
			PCE	1.2	03/85	1.2	03/85	
			NITRATE (N)	22.6	03/85	22.6	03/85	
			CLO4	NA	NA	NA	NA	
147W-2	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	12.2	09/74	12.2	09/74	
			CLO4	NA	NA	NA	NA	
147W-3	MUNICIPAL	DESTROYED	TCE	4.1	01/92	2.7	11/16	
			PCE	4.4	04/89	1.9	11/16	
			1,1-DCE	8.9	01/89	3.6	11/16	
			1,1-DCA	4.8	05/89	ND	11/16	
			NITRATE (N)	4.5	09/88	2.0	11/16	
			CLO4	3.0	04/10	ND	11/16	
			AS	1.8	07/04	ND	08/14	
			CR6	13.0	04/05	11.0	11/16	
148W-1	MUNICIPAL	DESTROYED	TCE	0.8	06/80	ND	04/97	
			NITRATE (N)	10.6	02/76	7.9	04/97	
			CLO4	NA	NA	NA	NA	
			AS	26.0	06/78	26.0	06/78	
149W-1	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE	DATE	
150W-1	MUNICIPAL	DESTROYED	NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
			TCE	6.0	09/81	ND	08/93	
			NITRATE (N)	12.0	03/86	3.0	08/94	
			CLO4	NA	NA	NA	NA	
151W-1	MUNICIPAL	DESTROYED	AS	ND	07/89	ND	08/94	
			VOCS	ND	01/80	ND	03/98	
			NITRATE (N)	26.2	03/98	26.2	03/98	
			CLO4	21.6	03/98	21.6	03/98	
			AS	7.0	08/79	7.0	08/79	
151W-2	MUNICIPAL	ACTIVE	PCE	0.6	03/19	ND	12/22	VULNERABLE (VOC,CLO4)
			TCE	6.9	05/22	0.5	12/22	
			NITRATE (N)	2.6	02/19	2.6	11/22	
			CLO4	5.5	01/17	ND	12/22	
			AS	1.4	02/19	ND	03/22	
			CR6	12.0	04/05	8.1	04/13	
152W-1	MUNICIPAL	DESTROYED	TCE	12.8	11/82	8.0	03/85	
			PCE	0.8	11/82	0.3	03/85	
			NITRATE (N)	9.8	05/86	9.8	05/86	
			CLO4	NA	NA	NA	NA	
153W-1	MUNICIPAL	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
154W-1	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	18.3	05/79	18.3	05/79	
			CLO4	NA	NA	NA	NA	
155W-1	MUNICIPAL	INACTIVE	PCE	190.0	11/80	90.0	11/98	
			TCE	50.0	07/81	24.0	11/98	
			CTC	19.0	02/82	ND	11/98	
			1,1-DCE	16.0	03/85	13.0	11/98	
			NITRATE (N)	13.6	11/80	11.2	11/98	
			CLO4	5.4	11/98	5.4	11/98	
			AS	4.0	08/76	ND	03/85	
155W-2	MUNICIPAL	DESTROYED	PCE	190.0	09/93	76.0	11/98	
			TCE	39.0	04/80	22.0	11/98	
			1,1-DCE	21.0	09/93	11.0	11/98	
			1,1-DCA	3.0	09/93	1.4	11/98	
			C-1,2-DCE	16.0	03/85	1.8	11/98	
			NITRATE (N)	11.1	11/98	11.1	11/98	
			CLO4	4.3	11/98	ND	11/98	
157W-1	MUNICIPAL	DESTROYED	TCE	12.2	02/80	ND	03/85	
			NITRATE (N)	13.1	02/86	13.1	02/86	
			CLO4	NA	NA	NA	NA	
201W-1	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
201W-2	MUNICIPAL	DESTROYED	TCE	6.8	04/89	1.7	08/06	
			PCE	3.9	09/88	1.4	08/06	
			1,1-DCE	3.2	08/89	ND	08/06	
			C-1,2-DCE	6.1	02/91	4.3	08/06	
			NITRATE (N)	1.5	08/94	1.4	08/06	
			CLO4	ND	08/97	ND	09/03	
			AS	8.5	08/97	3.0	08/06	
201W-3	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
201W-4	MUNICIPAL	INACTIVE	TCE	6.4	09/89	ND	06/14	
			PCE	4.1	09/88	ND	06/14	
			1,1-DCE	2.0	07/88	ND	06/14	
			C-1,2-DCE	5.2	05/97	ND	06/14	
			NITRATE (N)	4.7	11/14	4.7	11/14	
			CLO4	ND	06/97	ND	07/14	
			AS	4.0	08/97	ND	06/14	
CR6	1.9	05/01	ND	11/14				
201W-5	MUNICIPAL	DESTROYED	TCE	6.4	09/89	ND	03/08	
			PCE	3.8	09/89	ND	03/08	
			1,1-DCE	2.9	09/88	ND	03/08	
			C-1,2-DCE	4.9	08/88	ND	03/08	
			NITRATE (N)	2.7	08/94	2.7	08/07	
			CLO4	ND	06/97	ND	06/03	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE	DATE	
201W-6	MUNICIPAL	DESTROYED	AS	8.9	09/89	4.0	09/05	
			TCE	3.9	05/88	ND	09/05	
			PCE	3.3	05/88	ND	09/05	
			1,1-DCE	3.2	09/88	ND	09/05	
			C-1,2-DCE	8.7	05/88	ND	09/05	
			NITRATE (N)	4.5	06/85	1.7	05/05	
			CLO4	ND	06/97	ND	06/03	
			AS	9.2	08/95	2.0	09/04	
201W-7	MUNICIPAL	ACTIVE	PCE	0.7	05/19	ND	04/22	
			C-1,2-DCE	0.9	08/08	ND	04/22	
			NITRATE (N)	3.7	07/21	3.2	07/22	
			CLO4	ND	08/08	ND	07/22	
			AS	2.0	08/08	ND	08/20	
			CR6	0.8	04/13	0.8	04/13	
201W-8	MUNICIPAL	ACTIVE	TCE	0.5	05/07	ND	04/22	
			C-1,2-DCE	1.1	05/07	ND	04/22	
			NITRATE (N)	3.7	07/21	3.7	07/22	
			CLO4	2.1	07/06	ND	07/22	
			AS	2.7	08/09	ND	07/21	
			CR6	1.1	05/07	0.9	04/13	
201W-9	MUNICIPAL	ACTIVE	PCE	1.2	11/19	0.9	10/22	
			NITRATE (N)	5.0	02/19	3.6	04/22	
			CLO4	ND	03/08	ND	07/22	
			AS	1.5	05/07	ND	02/20	
			CR6	0.6	04/13	0.6	04/13	
201W-10	MUNICIPAL	ACTIVE	TCE	1.4	09/07	ND	04/22	
			PCE	1.3	09/07	ND	04/22	
			C-1,2-DCE	3.0	09/07	ND	04/22	
			NITRATE (N)	1.8	05/17	1.5	04/22	
			CLO4	ND	09/07	ND	04/22	
			AS	3.8	05/21	3.8	05/21	
			CR6	2.1	05/21	2.1	05/21	
202W-1	MUNICIPAL	DESTROYED	TCE	4.3	09/81	ND	01/89	
			PCE	15.0	10/88	12.1	01/89	
			NITRATE (N)	5.4	07/87	5.2	10/88	
			CLO4	NA	NA	NA	NA	
			AS	ND	09/88	ND	09/88	
<b>SUNNY SLOPE WATER COMPANY</b>								
08	MUNICIPAL	ACTIVE	VOCS	ND	01/87	ND	12/22	VULNERABLE (NO3(N))
			NITRATE (N)	6.3	10/22	5.4	12/22	
			CLO4	ND	07/97	ND	09/22	
			AS	ND	09/89	ND	09/20	
			CR6	7.1	12/00	3.5	09/20	
09	MUNICIPAL	ACTIVE	VOCS	ND	01/85	ND	12/22	VULNERABLE (NO3(N))
			NITRATE (N)	8.1	06/03	5.1	12/22	
			CLO4	ND	07/97	ND	09/22	
			AS	3.6	08/96	ND	09/21	
			CR6	7.0	03/17	6.5	09/21	
10	MUNICIPAL	INACTIVE	VOCS	ND	01/85	ND	08/96	
			NITRATE (N)	14.4	12/94	0.5	05/19	
			CLO4	NA	NA	NA	NA	
			AS	0.7	08/96	0.7	08/96	
13	MUNICIPAL	ACTIVE	VOCS	ND	08/96	ND	12/22	
			NITRATE (N)	1.6	09/09	1.2	12/22	
			CLO4	ND	07/97	ND	09/22	
			AS	3.3	06/21	3.3	06/21	
			CR6	15.0	06/22	11.0	12/22	
<b>TAYLOR HERB GARDEN</b>								
NA	IRRIGATION	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>TEXACO INC.</b>								
14	INDUSTRIAL	DESTROYED	PCE	40.0	07/01	2.8	09/03	
			TCE	5.0	05/85	ND	09/03	
			1,2-DCA	0.6	01/96	ND	09/03	
			NITRATE (N)	7.5	07/01	1.4	09/03	
			CLO4	ND	09/97	ND	09/97	



WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE	DATE	
<b>THOMPSON, EARL W.</b>								
01	DOMESTIC	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>TOMOVICH (NICK) &amp; SON</b>								
NA	DOMESTIC	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>TRAN, HIEU</b>								
TRAN	IRRIGATION	ACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>TYLER NURSERY</b>								
NA	IRRIGATION	INACTIVE	TCE	12.9	12/99	1.2	09/04	
			PCE	44.6	12/99	1.2	09/04	
			1,1-DCE	0.6	09/02	ND	09/04	
			1,1-DCA	0.9	09/02	ND	09/04	
			C-1,2-DCE	8.7	09/02	ND	09/04	
			NITRATE (N)	7.0	09/02	ND	09/04	
			CLO4	NA	NA	NA	NA	
<b>UNITED CONCRETE PIPE CORPORATION</b>								
NA	INDUSTRIAL	DESTROYED	VOCS	ND	08/89	ND	10/08	
			NITRATE (N)	1.0	08/89	1.0	08/89	
			CLO4	NA	NA	NA	NA	
<b>UNITED ROCK PRODUCTS CORPORATION</b>								
IRW-1	INDUSTRIAL	ACTIVE	VOCS	ND	08/89	ND	10/20	
			NITRATE (N)	1.4	07/96	1.1	10/20	
			CLO4	ND	02/98	ND	02/98	
			AS	ND	04/98	ND	04/98	
IRW-2	INDUSTRIAL	ACTIVE	VOCS	ND	07/96	ND	10/20	
			NITRATE (N)	1.3	12/19	1.2	10/20	
			CLO4	ND	02/98	ND	02/98	
SIERRA	INDUSTRIAL	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>VALENCIA HEIGHTS WATER COMPANY</b>								
01	MUNICIPAL	INACTIVE	VOCS	ND	06/89	ND	07/09	
			NITRATE (N)	10.5	04/99	7.4	07/07	
			CLO4	8.5	08/00	ND	07/09	
			AS	0.7	08/96	ND	07/07	
02	MUNICIPAL	INACTIVE	TCE	0.2	01/80	ND	07/08	
			NITRATE (N)	12.1	07/97	6.1	07/06	
			CLO4	8.0	10/98	4.2	07/08	
			AS	0.9	08/96	ND	07/06	
03A	MUNICIPAL	INACTIVE	VOCS	ND	03/85	ND	03/92	
			NITRATE (N)	7.9	09/89	2.7	08/92	
			CLO4	NA	NA	NA	NA	
04	MUNICIPAL	INACTIVE	PCE	1.0	09/99	ND	09/01	
			NITRATE (N)	20.3	11/97	17.6	03/02	
			CLO4	32.6	11/00	28.0	03/02	
			AS	2.2	07/00	ND	08/00	
			CR6	5.0	11/00	5.0	11/00	
05	MUNICIPAL	ACTIVE	VOCS	ND	06/90	ND	04/22	VULNERABLE
			NITRATE (N)	9.5	08/12	0.5	09/22	(NO3(N),CLO4)
			CLO4	7.2	11/00	ND	10/22	
			AS	0.9	08/96	ND	07/21	
			CR6	1.7	08/13	ND	07/21	
06	MUNICIPAL	ACTIVE	VOCS	ND	12/02	ND	07/22	VULNERABLE
			NITRATE (N)	11.1	06/04	9.1	12/22	(NO3(N),CLO4)
			CLO4	8.9	01/07	4.9	12/22	
			AS	ND	12/02	ND	10/20	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)				REMARKS					
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT						
				VALUE	DATE	VALUE		DATE				
07	MUNICIPAL	ACTIVE	CR6	8.0	12/02	3.1	10/20	VULNERABLE (NO3(N),CLO4)				
			VOCS	ND	05/08	ND	07/22					
			NITRATE (N)	9.8	10/18	5.1	12/22					
			CLO4	5.4	10/12	ND	12/22					
			AS	ND	12/09	ND	04/21					
			CR6	2.0	04/21	2.0	04/21					
<b>VALLEY COUNTY WATER DISTRICT</b>												
ARROW	MUNICIPAL	ACTIVE	TCE	700.0	07/82	18.0	11/22	VULNERABLE (VOC,NO3(N),CLO4)				
			PCE	980.0	12/96	36.0	11/22					
			1,1-DCE	64.0	12/96	3.8	11/22					
			C-1,2-DCE	59.0	12/96	0.9	11/22					
			CTC	14.5	09/92	ND	11/22					
			1,2-DCA	9.0	02/92	ND	11/22					
			1,1,1-TCA	45.0	12/96	ND	11/22					
			1,1-DCA	2.9	02/95	ND	11/22					
			NITRATE (N)	6.9	11/22	6.9	11/22					
			CLO4	4.3	08/22	4.3	11/22					
			AS	1.6	11/22	1.6	11/22					
			CR6	2.7	11/22	2.7	11/22					
			B DALTON	MUNICIPAL	INACTIVE	TCE	137.0		04/85	ND	05/11	
						PCE	8.0		04/85	ND	05/11	
1,1-DCA	0.9	05/96				ND	05/11					
C-1,2-DCE	2.0	11/95				ND	05/11					
CTC	9.9	04/85				ND	05/11					
1,2-DCA	11.0	12/98				ND	05/11					
NITRATE (N)	16.3	10/09				16.3	05/11					
CLO4	99.1	12/98				11.0	05/11					
AS	5.0	11/95				2.7	09/07					
E NIXON (E JOAN)	MUNICIPAL	ACTIVE	TCE	7.0	11/08	ND	12/22	VULNERABLE (VOC)				
			PCE	11.0	10/04	ND	12/22					
			1,1-DCE	1.3	10/04	ND	12/22					
			C-1,2-DCE	1.7	10/04	ND	12/22					
			NITRATE (N)	3.1	02/05	0.7	12/22					
			CLO4	ND	05/97	2.0	12/22					
			AS	3.0	08/06	2.0	08/22					
CR6	1.0	05/01	0.4	08/22								
E MAINE	MUNICIPAL	ACTIVE	TCE	36.0	10/04	ND	12/22	VULNERABLE (VOC,CLO4)				
			PCE	110.0	10/04	ND	12/22					
			1,1-DCE	10.1	02/91	ND	11/22					
			1,2-DCA	1.4	10/04	ND	11/22					
			1,1,1-TCA	9.1	02/91	ND	11/22					
			C-1,2-DCE	13.0	06/03	ND	11/22					
			NITRATE (N)	4.7	02/11	1.0	12/22					
			CLO4	7.8	10/04	2.0	12/22					
			AS	4.4	08/89	2.1	08/20					
			CR6	1.0	05/01	ND	08/20					
LANTE (SA1-3)	MUNICIPAL	ACTIVE	TCE	1315.0	04/98	20.0	05/22	VULNERABLE (VOC,NO3(N),CLO4)				
			PCE	1200.0	11/96	35.0	05/22					
			1,1-DCE	110.0	11/96	3.1	08/21					
			C-1,2-DCE	90.0	11/96	1.4	08/21					
			T-1,2-DCE	110.0	04/85	ND	08/21					
			1,1-DCA	18.0	08/04	ND	08/21					
			1,2-DCA	12.5	01/92	ND	08/21					
			CTC	17.6	01/92	ND	08/21					
			1,1,1-TCA	170.0	04/85	ND	08/21					
			NITRATE (N)	11.0	11/18	7.5	05/22					
			CLO4	94.0	04/98	5.2	05/22					
			AS	2.4	01/05	ND	08/21					
			CR6	18.0	01/05	3.3	08/21					
MORADA	MUNICIPAL	INACTIVE	TCE	770.0	03/80	ND	05/11					
			PCE	100.0	02/85	2.2	05/11					
			CTC	29.0	04/84	ND	05/11					
			1,1-DCE	2.5	04/88	ND	05/11					
			1,1-DCA	8.5	02/85	ND	05/11					
			1,2-DCA	0.7	04/88	ND	05/11					
			C-1,2-DCE	8.1	08/95	ND	05/11					
			NITRATE (N)	25.0	11/90	19.3	05/11					
			CLO4	21.0	02/04	11.0	05/11					
AS	3.6	08/95	3.6	08/95								
PADDY LN	MUNICIPAL	INACTIVE	TCE	166.0	04/94	29.0	05/11					
			PCE	42.0	11/93	3.5	05/11					
			CTC	15.0	12/87	1.0	05/11					
			1,1-DCE	17.2	11/93	1.6	05/11					
			C-1,2-DCE	23.8	11/93	1.9	05/11					
			1,2-DCA	6.6	02/04	2.6	05/11					

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS				
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT						
				VALUE	DATE	VALUE	DATE					
PALM	MUNICIPAL	INACTIVE	NITRATE (N)	14.2	05/10	8.9	05/11					
			CLO4	154.0	02/98	38.0	05/11					
			AS	ND	06/80	ND	11/94					
			CTC	48.0	07/82	0.8	02/04					
			TCE	56.0	02/04	56.0	02/04					
			PCE	51.0	02/04	51.0	02/04					
			C-1,2-DCE	7.1	02/04	7.1	02/04					
			1,1,1-TCA	1.8	02/04	1.8	02/04					
			NITRATE (N)	2.5	12/94	2.3	02/04					
			CLO4	5.6	02/04	5.6	02/04					
			AS	ND	10/87	ND	11/92					
			W NIXON (W JOAN)	MUNICIPAL	ACTIVE	TCE	4.0		11/04	ND	12/22	VULNERABLE (VOC)
						PCE	8.0		11/04	ND	12/22	
NITRATE (N)	1.9	08/13				1.0	12/22					
CLO4	ND	05/97				ND	12/22					
AS	3.1	08/95				1.9	08/22					
CR6	1.0	05/01				0.6	08/22					
W MAINE	MUNICIPAL	ACTIVE	TCE	47.3	02/91	ND	12/22	VULNERABLE (VOC,CLO4)				
			PCE	70.0	02/03	ND	12/22					
			1,1-DCE	14.2	02/91	ND	11/22					
			1,2-DCA	0.8	08/04	ND	11/22					
			1,1,1-TCA	10.6	02/91	ND	11/22					
			C-1,2-DCE	9.0	02/03	ND	11/22					
			NITRATE (N)	4.7	05/90	0.9	12/22					
			CLO4	6.3	10/04	ND	12/22					
			AS	2.6	07/96	2.1	08/20					
			CR6	1.0	05/01	ND	08/20					
			SA1-1	MUNICIPAL	ACTIVE	TCE	34.0		07/05	6.3	09/22	VULNERABLE (VOC,CLO4,NO3(N))
PCE	47.0	04/07				1.9	09/22					
1,1-DCA	11.0	07/05				ND	03/22					
1,1-DCE	110.0	07/05				7.9	03/22					
1,2-DCA	1.0	07/05				ND	03/22					
C-1,2-DCE	4.1	07/05				ND	03/22					
1,1,1-TCA	6.0	05/06				ND	03/22					
FREON 11	21.0	03/22				21.0	03/22					
NITRATE (N)	21.0	05/18				17.0	09/22					
CLO4	17.0	01/05				3.7	09/22					
AS	1.3	06/03				ND	03/22					
CR6	2.4	03/06				1.6	03/22					
SA1-2	MUNICIPAL	INACTIVE				TCE	25.0	04/06	2.0	12/09		
						PCE	37.0	05/06	4.8	12/09		
			1,1-DCA	8.7	07/05	ND	12/09					
			1,1-DCE	62.0	04/06	1.2	12/09					
			1,2-DCA	1.0	07/05	ND	12/09					
			C-1,2-DCE	6.2	07/05	ND	12/09					
			1,1,1-TCA	2.2	05/06	ND	12/09					
			NITRATE (N)	16.3	03/05	16.3	05/12					
			CLO4	15.0	03/05	11.0	12/09					
			AS	2.0	03/06	ND	02/09					
			CR6	2.6	03/06	2.0	09/07					
<b>VALLEY VIEW MUTUAL WATER COMPANY</b>												
01	MUNICIPAL	INACTIVE	VOCS	ND	06/89	ND	09/10					
			NITRATE (N)	1.4	09/09	1.3	09/10					
			CLO4	ND	08/97	ND	09/10					
			AS	3.0	09/07	ND	09/10					
			CR6	1.0	11/00	1.0	05/01					
02	MUNICIPAL	ACTIVE	PCE	2.1	09/16	ND	10/22					
			TCE	0.7	09/16	ND	10/22					
			NITRATE (N)	1.8	09/15	1.4	07/22					
			CLO4	ND	08/97	ND	07/22					
			AS	2.0	09/96	ND	07/22					
			CR6	2.5	05/01	0.7	07/22					
03	MUNICIPAL	INACTIVE	TCE	1.3	01/80	ND	03/98					
			NITRATE (N)	6.1	03/98	6.1	03/98					
			CLO4	18.6	03/98	18.6	03/98					
<b>VIA TRUST</b>												
01	NON-POTABLE	DESTROYED	VOCS	NA	NA	NA	NA					
			NITRATE (N)	NA	NA	NA	NA					
			CLO4	NA	NA	NA	NA					
<b>VULCAN MATERIALS COMPANY (CALMAT COMPANY)</b>												
DUR E	INDUSTRIAL	DESTROYED	TCE	32.0	11/04	ND	10/10					

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)				REMARKS	
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE		DATE
			PCE	27.0	11/04	0.9	10/10	
			1,1-DCE	5.3	11/04	ND	10/10	
			C-1,2-DCE	2.8	11/04	ND	10/10	
			1,1,1-TCA	0.7	11/04	ND	10/10	
			NITRATE (N)	3.7	10/04	1.6	10/10	
			CLO4	ND	04/98	ND	10/08	
			AS	ND	04/98	ND	04/98	
DUR W	INDUSTRIAL	DESTROYED	PCE	0.8	02/07	ND	10/09	
			NITRATE (N)	3.6	07/01	3.2	10/09	
			CLO4	4.0	05/98	4.0	05/98	
			AS	2.9	05/98	2.9	05/98	
REL 1	INDUSTRIAL	ACTIVE	VOCS	ND	05/94	ND	10/20	
			NITRATE (N)	1.5	09/02	0.5	10/20	
			CLO4	ND	05/98	ND	05/98	
			AS	4.8	05/94	3.5	07/94	
<b>WADE, RICHARD I.</b>								
NA	DOMESTIC	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>WEST COVINA VENTURE LIMITED</b>								
NA	NA	INACTIVE	VOCS	NA	NA	NA	NA	
			NITRATE (N)	NA	NA	NA	NA	
			CLO4	NA	NA	NA	NA	
<b>WHITTIER, CITY OF</b>								
09	MUNICIPAL	DESTROYED	TCE	1.4	04/85	ND	08/89	
			PCE	1.9	10/88	0.6	08/89	
			NITRATE (N)	2.0	08/89	2.0	08/89	
			CLO4	NA	NA	NA	NA	
			AS	ND	07/74	ND	08/89	
10	MUNICIPAL	DESTROYED	VOCS	NA	NA	NA	NA	
			NITRATE (N)	1.5	01/74	1.5	01/74	
			CLO4	NA	NA	NA	NA	
11	MUNICIPAL	DESTROYED	VOCS	ND	06/87	ND	11/90	
			NITRATE (N)	2.3	01/90	2.3	01/90	
			CLO4	NA	NA	NA	NA	
			AS	ND	04/80	ND	08/89	
12	MUNICIPAL	INACTIVE	TCE	1.5	07/88	1.5	07/88	
			PCE	0.7	07/88	0.7	07/88	
			NITRATE (N)	2.3	12/84	1.9	12/85	
			CLO4	NA	NA	NA	NA	
13	MUNICIPAL	ACTIVE	PCE	4.9	11/87	ND	12/22	VULNERABLE (VOC)
			TCE	1.1	06/87	ND	12/22	
			MTBE	6.4	03/02	ND	09/22	
			NITRATE (N)	3.8	03/11	3.0	09/22	
			CLO4	ND	08/97	ND	09/22	
			AS	4.1	03/02	ND	09/20	
			CR6	1.0	05/01	ND	09/20	
15	MUNICIPAL	ACTIVE	PCE	9.4	03/03	ND	12/22	VULNERABLE (VOC)
			TCE	0.7	09/04	ND	12/22	
			C-1,2-DCE	2.5	12/93	ND	12/22	
			NITRATE (N)	2.9	08/89	2.0	09/22	
			CLO4	ND	08/97	ND	09/22	
			AS	3.5	03/02	1.4	09/22	
			CR6	2.2	10/00	0.5	09/22	
16	MUNICIPAL	ACTIVE	PCE	3.4	12/02	1.5	12/22	VULNERABLE (VOC,AS)
			TCE	1.4	01/97	ND	12/22	
			C-1,2-DCE	2.5	10/96	ND	12/22	
			NITRATE (N)	3.0	03/16	2.4	03/22	
			CLO4	ND	08/97	ND	03/22	
			AS	5.8	03/02	2.2	03/20	
			CR6	2.5	05/01	ND	03/20	
17	MUNICIPAL	ACTIVE	PCE	12.0	12/02	2.5	12/22	VULNERABLE (VOC)
			TCE	2.2	05/92	ND	12/22	
			C-1,2-DCE	1.2	04/95	ND	03/22	
			NITRATE (N)	2.9	03/03	2.0	03/22	
			CLO4	ND	08/97	ND	03/22	
			AS	3.4	03/02	ND	03/22	
			CR6	1.6	10/00	1.1	03/22	

WELL NAME	USAGE	STATUS	CONCENTRATION (NITRATE IN MG/L, OTHERS IN UG/L)					REMARKS
			CONTAMINANT OF CONCERN	HISTORIC HIGH		MOST RECENT		
				VALUE	DATE	VALUE	DATE	
18	MUNICIPAL	ACTIVE	PCE	9.3	12/18	5.6	12/20	VULNERABLE (VOC)
			TCE	2.4	11/95	0.6	06/21	
			C-1,2-DCE	0.7	10/96	ND	06/21	
			NITRATE (N)	3.4	03/17	3.0	03/21	
			CLO4	ND	08/97	ND	03/21	
			AS	4.1	03/02	ND	03/21	
			CR6	1.0	10/00	ND	03/21	

**WILMOTT, ERMA M.**

01	DOMESTIC	INACTIVE	VOCS	NA	NA	NA	NA
			NITRATE (N)	NA	NA	NA	NA
			CLO4	NA	NA	NA	NA

**WOODLAND, RICHARD**

01	NON-POTABLE	INACTIVE	VOCS	NA	NA	NA	NA
			NITRATE (N)	NA	NA	NA	NA
			CLO4	NA	NA	NA	NA
02	NON-POTABLE	INACTIVE	VOCS	NA	NA	NA	NA
			NITRATE (N)	NA	NA	NA	NA
			CLO4	NA	NA	NA	NA

**WORKMAN MILL INVESTMENT COMPANY (ROSE HILLS MEMORIAL PARK)**

04	IRRIGATION	INACTIVE	PCE	5.3	08/87	ND	10/09
			TCE	11.0	04/85	ND	10/09
			1,1-DCE	14.0	04/85	ND	10/09
			1,1,1-TCA	3.3	04/85	ND	10/09
			NITRATE (N)	11.9	02/07	9.7	10/10
			CLO4	ND	06/98	ND	06/98
			01	IRRIGATION	INACTIVE	VOCS	NA
			NITRATE (N)	NA	NA	NA	NA
			CLO4	NA	NA	NA	NA
02	IRRIGATION	INACTIVE	PCE	8.6	04/85	ND	10/04
			TCE	11.0	04/85	ND	10/04
			NITRATE (N)	20.6	10/04	20.6	10/04
			CLO4	ND	06/98	ND	06/98
01	IRRIGATION	INACTIVE	TCE	6.1	04/87	ND	10/10
			PCE	6.4	11/87	1.1	10/10
			1,2-DCA	0.8	01/96	ND	10/10
			1,1-DCE	1.0	04/87	ND	10/10
			C-1,2-DCE	2.6	05/85	ND	10/10
			NITRATE (N)	10.2	02/98	7.0	10/10
			CLO4	ND	02/98	ND	02/98
			AS	3.0	06/95	2.1	06/96
			03	IRRIGATION	INACTIVE	TCE	21.0
			PCE	7.4	05/85	ND	09/05
			1,1-DCE	2.7	05/85	ND	09/05
			C-1,2-DCE	28.0	05/85	ND	09/05
			1,1-DCA	1.1	05/85	ND	09/05
			1,1,1-TCA	7.5	05/85	ND	09/05
			NITRATE (N)	10.5	08/00	5.8	09/05
			CLO4	ND	02/98	ND	02/98

NOTES	CONTAMINANT	MAXIMUM CONTAMINANT LEVEL	REPORTING LIMIT	REMARKS
	1,1-Dichloroethane (1,1-DCA)	5 micrograms per liter (ug/L)	0.5 ug/L	NA
	1,1-Dichloroethylene (1,1-DCE)	6 ug/L	0.5 ug/L	ND
	1,1,1-Trichloroethane (1,1,1-TCA)	200 ug/L	0.5 ug/L	NL
	1,1,2,2-Tetrachloroethane (1,1,2,2-PCA)	1 ug/L	0.5 ug/L	VOCS
	1,2-Dichloroethane (1,2-DCA)	0.5 ug/L	0.5 ug/L	Volatile Organic Compounds
	Arsenic (AS)	10 ug/L	2.0 ug/L	
	Perchlorate (CLO4)	6 ug/L	2.0 ug/L (1.0 ug/L effective 01/01/2024)	
	Carbon Tetrachloride (CTC)	0.5 ug/L	0.5 ug/L	
	Cis-1,2-Dichloroethylene (c-1,2-DCE)	6 ug/L	0.5 ug/L	
	Hexavalent Chromium (CR6)	NA	NA	
	Trichlorofluoromethane (Freon 11)	150 ug/L	5.0 ug/L	
	Trichlorotrifluoroethane (Freon 113)	1200 ug/L	10.0 ug/L	
	Methyl Tert-Butyl Ether (MTBE)	13 ug/L	3.0 ug/L	
	Nitrate as Nitrogen (NITRATE [N])	10 mg/L	0.4 mg/L	
	Tetrachloroethylene (PCE)	5 ug/L	0.5 ug/L	
	Trichloroethylene (TCE)	5 ug/L	0.5 ug/L	
	Trans-1,2-Dichloroethylene (t-1,2-DCE)	10 ug/L	0.5 ug/L	
	Vinyl Chloride (VC)	0.5 ug/L	0.5 ug/L	



---

**APPENDIX D.**  
**POTENTIAL SITES FOR**  
**AQUIFER PERFORMANCE TESTS**





**APPENDIX D**  
**POTENTIAL SITES FOR AQUIFER PERFORMANCE TESTS**

NAME	RECORD.	USAGE	STATUS	PERF. (1)	FUNCTION	REMARKS
<b>ALHAMBRA, CITY OF</b>						
LON 1	1902789	MUNICIPAL	ACTIVE	411-800	MONITORING	
LON 2	1900017	MUNICIPAL	ACTIVE	296-563	PUMPING	
<b>AZUSA, CITY OF</b>						
NO. 12	8000179	MUNICIPAL	ACTIVE	206-311	PUMPING	
NO. 11	8000178	MUNICIPAL	ACTIVE	200-320	MONITORING	
<b>CALIFORNIA AMERICAN WATER COMPANY/DUARTE</b>						
B V	1900035	MUNICIPAL	STANDBY	300-580	PUMPING	
B V 2	8000216	MUNICIPAL	ACTIVE	300-700	MONITORING	
<b>CALIFORNIA DOMESTIC WATER COMPANY</b>						
05A	8000100	MUNICIPAL	ACTIVE	?-920	PUMPING	
06	1902967	MUNICIPAL	ACTIVE	200-800	MONITORING	
<b>GLENDORA, CITY OF</b>						
05-E	8000149	MUNICIPAL	ACTIVE	150-400	PUMPING	
NA	1903119	INDUSTRIAL	INACTIVE	?-220	MONITORING	OWL ROCK PRODUCTS WELL
<b>GOLDEN STATE WATER COMPANY (SOUTHERN CALIFORNIA WATER COMPANY)/SAN DIMAS DISTRICT</b>						
COL-4	1902268	MUNICIPAL	ACTIVE	122-190	PUMPING	
COL-6	1902270	MUNICIPAL	INACTIVE	?-414	MONITORING	
<b>GOLDEN STATE WATER COMPANY (SOUTHERN CALIFORNIA WATER COMPANY)/SAN GABRIEL VALLEY DISTRICT</b>						
FAR 1	1902034	MUNICIPAL	ACTIVE	274-455	PUMPING	
FAR 2	1902948	MUNICIPAL	ACTIVE	229-600	MONITORING	
SG 1	1900510	MUNICIPAL	ACTIVE	190-411	MONITORING	
SG 2	1900511	MUNICIPAL	ACTIVE	209-393	PUMPING	
<b>RURBAN HOMES MUTUAL WATER COMPANY</b>						
NORTH 1	1900120	MUNICIPAL	ACTIVE	140-190	MONITORING	
SOUTH 2	1900121	MUNICIPAL	INACTIVE	125-165	PUMPING	
<b>SAN GABRIEL COUNTY WATER DISTRICT</b>						
05 BRA	1901669	MUNICIPAL	INACTIVE	450-800	MONITORING	
11	8000067	MUNICIPAL	ACTIVE	350-800	PUMPING	
12	8000123	MUNICIPAL	ACTIVE	470-1320	MONITORING	
<b>SAN GABRIEL VALLEY WATER COMPANY</b>						
B24A	8000203	MUNICIPAL	ACTIVE	600-1150	PUMPING	
B24B	8000204	MUNICIPAL	ACTIVE	600-1150	MONITORING	

NAME	RECORD.	USAGE	STATUS	PERF. (1)	FUNCTION	REMARKS
------	---------	-------	--------	-----------	----------	---------

**SUBURBAN WATER SYSTEMS**

201W-9	8000208	MUNICIPAL	ACTIVE	260-650	PUMPING	
201W-7	8000195	MUNICIPAL	ACTIVE	200-650	MONITORING	
201W-8	8000198	MUNICIPAL	ACTIVE	200-650	MONITORING	
201W-10	8000210	MUNICIPAL	ACTIVE	NA	MONITORING	

**VALLEY COUNTY WATER DISTRICT**

E NIXON (JOANBRIDGE)	1900032	MUNICIPAL	ACTIVE	300-586	MONITORING	ALTERNATE FOR MAINE SITE
W NIXON (JOANBRIDGE)	1902356	MUNICIPAL	ACTIVE	300-584	PUMPING	
E MAINE	1900027	MUNICIPAL	ACTIVE	250-580	PUMPING	ALTERNATE FOR NIXON SITE
W MAINE	1900028	MUNICIPAL	ACTIVE	250-580	MONITORING	

**VALLEY VIEW MUTUAL WATER COMPANY**

01	1900363	MUNICIPAL	INACTIVE	300-585	MONITORING	
02	1900364	MUNICIPAL	ACTIVE	300-535	PUMPING	
03	1900365	MUNICIPAL	INACTIVE	100-200	MONITORING	

**WORKMAN MILL INVESTMENT COMPANY (ROSE HILLS MEMORIAL PARK)**

01	1900094	IRRIGATION	INACTIVE	137-264	PUMPING	
ROSE HILLS	8000004	MUNICIPAL	INACTIVE	?-200	MONITORING	BEVERLY ACRES MWC

**NOTES**

NA: NOT AVAILABLE

RECORD.: RECORDATION NUMBER

PERF.: PERFORATION INTERVAL

(1) TOP OF THE TOP INTERVAL - BOTTOM OF THE BOTTOM INTERVAL (DEPTH BELOW GROUND SURFACE IN FEET)

---

# **APPENDIX E.**

## **SUMMARY OF TREATMENT FACILITY ACTIVITY IN THE MAIN SAN GABRIEL BASIN**



## APPENDIX E

### SUMMARY OF HISTORY AND ACTIVITIES OF OPERABLE UNITS

#### **BALDWIN PARK OPERABLE UNIT (BPOU)**

**BPOU Background.** The BPOU is a seven-mile-long, one-mile-wide area of groundwater contamination east of the San Gabriel River, stretching from north of the I-210 Freeway in Azusa to south of the I-10 Freeway in Baldwin Park (see Figure 12). The contamination primarily has resulted from the improper use and disposal of industrial chemicals in the Azusa area, and it continues to spread generally in a southwesterly direction.

**BPOU Cleanup Progress.** The United States Environmental Protection Agency (USEPA) originally issued its Record of Decision (ROD), or cleanup plan, for the BPOU in the mid-1990s. The ROD calls for pumping and treating groundwater in the northern area, where contaminant concentrations are highest, and in the southern area to limit further migration of contaminants. The ROD initially involved pumping and treating an average of about 7,000 gallons per minute (gpm) in the northern area and 16,000 gpm in the southern area. During 2015, the extraction rates were modified and now require pumping and treating an average of about 6,000 gpm in the northern area and 23,750 gpm in the southern area. The ROD also recommends using existing water supply wells, treatment systems, and pipelines when feasible. Importantly, the plan encourages adding the treated water to the potable supply rather than simply recharging it back into the ground or discharging it to storm drains.

In 2002, after several years of negotiation led by Watermaster, 8 of the BPOU Responsible Parties (called Cooperating Respondents, or CRs) and 7 water entities signed the BPOU Project Agreement. Under this landmark agreement, Watermaster provides overall project management and project coordination services. Under the original agreement, the CRs paid the cost to construct the USEPA-required BPOU cleanup facilities and were required to continue to provide funding to operate the facilities for about 15 years—through 2017. Subsequently, the BPOU Project Agreement was extended an additional 10 years through 2027.

The BPOU Project consists of 4 centralized treatment facilities with a combined extraction and treatment capacity of up to 33,900 gpm and a target average pumping and treatment rate of 29,750 gpm. Those treatment facilities are located at Valley County Water District's Lante Plant (7,800 gpm), San Gabriel Valley Water Company's Plant B6 (7,800 gpm) and Plant B5 (7,800 gpm), California Domestic Water Company's (CDWC) Bassett Plant (8,000 gpm), and La Puente Valley County Water District's (LPVCWD) site (2,500 gpm).

**Valley County Water District (VCWD) Project.** In the northerly portion of the BPOU, the VCWD Project consists of 3 extraction wells. The wells pump up to 7,800 gpm (target average annual pumping rate of 6,000 gpm) to a centralized treatment facility at the VCWD Lante Plant. The VCWD Project consists of separate facilities to treat Volatile Organic Compounds (VOCs), 1,2,3-TCP, perchlorate, N-nitrosodimethylamine (NDMA), and 1,4-dioxane. In addition, a treated-water pipeline provides up to 6,000 gpm of fully treated water to Suburban Water Systems (SWS) to offset production lost due to contamination of some of its wells; VCWD can use the remaining portion of the treated water. The VCWD Project began operation for contamination cleanup in 2006 and received its Department of Drinking Water (DDW) operating permit in July 2007 to provide potable water to customers. Since operation began in 2006, the VCWD treatment facility has treated about 93,500 acre-feet, and has removed about 46,000 pounds of contaminants, as shown in the table at the end of this Appendix (E).

**LPVCWD Project.** The LPVCWD consists of 3 existing production wells. Well-pumping capacity is limited to 2,500 gpm to equal the capacity of the treatment facility (target average annual pumping rate of 2,250 gpm). The LPVCWD project consists of separate facilities to treat VOCs, perchlorate, NDMA, 1,4-dioxane and nitrate. The LPVCWD project is permitted by DDW and has been operating since March 2001. Treated water in excess of LPVCWD's needs is provided to SWS to enable the treatment facility to operate continuously. Since operation

began, the LPVCWD treatment facility has treated about 90,400 acre-feet (including prior operations with only VOC treatment) and removed about 13,800 pounds of contaminants, as shown in the table at the end of this Appendix (E).

**San Gabriel Valley Water Company (SGVWC) B6 Project.** The SGVWC B6 project is permitted by DDW and has been operational since July 2005. The B6 project consists of 4 extraction wells and a centralized treatment facility that treats up to 7,800 gpm (target average annual pumping rate of 6,500 gpm). The facility treats the contaminated groundwater for VOCs, perchlorate, NDMA, 1,4-dioxane, and nitrate. The treated water is provided to SGVWC customers. Since operation began, the SGVWC B6 treatment facility has treated about 176,000 acre-feet (including prior operations with only VOC treatment) and removed about 34,100 pounds of contaminants, as shown in the table at the end of this Appendix (E).

**SGVWC B5 Project.** The SGVWC B5 Project consists of 4 wells that provide up to 7,800 gpm (target average annual pumping rate of 7,000 gpm) to a centralized treatment facility located at the SGVWC B5 site. The facility treats the contaminated water for VOCs, perchlorate, NDMA, and 1,4-dioxane. The treated water is provided to City of Industry customers (1,000 gpm), and the balance (6,000 gpm) is provided to SGVWC customers. DDW permitted the SGVWC B5 Project in fiscal year 2007–08. Since operation began in 2007, the SGVWC B5 treatment facility has treated about 164,600 acre-feet and has removed about 6,500 pounds of contaminants, as shown in the table at the end of this Appendix (E).

**CDWC Project.** The CDWC Project consists of 6 existing wells that provide up to 15,000 gpm (target average annual pumping rate of 8,000 gpm) to a centralized treatment facility located at the CDWC Bassett site. The facility treats the contaminated water for VOCs, perchlorate, and NDMA. The treated water is provided to CDWC customers. DDW permitted the CDWC Project in 1993. Since operation began in 1993, the CDWC treatment facility has treated about 427,400 acre-feet and has removed about 26,200 pounds of contaminants, as shown in the table at the end of this Appendix (E).

**Purveyor Projects.** In addition to the USEPA-required BPOU facilities, Watermaster has issued permits under Section 28 of its Rules and Regulations to SWS to construct new wells that are also used to blend with wells impacted by contaminants. These activities reduce reliance on expensive imported water and contribute to contaminant removal.

**BPOU Current and Upcoming Activities.** Watermaster regularly reviews water quality data to evaluate the impact the production wells and specially constructed extraction wells have on control of contamination migration. It is difficult to develop a precise picture of the geographic extent of contamination because water quality is obtained from numerous wells that produce water from different depths below the groundwater table. Figure 18 (see Appendix F) shows the approximate extent of VOC contamination from about 5 years ago and from current data. It also shows the approximate geographic extent of VOC contamination, using engineering judgment, for 5 years into the future. The 2022–23 plume indicates treatment facilities are controlling plume movement. Watermaster anticipates that the area of the VOC plume will continue to decrease, as shown on the 2027–28 plume. Similarly, Figure 19 (see Appendix F) shows the approximate extent of perchlorate. The series of 3 plume characterizations indicate that plume movement is expected to be controlled and, similar to VOCs, continue to decrease in the future (2027–28).

Watermaster routinely assess water quality data and the potential impact from production wells and USEPA remedy wells to ensure an effective control of plume movement. Unlike the depth specific monitoring well, the water quality data collected from production wells is a composite of samples from various depths, making it challenging to precisely map the spatial and vertical extent of contaminant plume. Figure 18 (see Appendix F) shows the changes in VOC plumes from fiscal year 2017-18, the present, and fiscal year 2027-28. The VOC plume maps for fiscal year 2017-18 and the present were delineated based on the available measurements, while the fiscal year 2027-28 VOC plume relied on the general water quality trend and engineering-informed

approximations. The current plume, observed in fiscal year 2022–23, suggests that treatment facilities effectively control plume movement. Due to this effective control and continuous decrease in VOC concentrations, Watermaster anticipates the the area covered by the VCO plume will continue its decline trend, as demonstrated by the fiscal year 2027-28 VOC plume projection. Likewise, Figure 19 (see Appendix F) illustrates an approximation of the extent of perchlorate contamination. A series of 3 plume delineations indicates that the movement of perchlorate can be effectively managed and, similar to VOCs, is expected to decrease in the future (fiscal year 2027–28).

In coordination with BPOU Producers, the CRs, and USEPA, Watermaster will continue to investigate, test, construct, and permit more efficient treatment facilities that provide the necessary treatment, reliability, and water quality at the lowest possible long-term cost. This includes using different granular activated carbons to remove VOCs, ion-exchange resins to remove perchlorate, and pressurized ultraviolet light vessels to remove NDMA and 1,4-dioxane. Watermaster updates records on all treatment facilities every quarter.

In September 2022, USEPA completed the fourth Five-Year Review Report for the BPOU. In April 2023, USEPA completed the 2022 Annual Performance Evaluation Report for the BPOU.

Watermaster will continue coordinating BPOU cleanup activities among the various parties to the BPOU Project Agreement through at least 2027, interfacing with USEPA and overseeing agreements between water purveyors to use the treated water. With all of the BPOU facilities now operational, Watermaster is also coordinating the collection of field data, such as water production, water quality, and water levels, and is providing BPOU Project performance reports to USEPA in cooperation with the CRs. The projects will ensure an adequate water supply for the BPOU area. These projects are consistent with the USEPA ROD, meet contaminant removal and containment requirements, and meet local water supply needs.

### **SOUTH EL MONTE OPERABLE UNIT (SEMOU)**

**SEMOU Background.** The SEMOU covers approximately 8 square miles in the south-central portion of the Basin. It is bounded by the I-10 Freeway, the 60 Freeway, the I-605 Freeway, and San Gabriel Boulevard (see Figure 12).

**SEMOU Cleanup Progress.** A ROD for the SEMOU was issued in 2000, addressing VOC contamination in a limited area. Subsequently, additional water supply wells became contaminated, and new contaminants, including perchlorate, were detected in wells in the SEMOU area.

In November 2005, USEPA revisited its ROD and issued an Explanation of Significant Differences (ESD) indicating that SEMOU cleanup projects would also address the treatment of perchlorate. In the meantime, area water purveyors impacted by contaminant migration and new perchlorate detections were forced to construct new or additional treatment facilities to maintain safe, reliable water supplies. The City of Monterey Park, SGVWC, and Golden State Water Company (GSWC) have all constructed new or additional treatment facilities within SEMOU. The San Gabriel Basin Water Quality Authority (WQA) has assisted the Producers by securing outside funding to help offset project costs.

**Monterey Park Project.** Monterey Park constructed a water treatment facility at its Delta Plant to treat VOCs and perchlorate. Monterey Park Well No. 9 (which only had detectable concentrations of VOCs) began operating through the VOC treatment facility in April 2002. Following construction and permitting of the perchlorate treatment facility, Monterey Park Well No. 12 began operation in spring 2005.

Monterey Park began operation of Well No. 15 in summer 2006. Monterey Park Wells No. 12 and No. 15 are operated consistent with the SEMOU ROD. Watermaster and Monterey Park maintain data on water quality in monitoring wells located up-gradient of wells No. 9, 12, and 15. Since the treatment facility began operation, about 103,800 acre-feet of water have been treated and about 16,600 pounds of contaminants removed from the groundwater, as shown in the table at the end of this Appendix (E).

**SGVWC Plant 8 Project.** SGVWC Plant 8 VOC Treatment Facility has a capacity of 5,000 gpm and has been in operation since fiscal year 2001–02. In response to increasing VOC concentrations, SGVWC voluntarily constructed supplemental VOC treatment at Plant 8. The supplemental VOC treatment facility was permitted by DDW in September 2006 and went online in December 2006. SGVWC plans to construct a 1,4-dioxane treatment facility within the next 5 years. Since the original VOC treatment facility began operation, about 62,200 acre-feet of water have been treated, and about 10,800 pounds of contaminants have been removed from the groundwater, as shown in the table at the end of this Appendix (E).

**GSWC Project.** GSWC VOC treatment facility at San Gabriel wells No. 1 and 2 had been permitted and operating but were voluntarily removed from operation after establishing the revised Perchlorate Notification Level (NL) in 2002. Subsequently, GSWC installed an ion-exchange system to remove perchlorate and has resumed operation at its San Gabriel Well No. 1. The facility has treated about 29,800 acre-feet of water and removed about 800 pounds of contaminants, as shown in the table at the end of this Appendix (E).

**SEMOU Current and Upcoming Activities.** USEPA prepared a SEMOU/WNOU Supplemental Feasibility Study, which would evaluate remedial alternatives with different goals and was made available in early 2021. In addition, USEPA also prepared an Enhanced Remedial Alternative Study for the SEMOU/WNOU, which would evaluate a range of potential remedy enhancements and was made available in early 2021. In September 2021, USEPA completed a Five-Year Review of the current cleanup plan. In October 2022, USEPA completed an Enhanced Remedial Alternatives Study for the SEMOU.

Over the next 5 years, Watermaster will continue reviewing all proposed treatment facilities modifications through the Section 28 permitting process. In addition, Watermaster will participate in planning/progress meetings which are held every quarter. Watermaster maintains records on all treatment facilities every quarter.

## **EL MONTE OPERABLE UNIT (EMOU)**

**EMOU Background.** The EMOU covers an area of about 10 square miles in the south-central portion of the Basin. It is bounded by the I-10 Freeway on the south, Rosemead Boulevard on the west, and Santa Anita Avenue and Rio Hondo on the east. The northern boundary generally follows Lower Azusa Road (see Figure 12). While shallow contamination is found throughout the EMOU, deep (intermediate zone) contamination is found in the northwest and eastern area of the EMOU.

**EMOU Cleanup Progress.** The USEPA's ROD for the EMOU includes numerous small, shallow extraction wells and treatment, along with 2 areas of deep extraction and treatment. Due to generally poor water quality in the area, the shallow groundwater will not be used for a potable supply. The deep extractions are recommended for potable use by local water purveyors. The remediation efforts are separated into "Westside" and "Eastside" activities.

**EMOU Westside Projects.** There are plans to clean up contaminants in the shallow aquifer. The shallow-zone water is treated for VOCs, discharged to an adjacent channel, and infiltrated back into the Basin as fully treated water. The treatment facility (Hermetic Seal) has treated about 600 acre-feet and removed about 60 pounds of contaminants, as shown in the table at the end of this Appendix (E). The deep-zone extraction and treatment in the northwest area are being accomplished by the existing Encinitas Wellfield and Treatment Facility owned by GSWC, which began operation in 1998. The GSWC treatment facility has treated about 37,100 acre-feet of water and has removed about 800 pounds of contaminants, as shown in the table at the end of this Appendix (E). In July 2002, USEPA issued an ESD, which indicated that perchlorate, NDMA, 1,4-dioxane, and hexavalent chromium had been detected in excess of DDW notification levels. In the event that water from extraction wells cannot be blended to acceptable levels, additional treatment facilities will need to be installed, significantly increasing cleanup costs. Thus far, extraction and treatment of VOCs at GSWC Encinitas Plant have not been impacted.



**EMOU Eastside Projects.** On the Eastside, the shallow-zone water is treated for VOCs, discharged to an adjacent channel, and infiltrated back into the Basin as fully treated water. The treatment facility (Gould/Johnson Controls) has treated about 300 acre-feet and removed about 50 pounds of contaminants, as shown in the table at the end of this Appendix (E). The deep-zone extraction and treatment in the northwest area are being accomplished by 3 new extraction wells that began operation during 2015–16. The operation of the treatment facility and use of the treated water were transferred to the City of El Monte in early 2019. The treatment facility has treated about 6,700 acre-feet of water and has removed about 400 pounds of contaminants, as shown in the table at the end of this Appendix (E).

**EMOU Current and Upcoming Activities.** In September 2021, USEPA completed a Five-Year Review of the current cleanup plan. Over the next 5 years, Watermaster will continue reviewing all proposed treatment facilities modifications through the Section 28 permitting process. In addition, Watermaster will participate in planning/progress meetings held every quarter and will maintain records on all treatment facilities every quarter.

### **PUEENTE VALLEY OPERABLE UNIT (PVOU)**

**PVOU Background.** The PVOU lies in the southeastern portion of the Basin, essentially bounded by the 60 Freeway on the south, Azusa Avenue on the east, and the I-10 Freeway on the north (see Figure 12). The PVOU encompasses the Puente Valley, which is tributary to the southeasterly portion of the Basin. Contamination in the PVOU includes various VOCs. All aquifers within the PVOU (shallow, intermediate, and deep) are considered sources of municipal water supplies. When significant, but not fundamental changes are needed in a Superfund cleanup plan, EPA informs the community through an ESD. The 1998 Interim Record of Decision (IROD) was updated through an ESD in June 2005 to add 2 emergent chemicals, 1,4-dioxane and perchlorate.

**PVOU Cleanup Progress.** The USEPA issued a ROD for the PVOU. The plan identified in the ROD includes extraction and treatment of groundwater within the shallow and intermediate zones from wells located in the center of the PVOU.

**PVOU Shallow-Zone Project.** The cleanup plan for shallow-zone contamination includes 9 wells that will collectively produce about 1,000 gpm. Due to the poor quality of shallow-zone water (which is high in naturally occurring dissolved solids), the water will not be used as drinking water but will instead be treated to remove VOCs and then recharged back into the Basin. Watermaster has developed an agreement with the Responsible Party to allow production and discharge of the PVOU shallow-zone water.

**PVOU Intermediate Zone.** Watermaster is working with USEPA, Responsible Parties, and local water entities to develop a cleanup solution that meets potable water supply needs. The intermediate zone extraction and treatment are being accomplished by 7 extraction wells that will begin operation during 2023-24. La Puente Valley Water Company will operate the treatment facility and be the end user of the treated water and can distribute the treated water to other purveyors including SWS.

**PVOU Current and Upcoming Activities.** The USEPA updated the Superfund cleanup plan for the PVOU through an ESD in August 2022 to allow reinjection as a discharge option for treated groundwater water; to provide a response to the detection of hexavalent chromium in PVOU groundwater; to define the discharge of treated groundwater to surface water as an offsite activity; to describe updates to the conceptual site model; to update levels at which site contaminants require containment; to clarify lead agency regulatory oversight for the shallow zone south of Puente Creek; and to update groundwater monitoring requirements for the interim groundwater remedy. USEPA completed the third Five-Year Review in 2021. Over the next 5 years, it is anticipated that the intermediate-zone extraction wells and treatment facility will be permitted and begin supplying treated water. Watermaster will continue to review all proposed modifications to the treatment facilities through the Section 28 permitting process. In addition, Watermaster will participate in

planning/progress meetings, which are held every quarter. Watermaster also maintains records on all treatment facilities every quarter.

### **WHITTIER NARROWS OPERABLE UNIT (WNOU)**

**WNOU Background.** The USEPA declared the WNOU a “fund-lead” project, meaning that the USEPA (with the State) has funded the design, construction, and operation of the remedy and will seek cost recovery from Responsible Parties later. The USEPA cleanup plan involves a series of shallow- and intermediate-zone extraction wells with treatment (see Figure 11).

**WNOU Cleanup Progress.** As of May 2013, the responsibility for the WNOU was transferred from USEPA to the California Department of Toxic Substances Control (DTSC). Furthermore, the WNOU Shallow-Zone Project (as described below) ceased operation in 2013 due to improved water quality.

WNOU Shallow-Zone Project Ceased Operation in 2012–13. During fiscal year 2002–03, NDMA was detected in some shallow extraction wells, prolonging the testing and review process for the shallow-zone water through June 2007. Studies indicated that the shallow-zone contamination could be adequately contained at an extraction rate of 2,500 gpm. Treated shallow-zone water has been discharged for conservation and recreational use at Legg Lake. Watermaster entered into a production agreement with USEPA and the County of Los Angeles regarding the accounting of that water. Since production began at the WNOU facility, over 30,000 acre-feet of groundwater have been treated, and over 1,620 pounds of contaminants have been removed. During fiscal year 2012–13, the WNOU’s Shallow-Zone Project ceased operation.

**WNOU Intermediate-Zone Project.** The City of Whittier obtained a DDW permit to use the 6,000 gpm of treated intermediate-zone water for municipal use instead of producing water from its existing wells. In April 2013, the City of Whittier ceased taking treated intermediate-zone water. Subsequently, the treated intermediate-zone water production was increased, and the balance was delivered to Legg Lake while DTSC negotiates with a municipal water supplier to accept additional treated intermediate-zone water. Since production began in late 2005, about 65,800 acre-feet of groundwater have been treated and about 1,900 pounds of contaminants removed, as shown in the table at the end of this Appendix (E).

**WNOU Current and Upcoming Activities.** In early 2021, USEPA made available: a SEMOU/WNOU Supplemental Feasibility Study that evaluated remedial alternatives with different goals. In the same month, USEPA also made available an Enhanced Remedial Alternative Study for the SEMOU/WNOU to evaluate a range of potential remedy enhancements. In September 2021, USEPA completed a Five-Year Review of the current cleanup plan.

Over the next 5 years, it is anticipated that SGVWC will operate the intermediate-zone extraction wells and treatment facility, including a blend plan, and will take treated water for potable use in addition to continued deliveries to Legg Lake. This will enable the WNOU treatment facility to produce more water and put all the water to beneficial uses. Watermaster will continue to review all proposed modifications to the treatment facility through the Section 28 permitting process. In addition, Watermaster will participate in planning/progress meetings, which are held every quarter. Watermaster maintains records on all treatment facilities every quarter.

### **AREA 3 OPERABLE UNIT**

**Area 3 Background.** The Area 3 Operable Unit is located in the western portion of the Basin. It is generally bounded on the south by the I-10 Freeway, on the east by Rosemead Boulevard, on the north by Huntington Drive, and the west by the boundary of the Main Basin (see Figure 12).

**Area 3 Cleanup Progress.** USEPA has installed a series of monitoring wells to collect water quality data to supplement data collected from water supply wells and has initiated a Remedial Investigation and Feasibility Study to identify the extent of the contamination and evaluate appropriate cleanup remedies.

Watermaster issued a permit during 2005–06 to the City of Alhambra to construct a treatment facility to remove VOCs from wells No. 7, 8, 11, and 12. The treatment facility became operational in April 2009, prior to USEPA’s

development of a final remedy, but it is necessary for Alhambra to receive a reliable source of supply from the groundwater Basin. The facility has treated about 35,000 acre-feet and has removed about 1,400 pounds of contaminants, as shown in the table at the end of this Appendix (E).

**Area 3 Current and Upcoming Activities.** USEPA will finish the groundwater investigation and develop the next steps for potential action. Watermaster will continue to review all proposed modifications to the treatment facility through the Section 28 permitting process. In addition, Watermaster will participate in planning/progress meetings held every quarter.

Watermaster maintains records on all treatment facilities every quarter.

**APPENDIX E**  
**SUMMARY OF TREATMENT FACILITY ACTIVITY IN THE MAIN SAN GABRIEL BASIN**  
**AS OF JUNE 30, 2023**

Operable Unit  Treatment Facility Owner	Treatment Facility(s)	Start Date 1/	Total Water Treated		Total Contaminants Removed	
			Fiscal Year 2022-23 (Acre-feet)	Accum. Total (Acre-feet)	Fiscal Year 2022-23 (Pounds)	Accum. Total (Pounds)
<b>AREA 3</b>						
ALHAMBRA, CITY OF	Well No. 7	July 2001	—	7,582.35	—	130.1
	Well No. 7, 8, 11 & 12	April 2009	1,401.24	34,967.96	25.7	1,363.0
<b>BPOU</b>						
CALIFORNIA DOMESTIC WATER COMPANY	Well No. 3, Well No. 5A Well No. 6, & Well No. 10	September 1993 April 1997	13,570.18	427,360.92	2,030.7	26,170.7
LA PUENTE VALLEY COUNTY WATER DISTRICT	Well No. 2, 3 & 4 Well No. 2, 3 & 5 (BPOU)	August 1992 January 2000	— 3,722.64	11,493.13 78,879.15	— 412.6	826.9 12,924.2
SAN GABRIEL VALLEY WATER COMPANY	Well B6C 2/ Well B6D 2/ Plant B5 (BPOU) Plant B6 (BPOU)	April 1994 April 1994 January 2007 September 2004	— — 10,760.52 8,179.95	5,194.17 14,526.27 164,603.86 156,251.06	— — 398.7 1,782.6	856.2 421.7 6,529.4 32,782.9
VALLEY COUNTY WATER DISTRICT	Lante Lante, SA1-1, SA1-2, & SA1-4 (BPOU)	June 1984 December 2004	— 4,289.87	7,719.61 93,520.23	— 643.4	10,356.7 46,024.4
<b>EMOU</b>						
ADAMS RANCH MUTUAL WATER COMPANY	Well No. 3 2/	November 2003	—	881.58	—	32.7
EL MONTE, CITY OF	Well No. 14, 15 & 16 3/	January 2019	923.00	6,689.31	80.4	434.8
GOULD AND JOHNSON CONTROLS	EMOU (Shallow Zone)	October 2015	25.81	317.60	2.9	47.7
GOLDEN STATE WATER COMPANY (SGV)	Encinita No. 1, 2 & 3	April 1998	1,633.97	37,125.27	28.0	825.7
HERMETIC SEAL CORPORATION	Hermetic Seal	May 2012	37.97	584.18	3.6	57.3
<b>PVOU</b>						
BDP - CARRIER	Carrier 2/	April 1988	0.00	6,789.57	0.0	2,843.1
<b>SEMOU</b>						
MONTEREY PARK, CITY OF	Well No. 5 Well No. 9 & 12, 15	September 1999 April 2002	0.00 3,649.46	20,090.00 103,809.55	0.0 365.2	1,404.2 16,643.4
SAN GABRIEL VALLEY WATER COMPANY	Well 8B, 8C, 8D & 8E	August 2002	3,011.58	62,180.70	643.0	10,753.6
GOLDEN STATE WATER COMPANY (SGV)	San Gabriel No.1 & 2	November 2001	1,461.15	29,757.84	35.5	827.8
<b>WNOU</b>						
EPA	WNOU (Shallow Zone) 2/	December 1999	—	30,065.52	—	1,618.9
SAN GABRIEL VALLEY WATER COMPANY	WNOU (Intermediate Zone) 4/	December 2005	1,838.23	65,832.23	4.2	1,892.2
<b>PRODUCER FACILITY</b>						
ARCADIA, CITY OF	Longden 1 & 2 Live Oak 1	January 1985 July 2021	161.28 3,612.75	73,140.38 6,912.73	0.6 26.4	762.3 62.0
BOZUNG	Well B36, F38, F39 & BC34 5/	October 1994	—	233.00	—	131.3
COVINA IRRIGATING COMPANY	Baldwin 1, Baldwin 2, & Baldwin 3	April 2021	2,283.62	5,310.46	9.4	13.0
EL MONTE, CITY OF	Well No. 12 Well No. 10 2/ Well No. 2A	February 1997 May 2004 July 1999	47.36 — 378.83	16,641.24 6,380.82 13,054.89	9.1 — 4.0	1,209.3 43.4 172.0
EPA	Richwood (North Well) 6/ Richwood (South Well) 6/	April 1990 April 1990	—	451.98	—	5.8

Operable Unit	Treatment Facility(s)	Start Date 1/	Total Water Treated		Total Contaminants Removed	
			Fiscal Year 2022-23 (Acre-feet)	Accum. Total (Acre-feet)	Fiscal Year 2022-23 (Pounds)	Accum. Total (Pounds)
<b>PRODUCER FACILITY</b>						
GOLDEN STATE WATER COMPANY (SD)	Art 2 & 3, Base 3 & 4, Hwy 1	May 2005	0.00	19,839.17	0.0	367.7
GOLDEN STATE WATER COMPANY (SGV)	Garvey No. 3	June 2016	656.26	3,696.42	7.2	36.6
HEMLOCK MUTUAL WATER COMPANY	Hemlock (North Well) 2/ Hemlock (South Well) 2/	April 1986 April 1986	—	2,553.65	—	44.6
MONROVIA, CITY OF	Wells No. 2 & 6 Wells No. 3, 4 & 5	March 1996 October 2007	2,613.51 1,602.57	56,884.39 29,809.02	81.3 7.4	1,239.3 248.8
MONTEREY PARK, CITY OF	Well No. 1, 3, 10 & Fern	June 2004	2,464.17	37,596.48	85.4	1,963.0
SAN GABRIEL VALLEY WATER COMPANY	Well 11B Well B11B Well B7C 7/ Well B4B & B4C Well G4A	March 1991 March 1993 March 1993 January 1999 December 2005	0.00 578.46 — — 600.31	45,136.03 52,425.36 46,711.28 24,093.04 6,869.27	0.0 26.2 — — 42.7	320.1 3,548.6 1,824.2 1,233.5 193.3
SOUTH PASADENA, CITY OF	Wilson 3 & Wilson 4	January 2019	2,779.27	14,361.99	216.8	1,034.0
SUBURBAN WATER SYSTEMS	Well No. 140W-4 2/	May 2001	—	2,247.59	—	16.2
VALLEY COUNTY WATER DISTRICT	Maine East & West Nixon East & West	June 1990 January 2004	2,438.36 3,224.85	68,238.53 71,179.35	0.2 3.4	1,831.6 337.6
WATER QUALITY AUTHORITY	Arrow (Project No. 1) 2/ Big Dalton (Project No. 2) 2/ Whitmore Street SEMOU	February 1992 March 1997 January 2008 July 1999	— — 12.98 —	7,250.41 1,229.02 373.50 3,885.19	— — 6.7 —	17,423.0 82.5 211.1 1,558.5
TOTAL			77,960.15	1,982,727.25	6,983.4	211,681.0

Footnotes:

- 1/ From date of beginning of operation.
- 2/ Well(s) no longer pumps to treatment facility.
- 3/ EMOU (Deep Zone) operation transferred to City of El Monte in January 2019.
- 4/ Previously operated by City of Whittier from December 2005 to May 2013.
- 5/ Treatment facility has been permanently dismantled.
- 6/ Wells destroyed in June 1999.
- 7/ Well destroyed in October 2016.



---

## **APPENDIX F.**


**SIMULATED BASIN GROUNDWATER CONTOURS  
2022-23 AND 2027-28  
(FIGURES 15 AND 16),**

**SIMULATED GROUNDWATER ELEVATION  
CHANGES BETWEEN FY 2022-23 AND  
FY 2027-28 (FIGURE 17),**

**VOC PLUME MAP IN BPOU AND  
PERCHLORATE PLUME MAP IN BPOU  
(FIGURES 18 AND 19)**





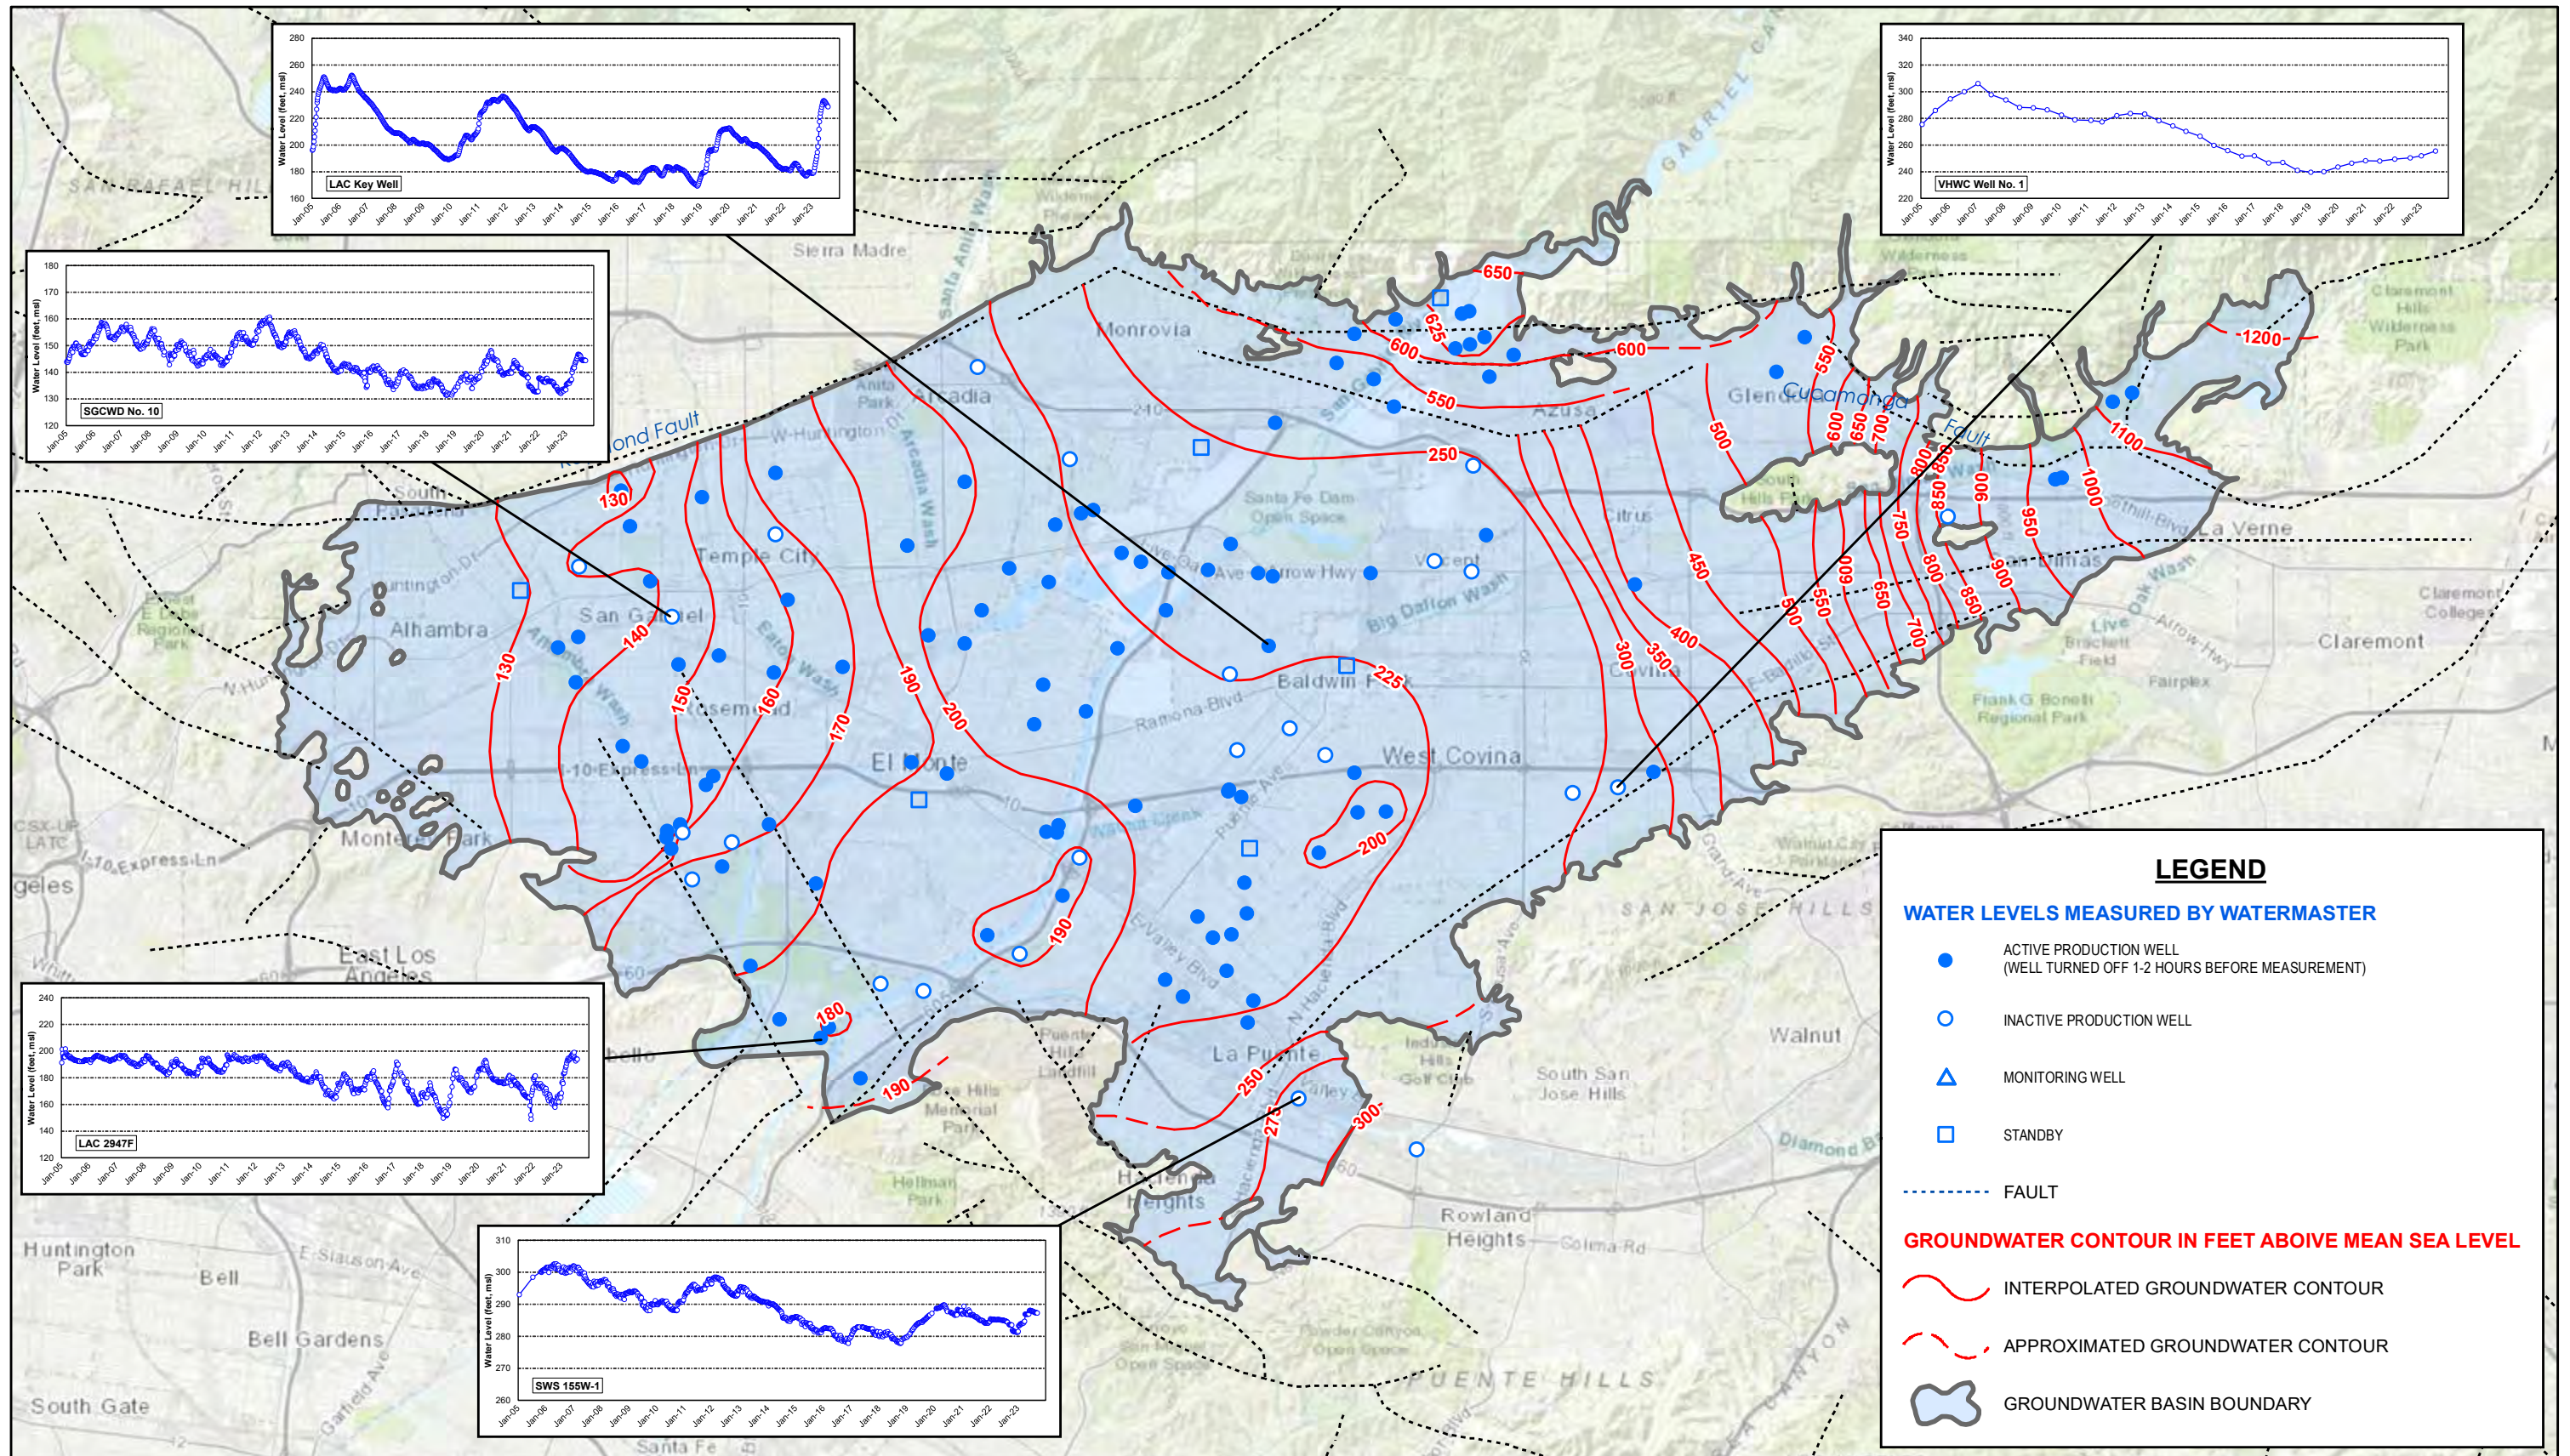

**LEGEND**

**WATER LEVELS MEASURED BY WATERMASTER**

- ACTIVE PRODUCTION WELL (WELL TURNED OFF 1-2 HOURS BEFORE MEASUREMENT)
- INACTIVE PRODUCTION WELL
- ▲ MONITORING WELL
- STANDBY
- FAULT


**GROUNDWATER CONTOUR IN FEET ABOVE MEAN SEA LEVEL**

- INTERPOLATED GROUNDWATER CONTOUR
- - - APPROXIMATED GROUNDWATER CONTOUR
- ⬭ GROUNDWATER BASIN BOUNDARY

**STETSON ENGINEERS INC**  
 861 VILLAGE OAKS DRIVE, SUITE 100  
 COVINA, CALIFORNIA 91724  
 TEL: (626) 967-6202  
 FAX: (626) 331-7065

2171 E Francisco Blvd., Suite K  
 San Rafael California 94901


2651 W Guadalupe Rd., Suite A209  
 Mesa Arizona 85202



**MAIN SAN GABRIEL BASIN WATERMASTER**

**GROUNDWATER CONTOUR MAP FOR SAN GABRIEL BASIN - JULY 2023**



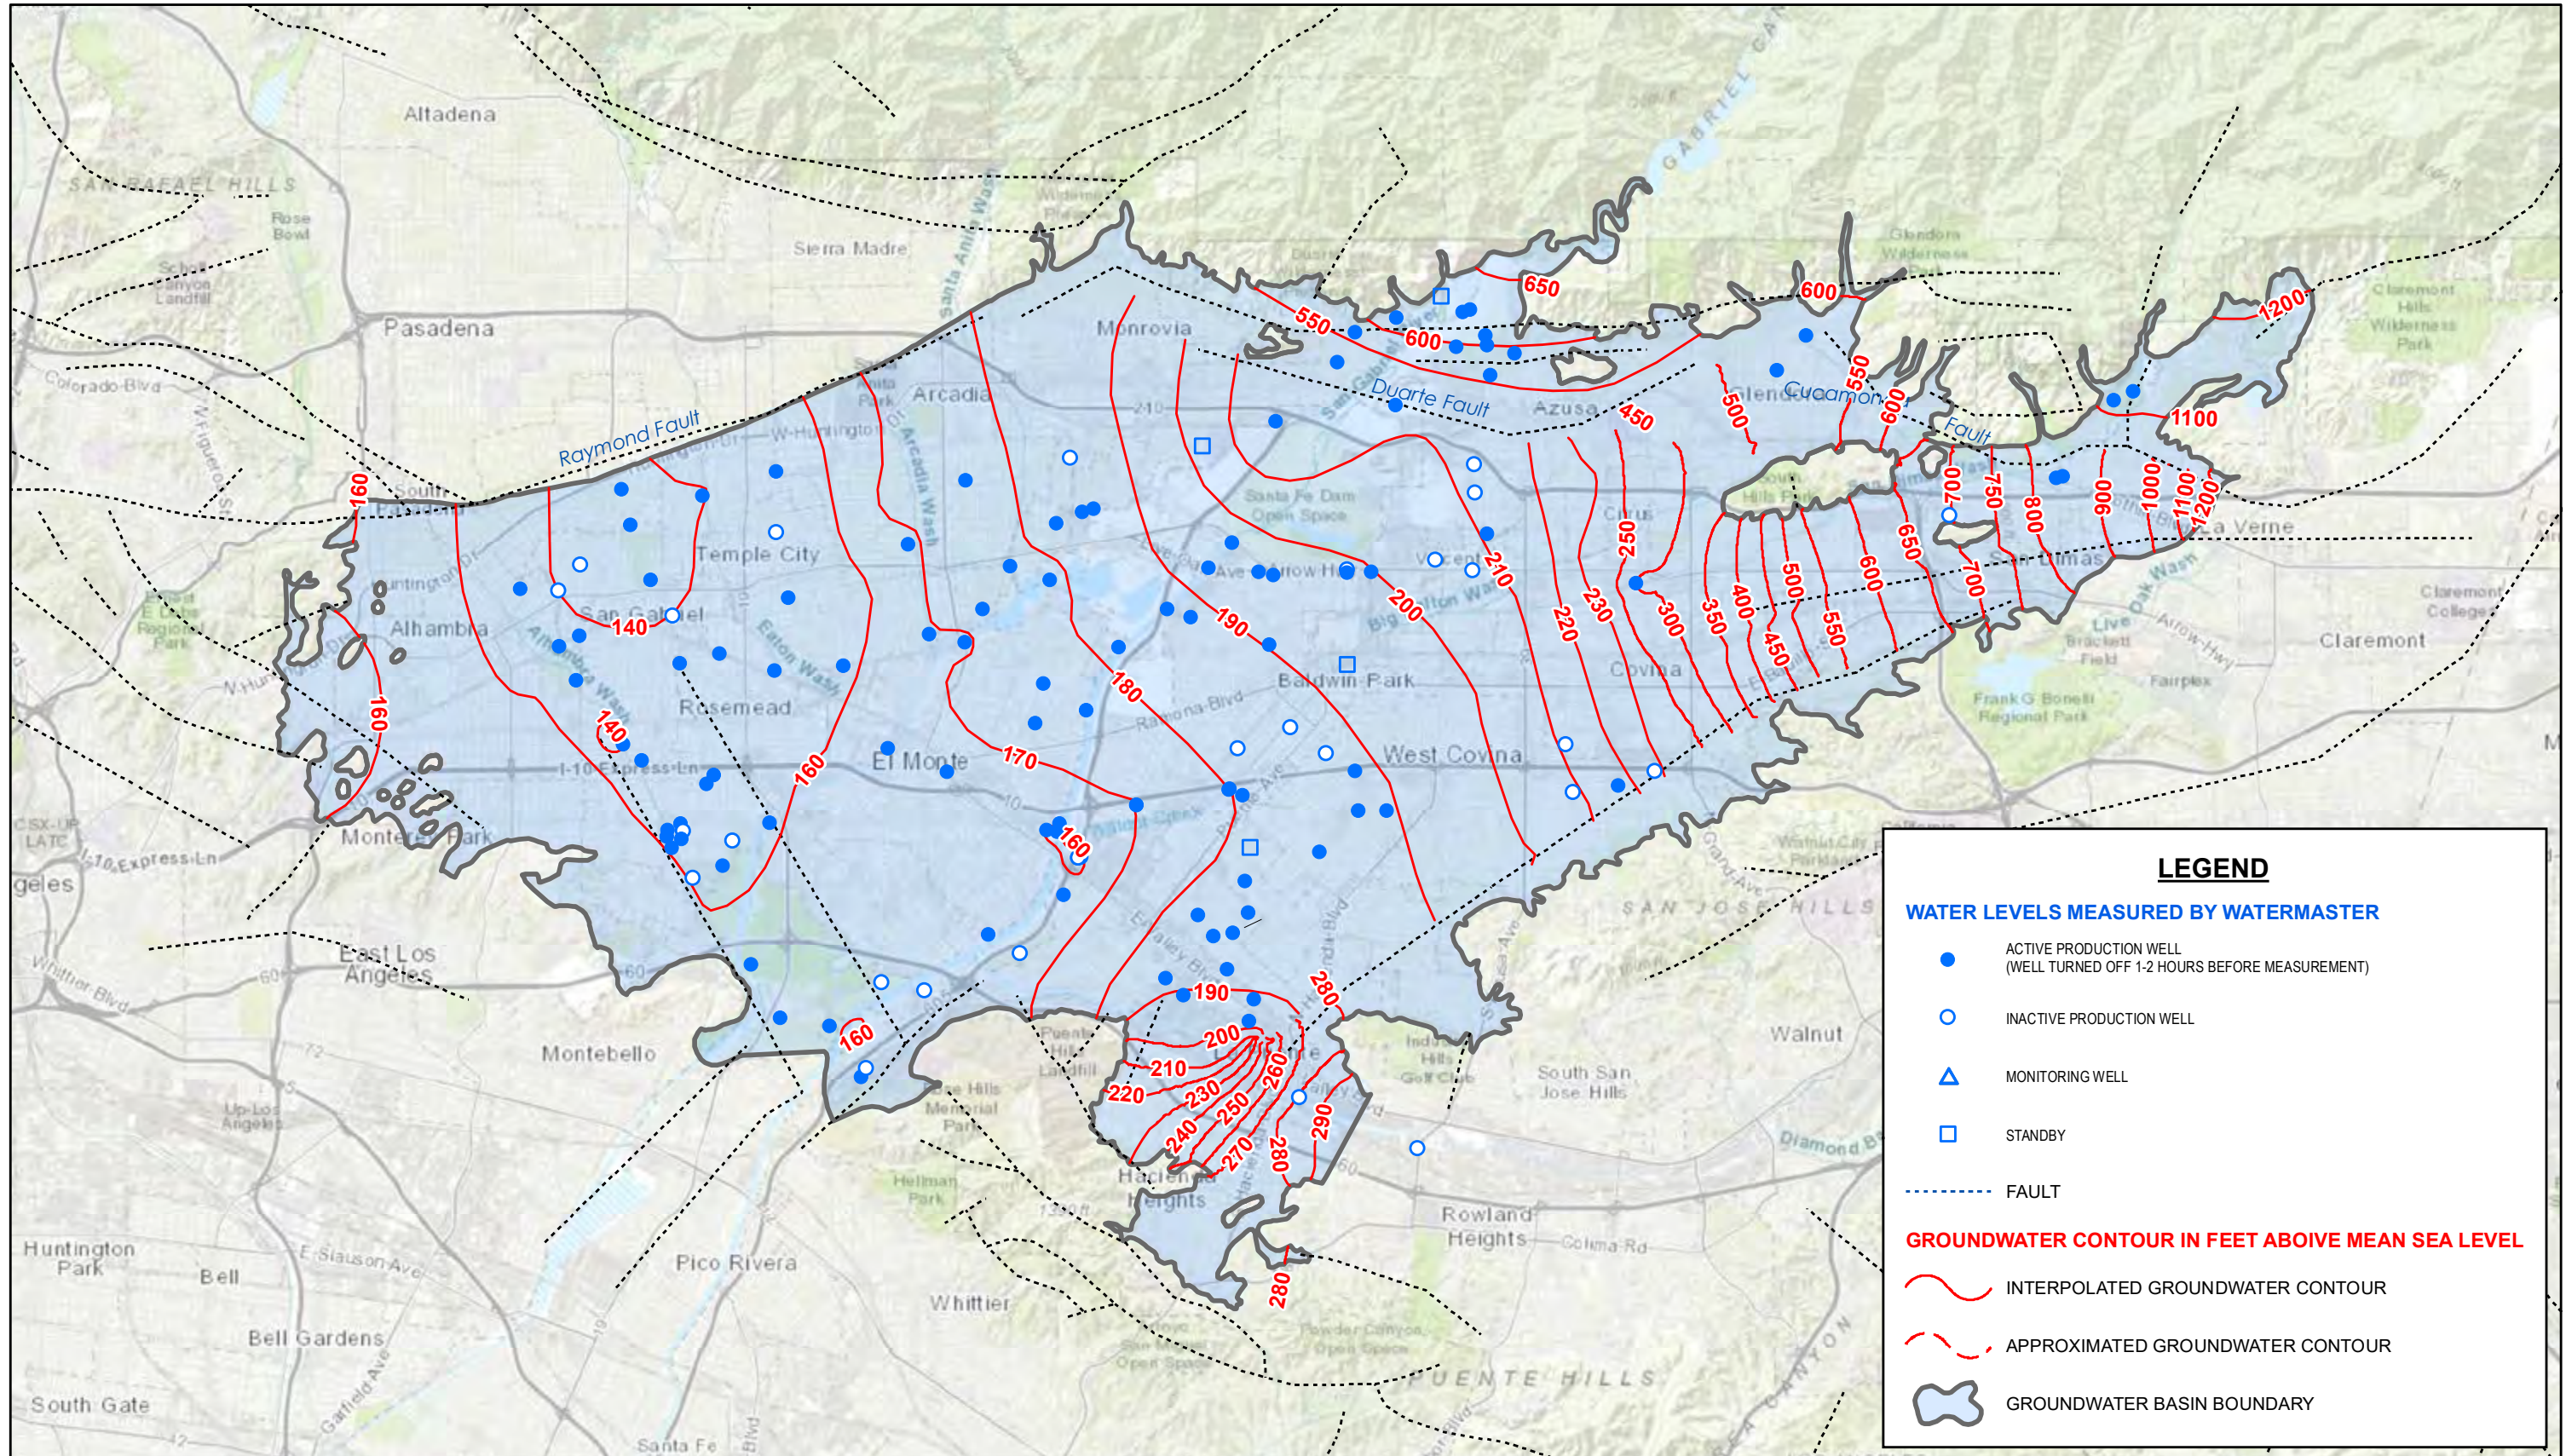


**LEGEND**


**WATER LEVELS MEASURED BY WATERMASTER**

- ACTIVE PRODUCTION WELL (WELL TURNED OFF 1-2 HOURS BEFORE MEASUREMENT)
- INACTIVE PRODUCTION WELL
- ▲ MONITORING WELL
- STANDBY
- FAULT

**GROUNDWATER CONTOUR IN FEET ABOVE MEAN SEA LEVEL**

- ~ INTERPOLATED GROUNDWATER CONTOUR
- - - APPROXIMATED GROUNDWATER CONTOUR
- ⬭ GROUNDWATER BASIN BOUNDARY


 861 VILLAGE OAKS DRIVE, SUITE 100  
 COVINA, CALIFORNIA 91724  
 TEL: (626) 967-6202  
 FAX: (626) 331-7065  
  
 2171 E Francisco Blvd., Suite K  
 San Rafael California 94901  
 2651 W Guadalupe Rd., Suite A209  
 Mesa Arizona 85202



**MAIN SAN GABRIEL BASIN WATERMASTER**

**2027-28 SAN GABRIEL BASIN GROUNDWATER CONTOUR MAP**



# SIMULATED GROUNDWATER ELEVATION CHANGES BETWEEN FY 2022-23 AND FY 2027-28


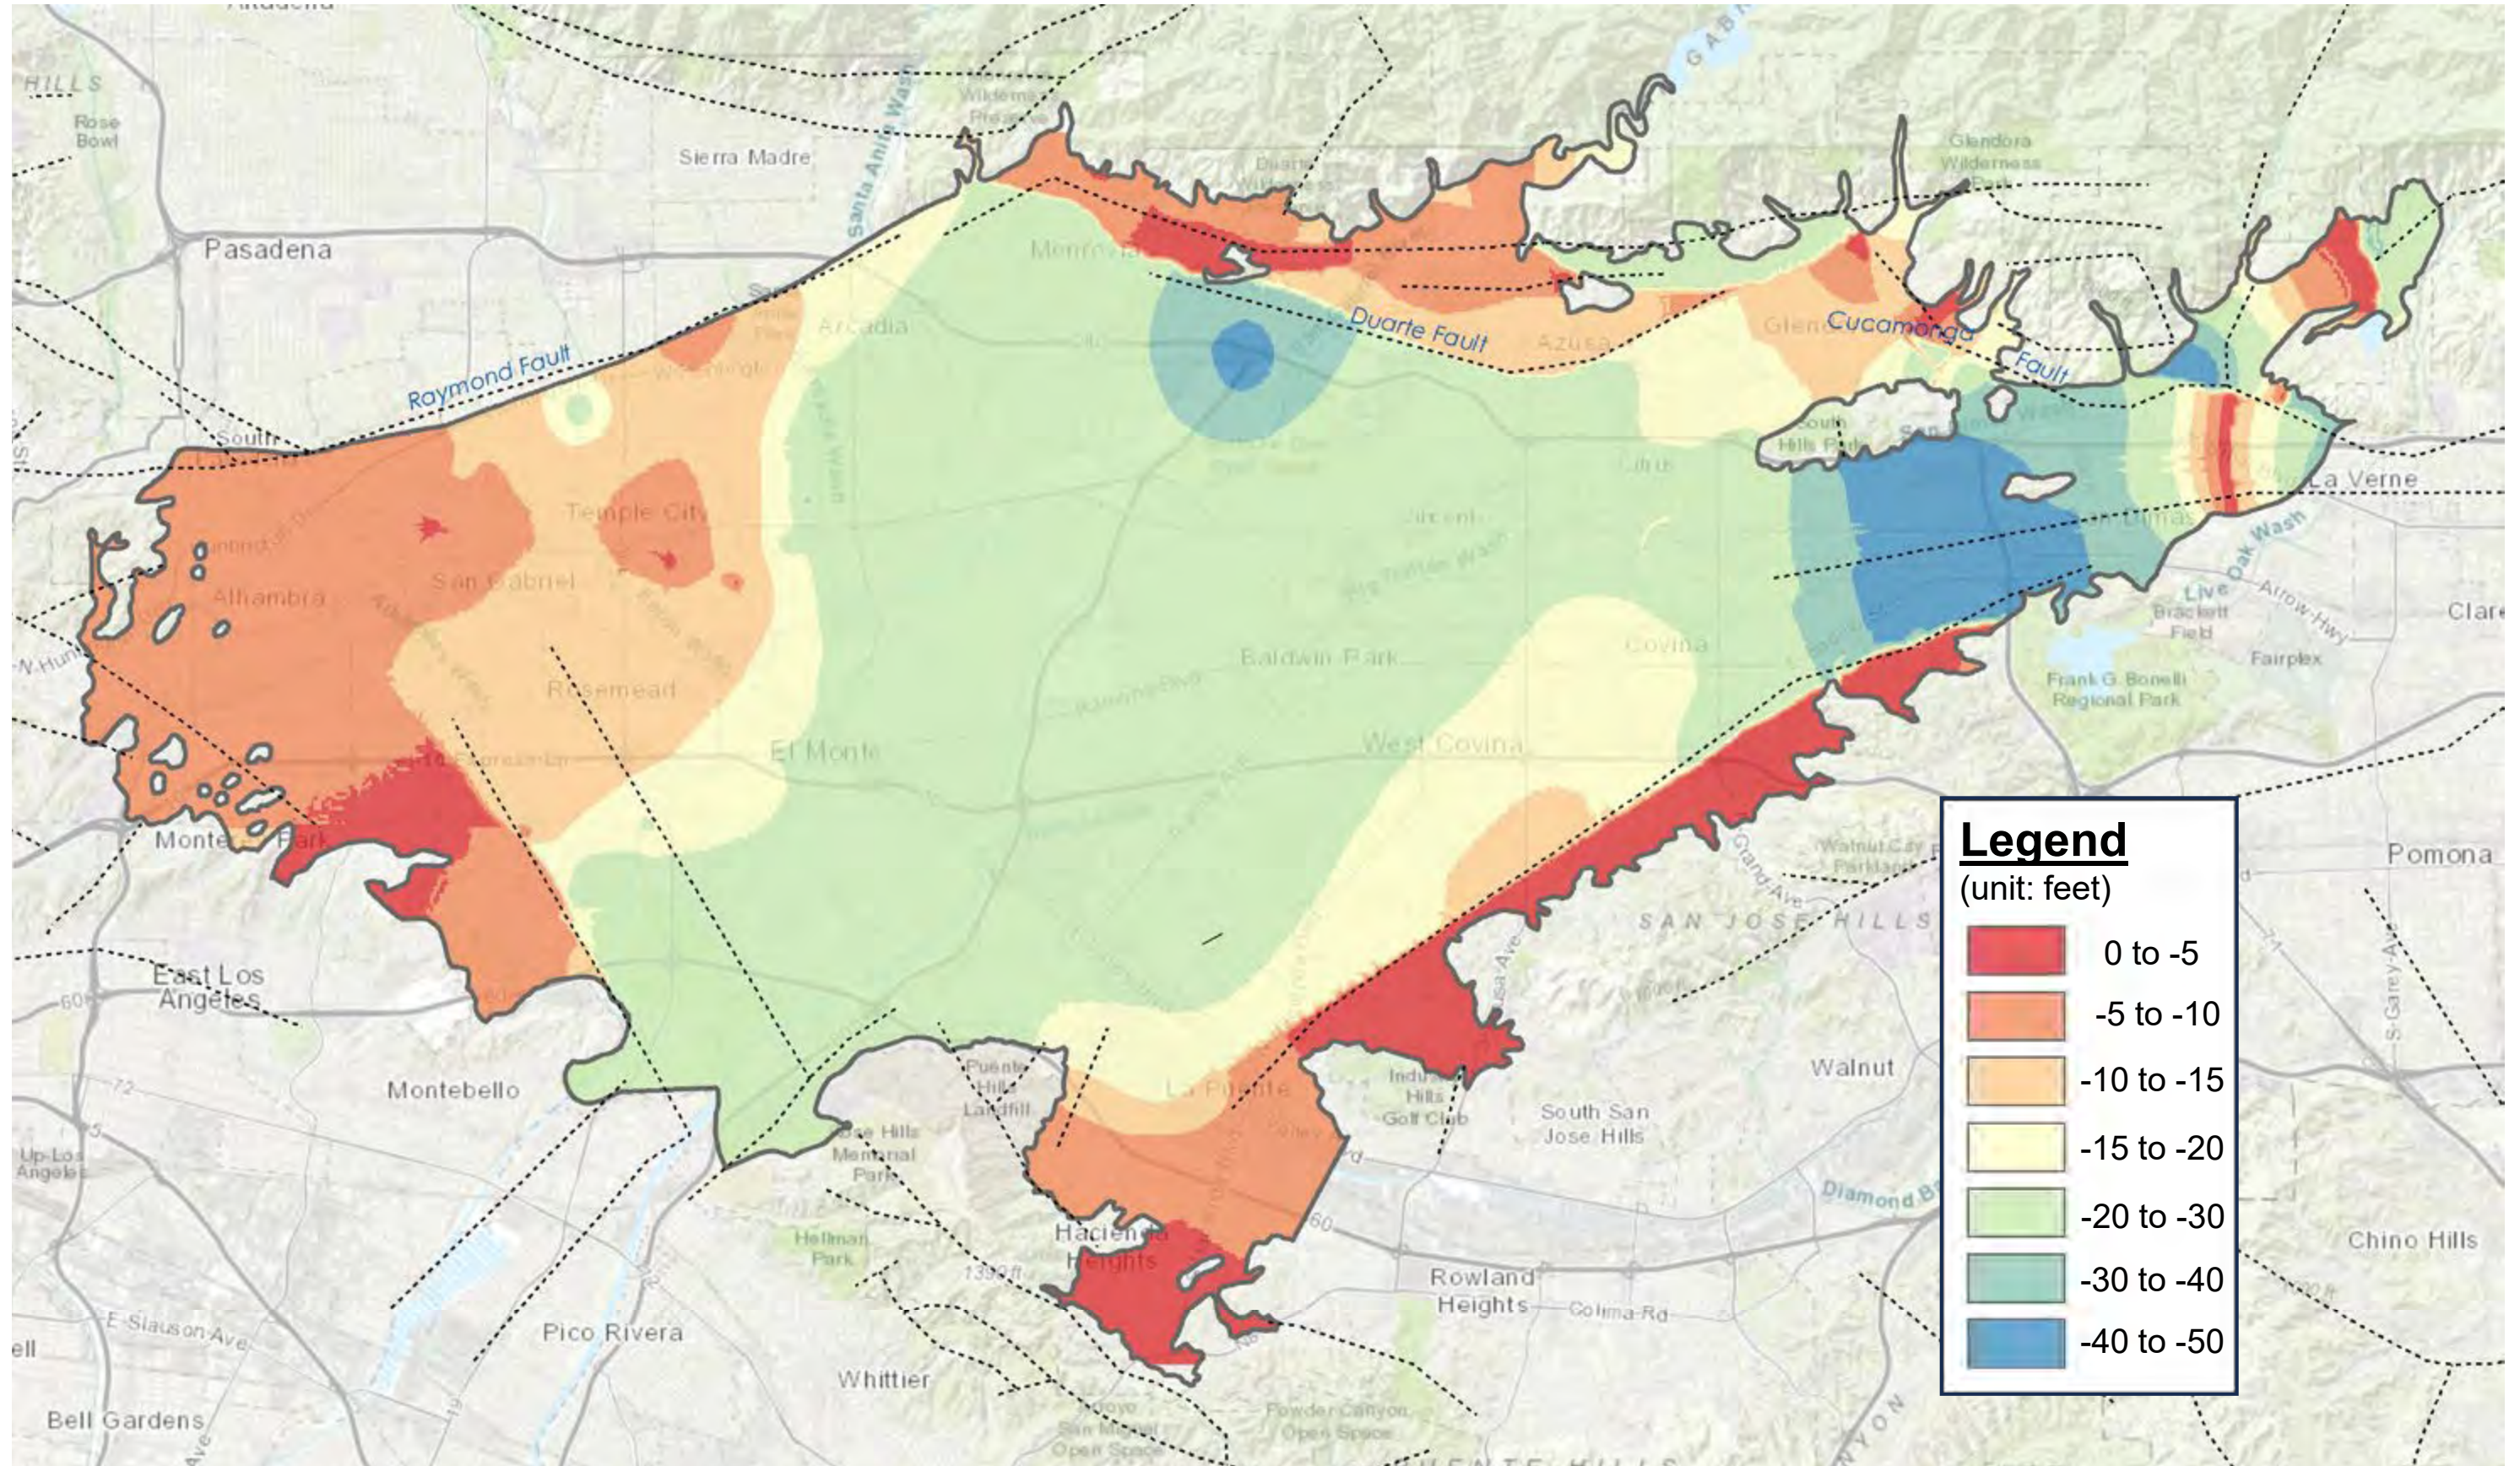


FIGURE 18 VOC PLUME MAPS

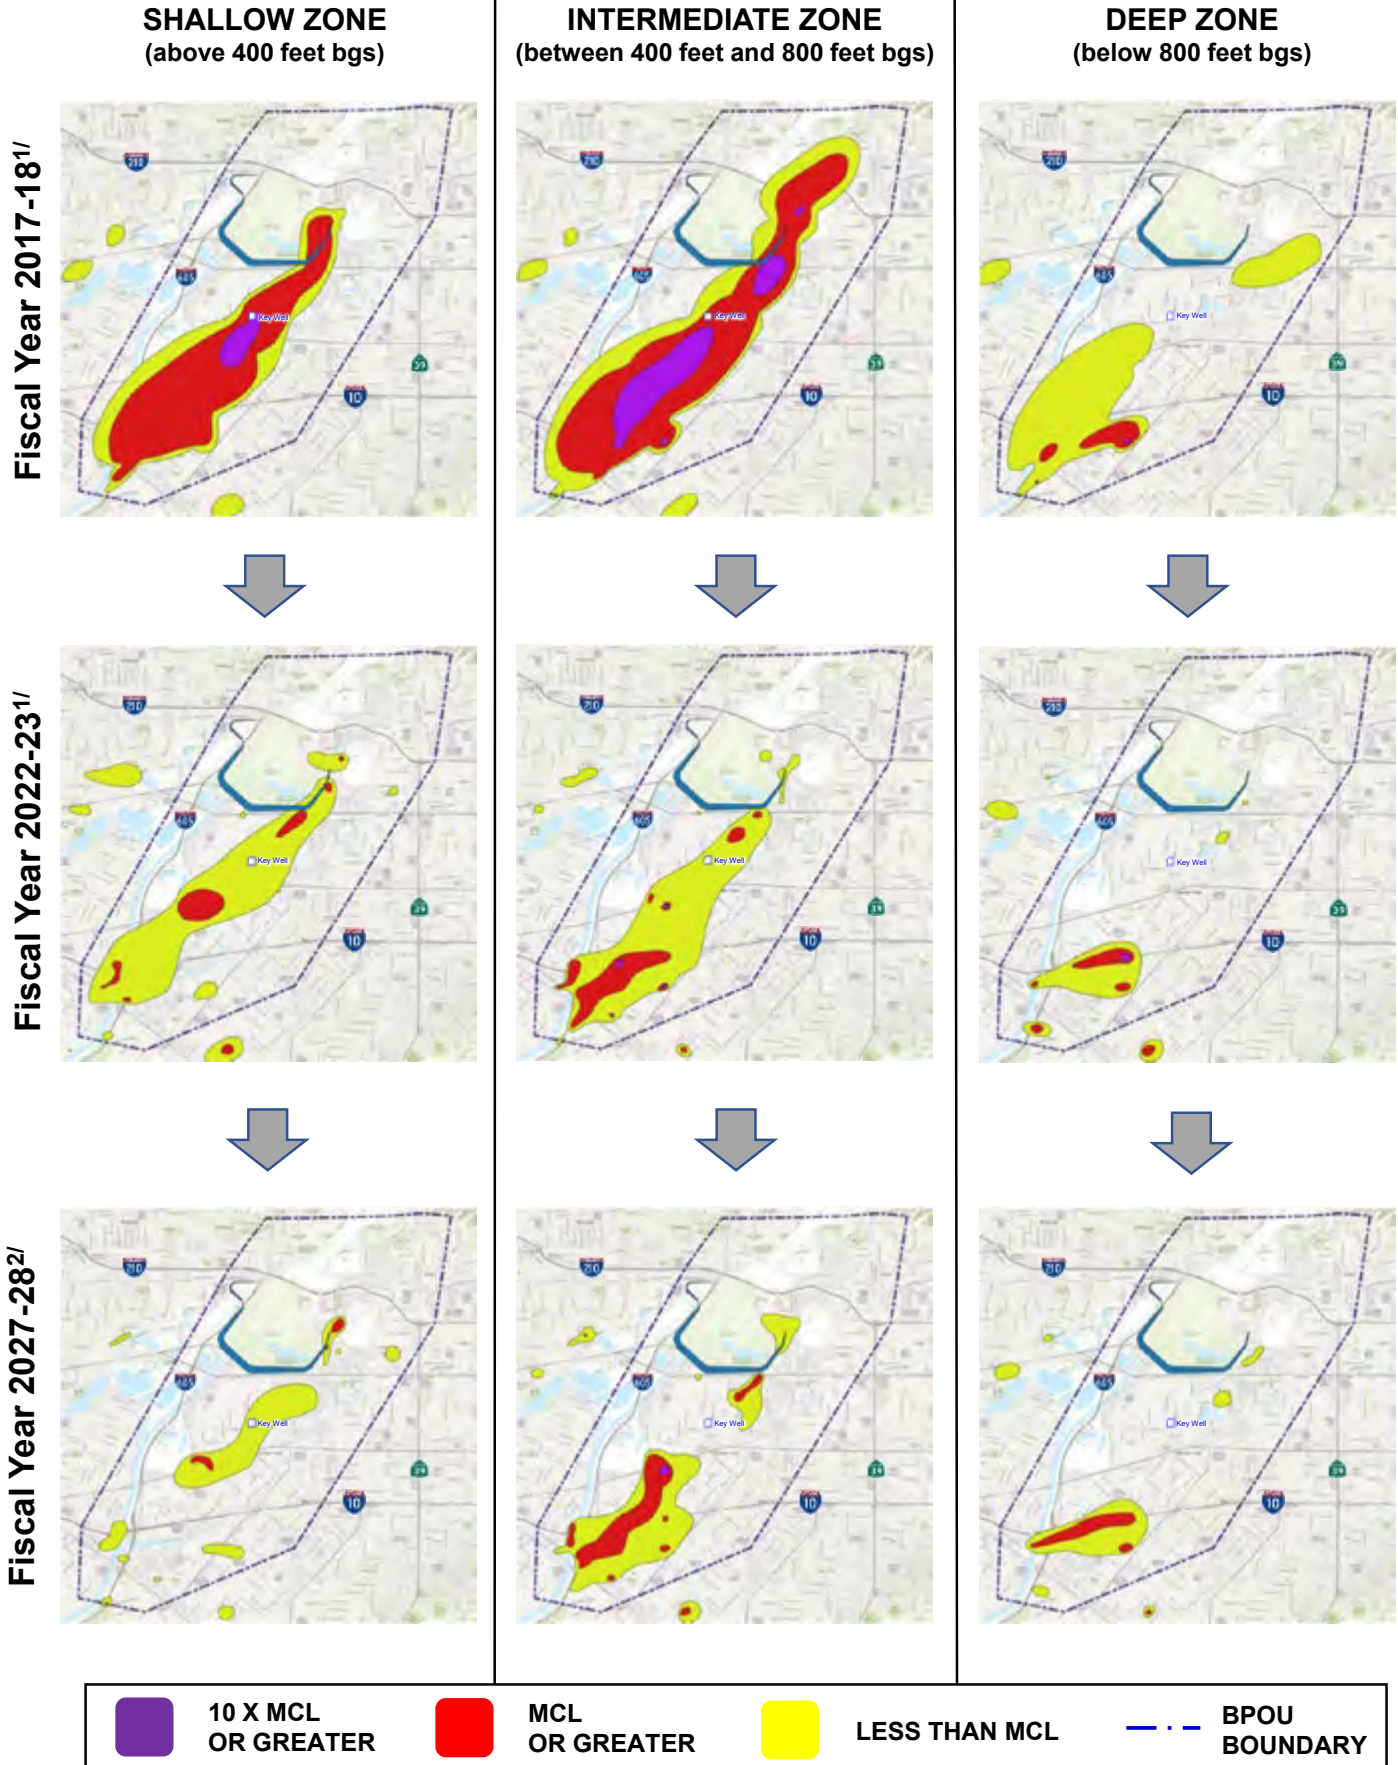

1/ Interpolated composite VOC plumes based on existing water quality data

2/ Projected composite VOC plume



**FIGURE 19 PLUME MAPS**

**SHALLOW ZONE**  
(above 400 feet bgs)


**INTERMEDIATE ZONE**  
(between 400 feet and 800 feet bgs)

**DEEP ZONE**  
(below 800 feet bgs)


**Fiscal Year 2017-18<sup>1/</sup>**

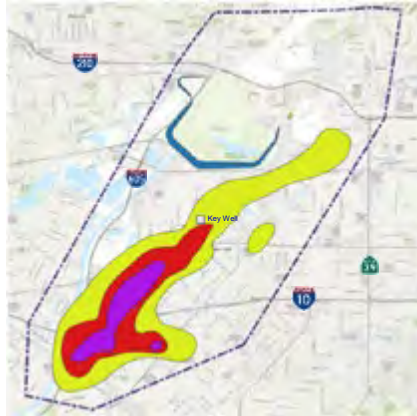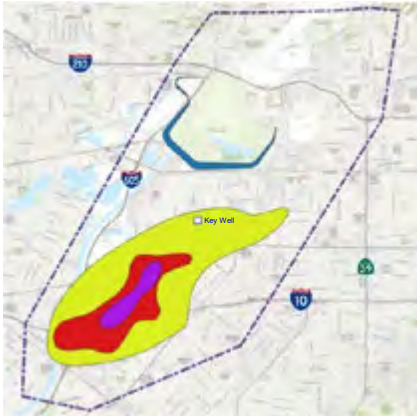

**Fiscal Year 2022-23<sup>1/</sup>**

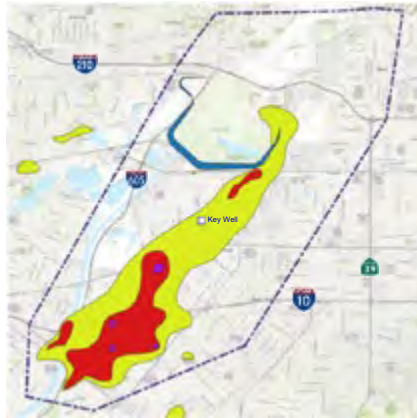

**Fiscal Year 2027-28<sup>2/</sup>**

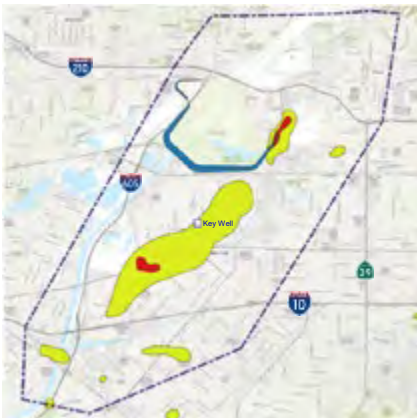

1/ Interpolated Perchlorate plumes based on existing water quality data  
2/ Projected Perchlorate plume





### **WATERMASTER BOARD**

- Lynda Noriega**, Chair – California Domestic Water Company  
**David Michalko**, Vice Chair – Valencia Heights Water Company  
**Martin Zvirbulis**, Secretary – San Gabriel Valley Water Company  
**Anteneh Tesfaye**, Treasurer – City of South Pasadena  
**David De Jesus**, Covina Irrigating Company  
**Anthony R. Fellow**, Upper San Gabriel Valley Municipal Water District  
**Benjamin Lewis, Jr.**, Golden State Water Company  
**Steven Placido**, San Gabriel Valley Municipal Water District  
**Jennifer Santana**, Upper San Gabriel Valley Municipal Water District

### **EXECUTIVE OFFICER**

**Anthony C. Zampielo**

725 North Azusa Avenue • PO Box 1329 • Azusa, California 91702

Telephone (626) 815-1300 • Fax (626) 815-1303

[www.watermaster.org](http://www.watermaster.org)